

MANAGING OUR ENVIRONMENT

Manual for On-Site Wastewater Design and Management

Technical Report to Support Policy Development



Manual for On-siteSite Wastewater Systems Design and Management

Technical Report to Support Policy Development



November 2009
Version 3

Authors

Harold Barnett

~~Enviromental~~Environmental Scientist

~~A.W.(Sandy)~~ Ormiston

Ormiston Associates Ltd, Auckland

Acknowledgements to

Jon Roygard
Science Manager

Richard Munneke
Policy Manager

Maree Clark
Research Associate

Pam Grey
Proof Reader

Jemma Callaghan
Regional Planning Group Secretary

Auckland Regional Council is gratefully acknowledged for allowing the use of material from Technical Publication No. 58 (TP58) – On-Site Wastewater Systems, Design and Management Manual

April 2007

November 2009

ISBN: ~~978-1-877413-69-0~~

~~877516-82-5~~

Report No: ~~2007~~2009/EXT/~~778~~1055

CONTACT | 24hr Freephone 0508 800 800

help@horizons.govt.nz

www.horizons.govt.nz

| | | | | | |
|------------------------|--|------------------------|--|---------------|---|
| SERVICE CENTRES | Kairanga Cnr Rongotea and Kairanga-Bunnythorpe Rds Palmerston North | REGIONAL HOUSES | Palmerston North 11-15 Victoria Avenue | DEPOTS | Dannevirke Weber Road |
| | Marton Hammond Street | | Wanganui 181 Guyton Street | | Levin 11 Bruce Road |
| | Taumarunui 34 Maata Street | | | | Pahiatua Cnr Huxley and Queen Streets |
| | | | | | Taihape Torere Road Ohotu |

POSTAL ADDRESS

Horizons Regional Council, Private Bag 11025, Manawatu Mail Centre, Palmerston North 4442

F 06 9522 929

CONTENTS

| | |
|--|------------------------------------|
| 1. INTRODUCTION | 1 |
| 1.1 General | 1 |
| 1.2 THE MANAWATU-WANGANUI Horizons' Region | 1 |
| 1.2.1 Our The Region | 1 |
| 1.2.2 Our The Region's People | 4 |
| 1.3 Regional Rules | 5 |
| 1.3.1 Permitted Activity Rules | 5 |
| 1.3.2 Existing discharges of domestic wastewater | 1.4 |
| Cumulative Effects | 9 |
| 1.3.3 New and upgraded discharges of domestic wastewater | 1.5 |
| Decentralised vs On-Site Wastewater Disposal | 10 |
| 1.3.4 Discharges of domestic wastewater not complying with Rules 13-9 and 13-10 of the One Plan | 1.5.1 |
| Decentralised Systems | 10 |
| 1.3.5 Human effluent storage and treatment facilities | 1.5.2 |
| Individual On-Site Systems | 10 |
| 1.3.6 Discharge of untreated human effluent directly into surface water | 1.6 |
| Who Should Use This Design Manual | 10 |
| 1.4 CUMULATIVE EFFECTS | 1.7 |
| Who Should Design On-Site Systems | 11 |
| 1.5 DECENTRALISED VS ON-SITE WASTEWATER DISPOSAL | 1.8 |
| Minimum Reporting Requirements | 11 |
| 1.5.1 Decentralised Systems | 1.9 |
| Assessment of Environmental Effects (AEE) | 12 |
| 1.5.2 Individual On-Site Systems | 1.10 |
| Successful On-Site System Design | 13 |
| 1.6 WHO SHOULD USE THIS DESIGN MANUAL | 2. |
| | SITE ASSESSMENT METHODOLOGY |
| | 15 |
| 1.7 WHO SHOULD DESIGN ON-SITE SYSTEMS | 2.1 |
| Introduction | 15 |
| 1.8 MINIMUM REPORTING REQUIREMENTS | 2.1.1 |
| Site Investigation and Assessment | 15 |
| 1.9 ASSESSMENT OF ENVIRONMENTAL EFFECTS | 2.2 |
| Soakage Testing vs Soil Category Assessment | 21 |
| 1.10 SUCCESSFUL ON-SITE SYSTEM DESIGN | 2.3 |
| Separation Distances | 22 |
| 2. SITE ASSESSMENT METHODOLOGY | 2.4 |
| Review of Development Plans | 23 |
| 2.1 INTRODUCTION | 2.5 |
| Reserve Wastewater Land Application Area | 24 |
| 2.1.1 Site Investigation and Assessment | 3. |
| | WASTEWATER PRODUCTION |
| | 27 |
| 2.2 SOAKAGE TESTING VS SOIL CATEGORY ASSESSMENT | 3.1 |
| Introduction | 27 |

| | | |
|--------------|--|-----------------------------------|
| 2.3 | SEPARATION DISTANCES | 3.2 |
| | Occupancy Assessment | 27 |
| 2.4 | REVIEW OF DEVELOPMENT PLANS | 3.3 |
| | Wastewater Production Assessment | 27 |
| 2.5 | RESERVE WASTEWATER DISPOSAL AREA | 3.3.1 |
| | Daily Wastewater Production Assessment Worked Example | 31 |
| 34. | WASTEWATER PRODUCTION | TREATMENT |
| | | 33 |
| 34.1 | Introduction | 33 |
| 3.2 | OCCUPANCY ASSESSMENT | 4.1.1 |
| | Water Tightness | 34 |
| 3.3 | WASTEWATER PRODUCTION ASSESSMENT | 4.2 |
| | Primary Treatment | 34 |
| 3.3.1 | <i>Daily Wastewater Production Assessment Worked Example</i> | 4.2.1 |
| | Individual Dwelling Septic Tank Capacities | 35 |
| 4. | WASTEWATER TREATMENT | 4.2.2 |
| | Septic Tank Effluent Outlet Solids Control Devices | 37 |
| 4.1 | INTRODUCTION | 4.2.3 |
| | Grease Traps | 39 |
| 4.1.1 | <i>Water Tightness</i> | 4.2.4 |
| | Septic Tank Pump-out | 39 |
| 4.2 | PRIMARY³ | Secondary Treatment |
| | 40 | |
| 4.2.1 | <i>Individual Dwelling Septic Tank Capacities</i> | 4.4 |
| | Advanced Secondary Treatment | 41 |
| 4.2.2 | <i>Septic Tank Effluent Outlet Solids Control Devices</i> | 4.4.1 |
| | Sand Filters | 41 |
| 4.2.3 | <i>Grease Traps</i> | 4.4.2 |
| | Textile Filters | 44 |
| 4.2.4 | <i>Septic Tank Pump-out</i> | 4.4.3 |
| | Membrane Bioreactors (MBR) | 45 |
| 4.3 | ALTERNATIVE WASTEWATER⁵ | Tertiary Treatment SYSTEMS |
| | 46 | |
| 4.4 | SECONDARY TREATMENT | 4.5.1 |
| | Disinfection | 46 |
| 4.5 | ADVANCED SECONDARY TREATMENT | 4.5.2 |
| | Nutrient Reduction | 47 |
| 4.5.1 | <i>Sand Filters</i> | 4.6 |
| | Pump Chambers and Emergency Storage | 48 |
| 4.5.2 | <i>Textile Filters</i> | 4.6.1 |
| | Alarms | 48 |
| 4.5.3 | <i>Membrane Bioreactors (MBR)</i> | 4.6.2 |
| | Emergency Storage | 48 |
| 4.6 | TERTIARY TREATMENT | 4.7 |
| | System Construction Integrity | 49 |
| 4.6.1 | <i>Disinfection</i> | 4.8 |
| | Greywater | 49 |
| 4.6.2 | <i>Nutrient Reduction</i> | 4.8.1 |
| | Greywater Recycling | 49 |
| 4.7 | PUMP CHAMBERS AND EMERGENCY STORAGE | 4.9 |
| | Alternative Wastewater Treatment Systems | 49 |

| | | | |
|----------------|--|--|--------------|
| 4.79.1 | <i>Alarms</i> | <u>Composting Toilets</u> | |
| | 50 | | |
| 4.7.2 | Emergency Storage | | 5. |
| | | DOSING AND DISTRIBUTION METHODS AND DEVICES | |
| | | | 51 |
| 4.8 | SYSTEM CONSTRUCTION INTEGRITY | | 5.1 |
| | <i>Controlled Loading Devices</i> | | 51 |
| 4.9 | GREYWATER | | 5.1.1 |
| | <i>Pump-Controlled Dose Loading</i> | | 51 |
| 4.9.1 | <i>Greywater Recycle</i> | | 5.1.2 |
| | <i>Siphon-Controlled Dose Loading</i> | | 51 |
| 4.10 | COMPOSTING TOILETS | | 5.2 |
| | <i>Controlled Dose Loading Methods</i> | | 51 |
| 5. | DOSING AND DISTRIBUTION METHODS AND DEVICES | | 5.2.1 |
| | <i>On-Demand Dose Loading</i> | | 51 |
| 5.1-2.2 | Timer-Controlled Dose Loading DEVICES | | 52 |
| 5.1.1 | <i>Pump-Controlled Dose Loading</i> | | 5.3 |
| | <i>Uncontrolled Gravity Loading</i> | | 52 |
| 5.1.2 | <i>Siphon-Controlled Dose Loading</i> | | 5.4 |
| | <i>Distribution to the Land Application System</i> | | 52 |
| 5.2 | CONTROLLED DOSE LOADING METHODS | | 5.5 |
| | <i>Distribution Methods within the Land Application System</i> | | 52 |
| 5.25.1 | <i>On-Demand Dose Flood Loading</i> | | 52 |
| 5.5.2.2 | <i>Timer-Controlled</i> | <i>Dose Loading</i> | |
| | 53 | | |
| 5.3 | UNCONTROLLED GRAVITY LOADING | | 5.5.3 |
| | <i>Distribution Aggregate</i> | | 53 |
| 5.4 | DISTRIBUTION TO THE LAND APPLICATION SYSTEM | | 6. |
| | | LAND APPLICATION METHODS | |
| | | | 55 |
| 5.5 | DISTRIBUTION METHODS WITHIN THE LAND APPLICATION SYSTEM | | 6.1 |
| | <i>Discussion</i> | | 55 |
| 5.5.1 | <i>Distribution Aggregate</i> | | 6.2 |
| | <i>Land Application Area Sizing</i> | | 55 |
| 6. | LAND APPLICATION METHODS | | 6.2.1 |
| | <i>Areal Loading Rate Design</i> | | 56 |
| 6.1 | DISCUSSION | | 6.2.2 |
| | <i>Basal Loading Design</i> | | 56 |
| 6.2 | DISPOSAL AREA SIZING | | 6.2.3 |
| | <i>Land Application System Method and Design Area Calculation</i> | | |
| | <i>Method</i> | | 56 |
| 6.2.1 | <i>Areal Loading Rate Design</i> | | 6.3 |
| | <i>Pressure Compensating Dripper Irrigation</i> | | 57 |
| 6.2.2 | <i>Basal Loading Design</i> | | 6.3.1 |
| | <i>Subsurface Pressure Compensating Dripper Irrigation</i> | | 57 |
| 6.2.3 | <i>Land Application System Method and Design Area Calculation Method</i> | | 6.3.2 |
| | <i>Surface Pressure Compensating Dripper Irrigation</i> | | 58 |
| 6.3 | PRESSURE COMPENSATING DRIPPER IRRIGATION | | 6.3.3 |
| | <i>PCDI Areal Loading Rates</i> | | 58 |

| | | |
|--------------|--|-----------------------------------|
| 6.3.1 | <i>Sub-surface Pressure Compensating Dripper Irrigation</i> | 6.3.4 |
| | PCDI Head Loss Assessment | 59 |
| 6.3.2 | <i>Surface 5 Pressure Compensating Dripper Irrigation Design Example</i> | |
| | 60 | |
| 6.3.3 | <i>Areal Loading Rates</i> | 6.3.6 |
| | PCDI Installation | 60 |
| 6.3.4 | <i>Loading Methods</i> | 6.3.7 |
| | Root Intrusion | 61 |
| 6.3.5 | <i>Pressure Compensating Dripper Irrigation Design Example</i> | 6.3.8 |
| | Maintenance | 61 |
| 6.3.6 | <i>PCDI Installation</i> | 6.3.9 |
| | Shallow Trenches and Low Pressure Effluent Distribution (LPED) | 62 |
| 6.3.7 | <i>Root Intrusion</i> | 6.4 |
| | Trench Systems | 64 |
| 6.3.8 | <i>Maintenance</i> | 6.4.1 |
| | General | 64 |
| 6.4 | TRENCH SYSTEMS | 6.4.2 |
| | Conventional Trenches | 64 |
| 6.4.1 | <i>General</i> | 6.5 |
| | Beds | 68 |
| 6.4.2 | <i>Shallow Trenches and Low Pressure Effluent Distribution (LPED):</i> | |
| | 6.5.1 Conventional Beds | |
| | 68 | |
| 6.4.3 | <i>Conventional Trenches</i> | 6.5.2 |
| | Evapotranspiration (ETS) Beds | 70 |
| 6.5 | BEDS | 6.6 |
| | Bottomless Intermittent Sand Filters | 72 |
| 6.5.1 | <i>Conventional Beds</i> | 6.7 |
| | Wisconsin Mounds | 73 |
| 6.5.2 | <i>Evapotranspiration Beds (ETS Beds)</i> | 6.7.1 |
| | Wisconsin Mound Model Design | 74 |
| 6.6 | BOTTOMLESS INTERMITTENT SAND FILTERS | 6.8 |
| | Land Application Method and Soil Category | 78 |
| 6.7 | WISCONSIN MOUNDS | 6.9 |
| | Reserve Land Application Area Requirements | 78 |
| 6.7.1 | Wisconsin Mound Model Design | 7. |
| | | MAINTENANCE AND MANAGEMENT |
| | | 81 |
| | SIZING THE SYSTEM TO SUIT YOUR SOIL TYPE | 7.1 |
| | Management Plan | 81 |
| 6.8 | LAND APPLICATION METHOD AND SOIL CATEGORY | 7.2 |
| | Maintenance Contract | 81 |
| 6.9 | RESERVE DISPOSAL AREA REQUIREMENTS | 7.3 |
| | Owner Education | 81 |
| 7. | MAINTENANCE AND MANAGEMENT | 7.4 |
| | Operation, Maintenance and Management | 83 |
| 7.1 | MANAGEMENT PLAN | 7.4.1 |
| | Wastewater Production Facilities | 83 |
| 7.2 | MAINTENANCE CONTRACT | 7.4.1.1 |
| | Wastewater Collection System | 84 |
| 7.3 | OWNER EDUCATION | 7.4.2 |
| | Wastewater System Automatic Monitoring Equipment | 85 |

| | |
|--|--------------|
| 8. ASSESSMENT OF EFFECTS ON THE ENVIRONMENT | 7.4.3 |
| New Systems | 85 |
| 9. REFERENCES | 7.4.4 |
| Alternative Systems | 87 |
| 10. APPENDICES | 7.4.5 |
| Consequences of Inadequate Maintenance | 87 |
| 8. ASSESSMENT OF EFFECTS ON THE ENVIRONMENT | 89 |
| 9. REFERENCES | 89 |

1. INTRODUCTION

1.1 General

The purpose of this manual is to provide direction for on-site wastewater system designers and council officers, and is aimed at increasing the effectiveness of on-site land disposal systems. The guidelines have not been developed as a stand-alone document but are to be used by designers and council officers in ~~the Manawatu-Wanganui~~Horizons' Region, in conjunction with Auckland Regional Council TP58 (2004), Horizons Regional Council's On-Site ~~Wasterwater~~Wastewater System Guidelines for the Manawatu-Wanganui Region (2000) and the Australia/New Zealand Standard: AS/NZSNZS 1547:2000. The concepts and design principles are sourced from these ~~two documents as can specific design details along with detailed explanations.~~

-

Horizons ~~Regional Council~~ appreciates that this manual provides a new ~~direction~~approach for the Region and designers, and that training will be required to achieve the desired long-term results. Training courses will be provided to introduce designers to the new ~~direction~~approach and in the medium to short term, accredited designers who have completed the training will be ~~placed~~listed on ~~the a register of~~ approved ~~designer register~~designers.

1.2 ~~The Manawatu-Wanganui~~Horizons' Region

1.2.1 ~~Our~~The Region

Figure 1.1 shows ~~our~~Horizons' Region ~~stretching, which stretches~~ from Mount Ruapehu on the Volcanic Plateau in the ~~North~~north to the fertile Horowhenua plains in the south; and from the sandy western dunes bordering the Tasman Sea ~~in the west~~ to the rocky Pacific Ocean bays ~~to in~~ the east.


At 22,215 km² ~~(around 2square kilometres (approximately 2.2 million hahectares))~~, it is the second largest local government ~~Region~~region in the North Island and comprises just over 8% of New Zealand's total land area.

The rugged Ruahine Ranges form a natural boundary with the Hawke's Bay, ~~Region~~ and impact on both river systems and regional climate, while the Manawatu River plains both east and west of the divide provide a rich basis for ~~both our the Region's~~ agricultural economy and ~~its~~ settlements.

Regional Council boundaries are based on river catchments and ~~our~~Horizons' Region is connected and defined by three major rivers – the Whanganui, Rangitikei and Manawatu. The Whanganui and Rangitikei ~~rivers~~ both rise on the Volcanic Plateau where they drain land west of the Ruahine Ranges. The Manawatu River begins on the eastern side of the ranges, collecting water from several smaller rivers ~~and then flows before flowing~~ through the

Manawatu Gorge ~~to meander~~ and meandering across the plains ~~and to~~ join the ~~sea~~ Tasman Sea at Foxton Beach on the west coast.

~~Our~~ The Region's many and diverse communities have much in common and share common challenges regarding environmental management.

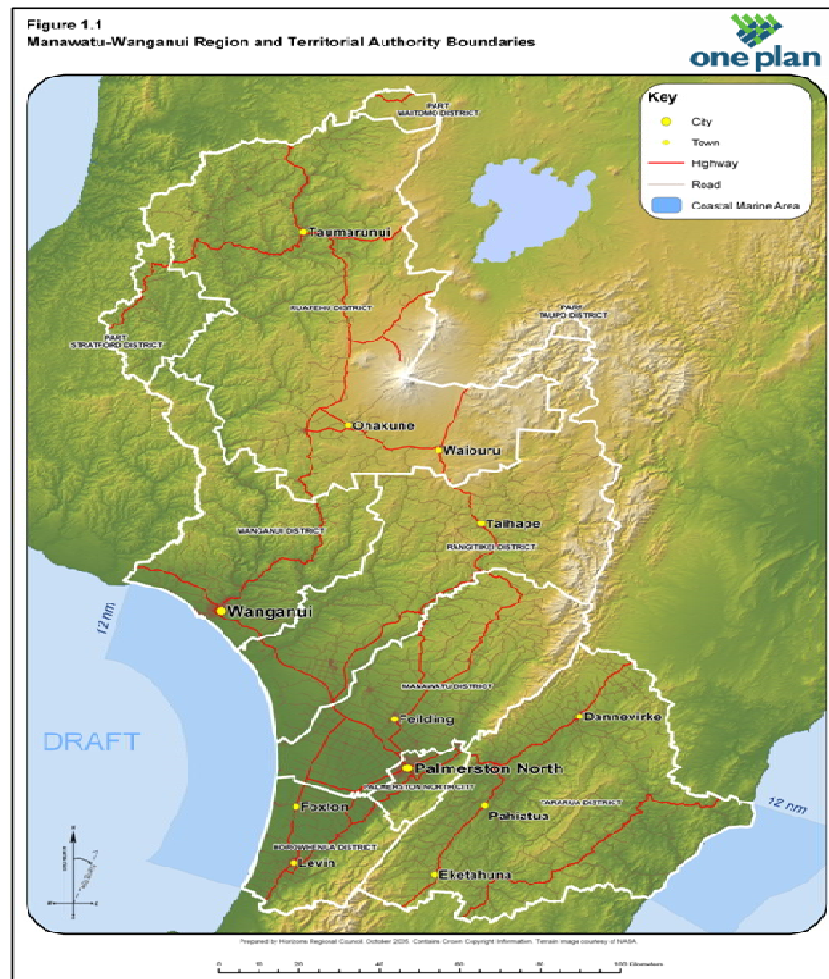

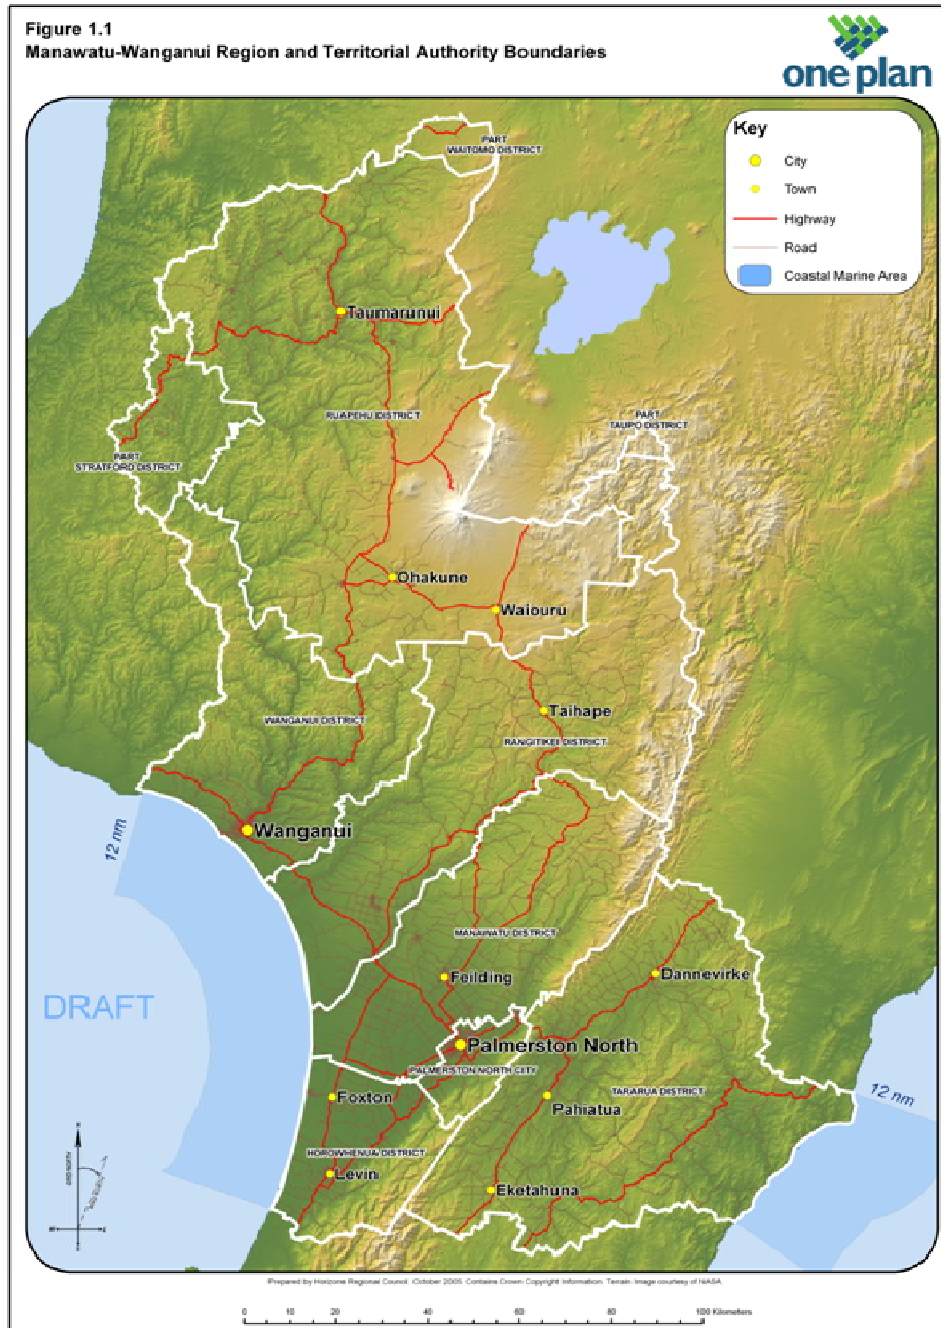


Figure 1.1 Physical Features of ~~the Manawatu-Wanganui~~Horizons' Region

1.2.2 ~~Our~~The Region's People

~~Whether we live on the mountains or the plains we are typically provincial New Zealand and strongly support those values.~~ ~~Our~~The Region is relatively sparsely populated (~~with~~ only 6% of ~~the national~~New Zealand's total population ~~resides here~~), rurally focused, and less income-rich ~~compared to~~ ~~than~~ other regions ~~that are~~ dominated by large cities.

Based on ~~2004~~2006 Census data, ~~overmore than~~ half the ~~Region's~~ resident population of approximately 226,000 live in the cities of Palmerston North and Wanganui. The ~~rest~~remainder live in small, rural communities spread across the Region (refer Figure 2.3).

~~Looking to the future, it~~ is likely that ~~our regional~~the Region's population will remain ~~the same~~static or decline slightly over the next 20 years. Palmerston North, as the largest urban centre, will probably ~~benefit~~grow by attracting young and working age people, but most rural areas will experience declines - ~~some~~ losing up to 20% of their population. ~~All this~~This is ~~likely to occur within a contrast to a projected~~ national population rise of 16% (Statistics New Zealand medium growth population prediction).

1.3 Regional Rules

New Proposed Regional Rules for land disposal of treated effluent have been developed with the objective of improving the quality of effluent discharge and land disposal systems ~~for improved~~. The overall aim is ~~better~~ protection of surface ~~water~~ and groundwater in the Region. The proposed ~~Rules~~rules for land disposal are more stringent ~~than previous rules~~ for small sites, (generally accepted as being up to ~~5,000m²~~2000 m²) where there are risks from cumulative effects of multiple on-site effluent disposal systems. ~~Large~~Proposed requirements for large sites ~~are~~ (defined for this document as being greater than ~~2010~~ hectares, ~~for which proposed requirements~~) are less stringent.

1.3.1 Permitted Activity Rules

~~On-site wastewater systems must comply with permitted activity criteria, or a discharge consent will be required from Horizons regional Council. The key criteria to comply with are for:~~

~~1.3.2 Existing discharges of domestic wastewater~~

~~The discharge of domestic wastewater into or on to land from an on-site wastewater treatment and disposal system lawfully in existence at the time that this rule comes into effect is permitted provided:~~

- ~~(a) The design flow shall be no greater than 2 m³/d.~~
- ~~(b) The flow allowance used to calculate the system design flow shall be no less than 145 litres per person per day where the water supply is provided by roof water collection, or 180 litres per person per day for other sources of water supply.~~
- ~~(c) The discharge shall consist only of contaminants normally associated with domestic sewage and greywater.~~
- ~~(d) There shall be no direct discharge of wastewater to groundwater.~~
- ~~(e) The discharge shall comply with the following separation distances—~~
 - ~~(i) At least 30 m from any bore,~~
 - ~~(ii) At least 20 m from any river, lake, natural wetland or artificial watercourse, or the coastal marine area.~~
- ~~(f) The discharge shall not cause any offensive or objectionable odour to the extent that causes an adverse effect beyond the property boundary.~~

- ~~(g) There shall be no increase in the concentration of pathogenic organisms in any surface water body as a result of the discharge.~~
- ~~(h) The wastewater treatment and disposal system shall be maintained in accordance with the manufacturer's instructions, a schedule of maintenance shall be kept, and this schedule shall be available for inspection by the Regional Council upon request.~~

~~1.3.3 New and upgraded discharges of domestic wastewater~~

~~The discharge of domestic wastewater* into or on to land from an on-site wastewater treatment and disposal system which either—~~

- ~~• Is newly established after this rule becomes operative; or~~
- ~~• Involves the upgrade of a system that existed prior to this rule coming into effect;~~

~~is permitted provided:~~

- ~~(a) The activity shall comply with conditions (a) to (g) of the Rule 13.9 (here under Section 1.3.2 above).~~
- ~~(b) All aspects of the wastewater treatment and disposal system, including design, installation and operation, shall be in accordance with the "Manual for On-site Wastewater Systems—Design and Management" (Horizons Regional Council, 2007).~~
- ~~(c) Where the property within which the discharge occurs is less than 10 ha
 - ~~(i) The property shall cover an area of at least either 5000 m² for properties created by subdivision after this rule comes into effect, or 2500 m² for properties that existed prior to this rule coming into effect,~~
 - ~~(ii) The treatment system shall include secondary treatment which shall achieve, as a minimum, the following discharge quality standards: 20 g/m³ Biochemical Oxygen Demand, 30 g/m³ Suspended Solids, and 30 g/m³ Total Nitrogen.~~
 - ~~(iii) The areal loading rate within the wastewater disposal field shall be no greater than 3mm/d (3 litres per m² per day).~~~~
- ~~(d) The disposal system shall comprise a sub-surface pressure compensating drip irrigation land application disposal system.~~
- ~~(e) There shall be at least a 50% reserve disposal area allocation.~~
- ~~(f) The activity shall not take place in any Rare, Threatened Habitat* or in any At Risk Habitat*, or area with Iwi Spiritual or Cultural value.~~
- ~~(g) There shall be a programmed maintenance contract in accordance with the supplier's specifications or the requirements of the Manual for On-site Wastewater Systems—Design and Management, whichever are the more stringent, and records of each maintenance action shall be retained and made available for inspection by the Regional Council or its agents upon request.~~

~~1.3.4 Discharges of domestic wastewater not complying with Rules 13.9 and 13.10 of the One Plan~~

~~Such discharges will require discharge consent from Horizons Regional Council on a **Restricted Discretionary Activity** basis provided:~~

- ~~(a) The design flow shall not exceed 6 m³/d.~~
- ~~(b) The flow allowance used to calculate the system design flow shall be no less than 145 litres per person per day where the water supply is provided by roof water collection, or 180 litres per person per day for other sources of water supply~~
- ~~(c) The discharge shall consist only of contaminants normally associated with domestic sewage and greywater.~~
- ~~(d) The activity shall not take place in any Rare or Threatened Habitat* or in any At Risk Habitat*.~~
- ~~(e) The activity shall not be to any archaeological site, waahi tapu or koiwi remains as identified in any district plan, in the New Zealand Archaeological Association's Site Recording Scheme, or by the Historic Places Trust except where Historic Places Trust approval has been obtained.~~
- ~~(f) In the event of an archaeological site, waahi tapu, or koiwi remains being discovered or disturbed while undertaking the activity, the activity shall cease and the Regional Council shall be notified as soon as practicable. The activity shall not be recommenced without the approval of the Regional Council.~~

~~Resource consent applications under this rule will not be notified and written approval of affected persons will not be required (notice of applications need not be served on affected persons).~~

~~Council control is reserved over—~~

- ~~(a) The volume of wastewater and design of the treatment system;~~
- ~~(b) Compliance with the "Manual for On-site Wastewater Systems—Design and Management" (Horizons Regional Council, 2006);~~
- ~~(c) The design of the disposal system, the disposal method, and the rate of land application;~~
- ~~(d) The discharge quality, and allowable level of contamination;~~
- ~~(e) Environmental effects arising from the location and method of disposal;~~
- ~~(f) The reserve application area;~~
- ~~(g) Duration of consent;~~
- ~~(h) Review of consent conditions; and~~
- ~~(i) Compliance monitoring.~~

1.3.5 Human effluent storage and treatment facilities

~~Such activities are **permitted** provided:~~

- ~~(a) All effluent storage and treatment facilities (including sumps and ponds) shall be sealed so as to restrict seepage of effluent. The permeability of the sealing layer shall not exceed 1x10⁻⁹ m/s.~~
- ~~(b) Facilities are located and/or managed in a manner ensures at all times that—~~
 - ~~(i) Run-off from the area into surface water is prevented; and~~
 - ~~(ii) Run-off from the surrounding catchment is prevented from entering the area.~~

- ~~(c) The discharge shall not result in any offensive or objectionable odour to the extent that it causes an adverse effect beyond the boundary of the subject property*.~~
- ~~(d) The discharge shall comply with the following separation distances—~~
 - ~~(i) 150 m from residences, marae, schools, public buildings and public recreation areas;~~
 - ~~(ii) For all discharges, 50 m from Rare and Threatened Habitats* and At Risk Habitats*;~~
 - ~~(iii) For all discharges, 30 m from bores;;~~
 - ~~(iv) For all discharges, 20 m from surface water bodies, public roads and the coastal marine area; and~~
 - ~~(v) For all discharges, 50 m from archaeological sites, waahi tapu and koiwi remains identified in a district plan, in the NZ Archaeological Association's Site Recording Scheme, or by the Historic Places Trust except where Historic Places Trust approval has been obtained.~~

~~1.3.6 Discharge of untreated human effluent directly into surface water~~

~~Is a prohibited activity with exceptions being for:~~

~~The discharge of untreated human effluent directly into a surface water body, except—~~

- ~~(a) Within the section of the Whanganui River between NZMS R22: 848380 and NZMS R22: 858392 until 1 July 2009; and~~
- ~~(b) Stormwater that is contaminated with sewage as a result of infiltration during rainfall.~~

~~Note: Rule Guide:~~

~~Discharges in Rare and Threatened Habitats* and At Risk Habitats* are regulated by Rules 12-5 and 12-6 of the One Plan. Discharges at other locations are regulated as follows—~~

- ~~(a) **Activities not covered by rules**—Discharges of sewage that are not covered by the rules above are a **discretionary activity** under Rule 13-26.~~
- ~~(b) **Activities that do not comply**—Discharges of domestic wastewater that do not comply with the permitted, controlled or restricted discretionary activity rules above, but which are not prohibited, are a **discretionary activity** under Rule 13-26.~~

~~On-site wastewater systems must comply with Permitted Activity criteria, or they will require discharge consents from Horizons.~~

~~Policy 13-3 of the Proposed One Plan (POP) sets out the management objectives for discharges of domestic wastewater.~~

~~Proposed Rule 13-10 sets out the conditions/standards for Permitted Activity classification for the discharge of domestic wastewater from systems that existed lawfully when the POP came into effect.~~

~~Rules 13-11 and 13-12 set out the conditions/standards for Permitted Activity classifications for new and upgraded systems. The rule for new systems only becomes applicable after the One Plan, or this section of Plan, becomes operative.~~

Please refer to the proposed rules in the POP document for details of requirements applying to discharges from on-site wastewater systems.

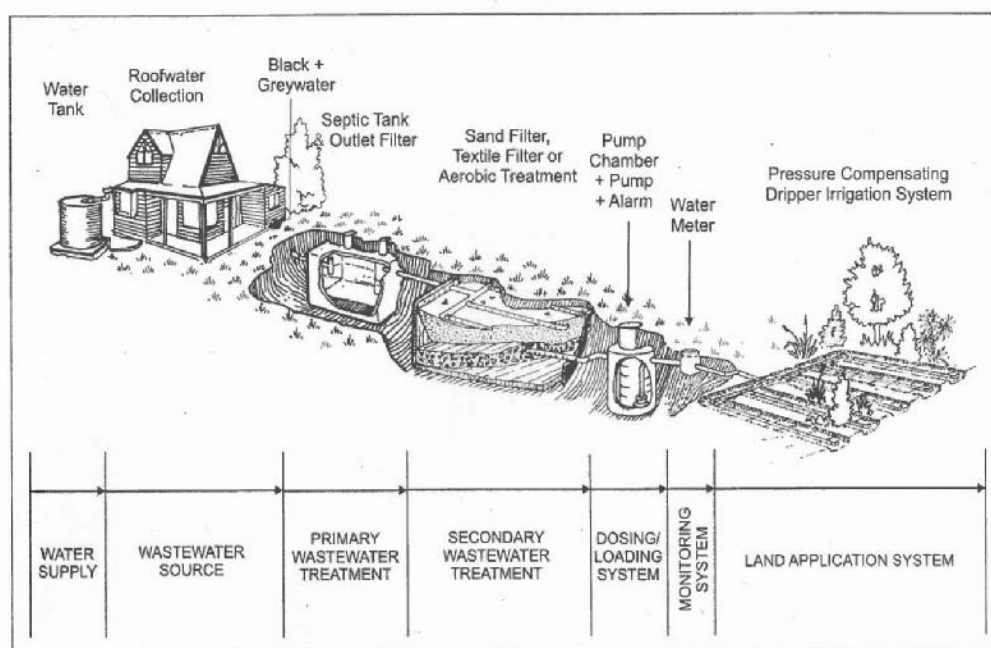


Figure 1.2 Process-flow schematic for on-site wastewater system components. (Source: Auckland Regional Council TP58 2004).

1.4 Cumulative Effects

The risks from cumulative environmental effects need to be considered when there is more than one system per 5,000m² 2000 m² of land area. Cumulative effects result from the intensification and clustering of on-site wastewater disposal systems. The discharge of treated wastewater into the ground from individual on-site or community systems can impact on and adversely affect groundwater quality through insufficient in-ground treatment, surface water quality by run-off and overland flow, soil structure, and public health. The potential for detrimental impacts-effects results from nutrients, organic matter, and micro-organisms contained within the wastewater. Potential cumulative impact-effects decrease with increased effluent treatment, careful site assessment of soil and groundwater conditions, thorough site assessment, and land disposal system design including that includes conservative land disposal rates with on-going regular system maintenance.

A conservative design approach is crucial to mitigate potential detrimental and cumulative effects by designing for a high quality treated effluent and a conservative soil loading rate.

1.5 Decentralised vs On-Site Wastewater Disposal

1.5.1 Decentralised Systems

Decentralised systems ~~are~~ a relatively new concept in New Zealand ~~and represent systems servicing, service~~ two or more dwellings or wastewater sources ~~with. The~~ discharge ~~is~~ to a site ~~that is~~ separate from ~~where~~ the ~~site of generation~~ wastewater is produced. Wastewater may be collected at each site ~~of generation~~ where it is produced, in a septic tank ~~including that includes~~ an effluent outlet filter, ~~and~~ the primary treated wastewater ~~is then~~ discharged via gravity or by pump to a community treatment plant. Alternative collection systems may comprise grinder pumps or vacuum systems for transfer of the wastewater to a central treatment plant. Land disposal of treated effluent occurs in a central area, or areas designated for this purpose and separated from the wastewater sources.

Decentralised wastewater management technology can be applied to new subdivisions or for reticulation of existing communities where individual on-site systems have resulted in ~~adverse~~ cumulative adverse effects.

Long-term operation and management of decentralised systems is critical to the system performance and achievement of the desired environmental outcomes. Options for ownership include:

- i. Council ownership and operation.
- ii. Body corporate ownership and operation.
- iii. Private company ownership, management and operation.

Whichever ~~type of~~ ownership plan is implemented, it is important that the owners take full responsibility for the entire system (~~ie.~~ collection, treatment and disposal). Failure to do so can result in serious deficiencies and system failure. For ~~the~~ Council to be sure that the ownership structure is robust, ~~and~~ that there is certainty of on-going management including operation, maintenance and rectification of problems should they develop, ~~it is important that~~ all ownership bodies ~~should~~ have a significant financial bond that is readily accessible for this purpose. The value of any bond is to be regularly reviewed and increased to reflect the true value of ~~any~~ works ~~in the event they are that may be~~ required. It is also important that responsibility for the system operation, management, and maintenance is clearly designated and achieved.

1.5.2 Individual On-Site Systems

Individual on-site systems are those where ~~by~~ all wastewater produced from a single dwelling is treated and discharged into or onto the ground within the site of production.

1.6 Who Should Use This Design Manual

This manual has been developed to provide designers with clear direction for the investigation and design of on-site wastewater systems and to provide ~~territorial local authorities~~ Territorial Authorities and ~~the Regional Council~~ Horizons with assessment criteria for on-site wastewater treatment, land disposal, and assessment of ~~environmental~~ effects within the ~~Manawatu-~~

~~Wanganui~~ Region. This guideline is not intended as a comprehensive design manual as there are existing design manuals ~~providing that provide~~ this detail ~~and these~~. These include:

- i. Auckland Regional Council Technical Publication 58 (TP58) ~~“On-Site Wastewater Systems Design and Management Manual”~~ (2004).
- ii. Australian/New Zealand Standard ~~“On-site Domestic Wastewater Management”~~, AS/NZSNZS 1547:2000.
- iii. United States Environmental Protection Agency ~~“Onsite Wastewater Treatment Systems Manual”~~ (2002).
- iv. On-Site Wastewater System Guidelines for the Manawatu-Wanganui Region ~~“(November 2000)”~~.

~~It is recommended that designers~~ Designers and assessors should reference ~~the these~~ four documents for comprehensive design guidance.

1.7 Who Should Design On-Site Systems

Only practitioners experienced in on-site wastewater system investigation and design should undertake on-site wastewater system investigation and design. A qualified designer is a person who has completed ~~the Council On~~ Horizons’ on-site Wastewater wastewater training course ~~or/and/or~~ other training course approved training courses by Horizons, and is familiar with these design guidelines.

~~It is important that on~~ On-site wastewater system design ~~comprises should~~ comprise a staged approach to determine the most appropriate effluent treatment and Landland application method in order to minimise environmental impacts from Landland application of wastewater.

Fundamental training is to be provided by Horizons ~~Regional Council~~ in support of these guidelines, to assist designers to advance their investigation and design skills. In addition ~~certified~~, training courses are available for advanced training and reporting requirements. Horizons can provide contact details of course providers.

Horizons ~~Regional Council~~ will ~~be developing~~ develop a list of approved designers from whom system designs will be accepted. Designers must apply to ~~the Council~~ Horizons for inclusion on this list.

1.8 Minimum Reporting Requirements

Clear and concise reporting by the designer is critical ~~for any when making an~~ application to ~~the a~~ Territorial ~~Local~~ Authority or Regional Council ~~when making an application~~ for a new or upgraded on-site wastewater system installation. Any application report should include the following:

- i. A scaled site Planplan showing: property boundaries, ~~the dwelling dwellings~~ and any other structures, driveways, surface water (eg. drains, ~~and streams~~), retaining walls, stands of trees, slope angle and direction, slope breaks, location of all investigation boreholes or test-pits, ~~the~~ location of the proposed wastewater treatment plant,

- location and extent of the land disposal system ~~and also identify, and~~ **identification of** appropriate separation distances.
- ~~ii.~~ A site description.
 - ~~iii.~~ Borehole/test-pit logs including depth to each soil horizon, description of each horizon, soil category for each horizon, and depth to the groundwater table if encountered. A minimum depth of ~~1.0 metres to~~ 2.0 metres is required, depending on the soil type and treated effluent quality.
 - ~~iv.~~ Water supply (eg. roof water collection, reticulated, water bore).
 - ~~v.~~ The number of bedrooms and additional rooms that ~~could be~~ potentially **could be** used as bedrooms.
 - ~~vi.~~ Design occupancy.
 - ~~vii.~~ Any water conservation fixtures proposed (e.g. dual ~~low~~-flush cisterns).
 - ~~viii.~~ Design per capita flow allowance.
 - ~~ix.~~ Total design daily wastewater production.
 - ~~x.~~ The proposed wastewater treatment method and description of the system, including tank capacities, make, supplier and expected treated effluent quality.
 - ~~xi.~~ Proposed **Landland** application method.
 - ~~xii.~~ Proposed wastewater **Landland** application system basal or areal loading rate.
 - ~~xiii.~~ Disposal system area sizing calculation and reserve areas.
 - ~~xiv.~~ Vegetation within the proposed **Landland** application area (existing and/or proposed)
 - ~~xv.~~ Treated ~~Effluent Tank~~**effluent tank** discharge pump head requirements.
 - ~~xvi.~~ ~~Disposal~~**Land application** area fencing.
 - ~~xvii.~~ An assessment of **actual and potential environmental** effects (noting wastewater treatment level, separation distances from surface water, stormwater drains, roadside curb drains, groundwater, and water bores, impacts on surface and groundwater, impacts on soils, soil capacity for reduction of pathogens and nutrients, flood risk), clearance to property boundaries, **and** separation distance from neighbouring on-site land application systems.
 - ~~xviii.~~ Proposed mitigation measures if these are necessary (e.g. stormwater controls, ~~and~~ **and** topsoil bunds).

1.9 Assessment of Environmental Effects **(AEE)**

An assessment of effects on the environment is an essential methodology to enable identification of the risks associated with discharge of treated wastewater into the ground, ~~and~~; depending on the sensitivity of the environment, **this assessment** provides the designer with direction on the level of treatment required and **the** most appropriate land application method. The designer should also consider the cumulative effects of the wastewater discharge, as even highly treated wastewater can have a gradual and increasing impact. Adverse effects increase ~~with increasing as the~~ density of development **increases**, and can be noticeable within groundwater and surface water.

An impact assessment should include the potential for the receiving soils to reduce the ~~effluent~~-organic content, pathogens, and nutrients (nitrates and phosphates) **of the effluent**, along with the potential for impact on groundwater and sensitivity of the receiving environment.

1.10 Successful On-Site System Design

A thorough and effective site assessment is critical to the success of any on-site wastewater system. Effective on-site wastewater system design includes:

- ~~(b)~~i. A comprehensive surface and sub-surface investigation.
- ~~(b)~~ii. Conservative design daily wastewater production assessment.
- ~~(k)~~iii. A conservative wastewater treatment system design ~~achieving that~~ achieves an appropriate level of treated effluent discharge quality.
- ~~(b)~~iv. A conservative land application system loading rate.
- ~~(m)~~v. ~~An appropriate A~~ land application system that is appropriate for the site soils and constraints.
- ~~(n)~~vi. Appropriate mitigation measures for stormwater cut-off/diversion.

2. SITE ASSESSMENT METHODOLOGY

2.1 Introduction

Any on-site wastewater assessment must include a thorough surface and sub-surface assessment to allow determination of the wastewater treatment level required, the environmental constraints and the most appropriate land application method.

The assessment process should generally comprise at least the following steps:

- i. Review of the development plans.
- ii. Assessment of the maximum potential occupancy based on bedrooms and potential bedrooms.
- iii. Assessment of the per capita wastewater production rate and peak daily wastewater production.
- iv. Assessment of the area available for wastewater disposal from the site plans.
- v. A site visit ~~including~~that includes a soil assessment (texture and structure), groundwater assessment, and potential constraints limiting on-site wastewater disposal.
- vi. Delineation of the area available for wastewater disposal on the plan.
- vii. ~~Determine~~Determining the effluent treatment level required on the basis of the site constraints assessment.
- viii. ~~Determine~~Determining the most appropriate land application method.
- ix. ~~Develop~~Developing a site plan detailing the proposal, along with a supporting report.


2.1.1 Site Investigation and Assessment

The site investigation ~~is to~~should comprise a surface and a sub-surface assessment. The following site evaluation flow chart ([Figure 2.1](#)) summarises the evaluation process and critical issues to be addressed. Not all the criteria identified may be required for each site but ~~the flow diagram~~[Figure 2.1](#) and sections 2.1.1.1 and 2.1.1.2 summarise criteria that any thorough site assessment should address.

A surface assessment requires the designer to complete a site visit and develop a site plan ~~identifying~~that identifies critical site features, and delineate the area available for a wastewater land application system.

The site assessment should identify and evaluate both positive and limiting factors relating to surface and sub-surface factors ~~influencing~~that influence on-site wastewater land disposal.

FIGURE 2.1
SITE ASSESSMENT FLOW CHART

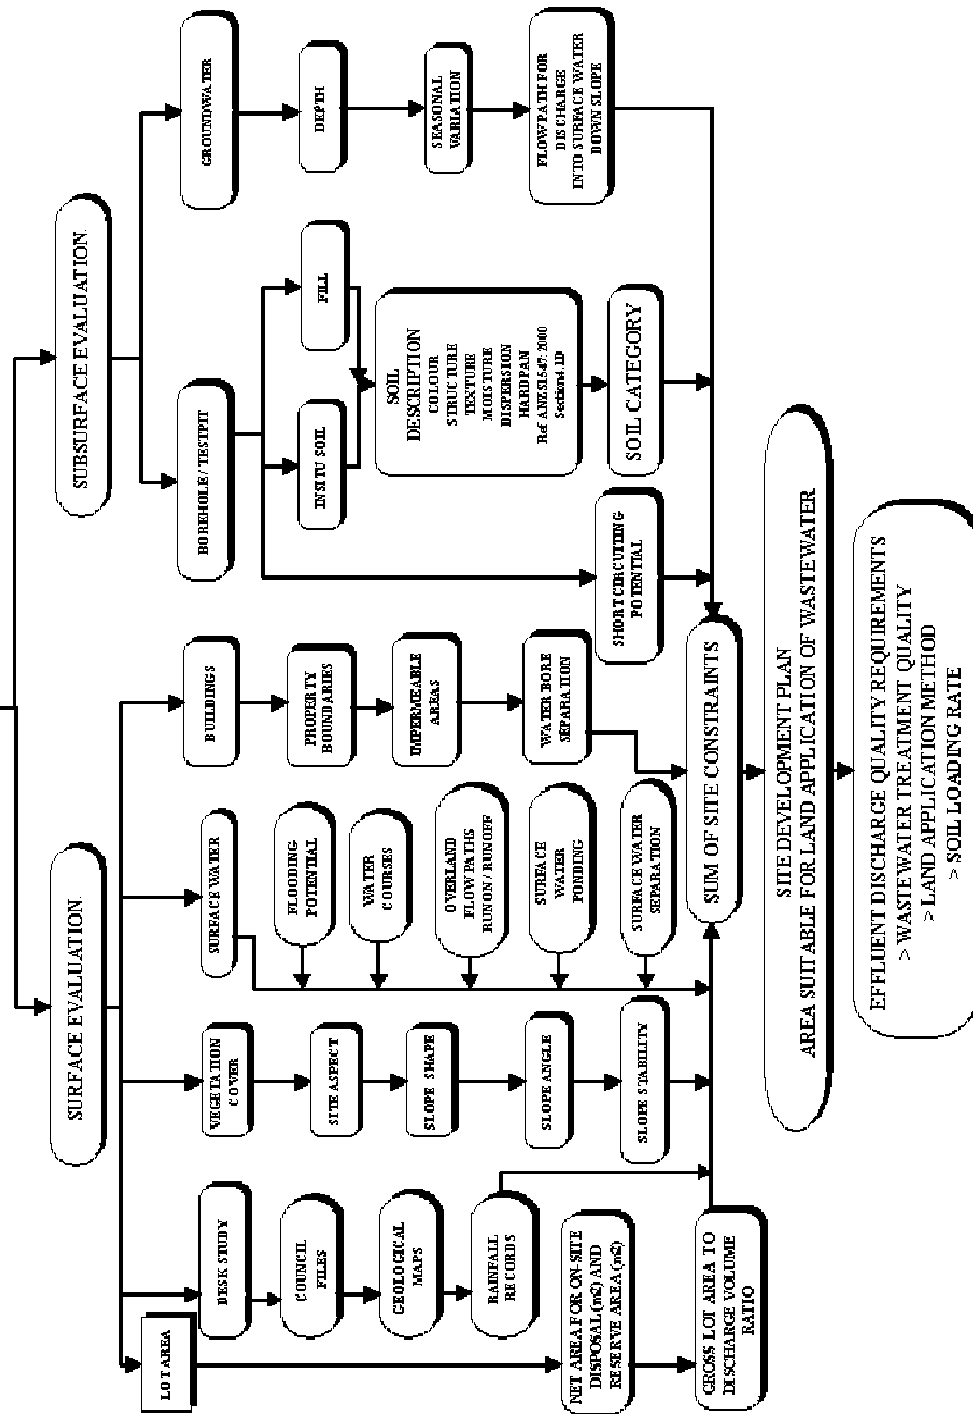

Source: Auckland Regional Council TP58 (2004).

2.1.1.1 Surface Evaluation


The surface criteria that must be considered in designing an on-site wastewater disposal system are explained in the following section:

- net lot area** ← area available for primary and reserve land application areas excluding land area taken up by right of ways, impermeable

- areas, setback requirements from surface water, dwellings, and property boundaries);
- ~~ii.~~ **desk study** (← review of existing site specific information held on council files);
 - ~~iii.~~ **performance of other systems** (← knowledge of the performance of adjacent systems, and the reason for any failures occurring, ~~be it eg.~~ soil type, loading rates or poor construction, or changes in the type of development and increased per capita water consumption, can assist the investigator when designing a new system. If there are any doubts about the likely performance of the proposed land application system ~~performance~~, the best available wastewater treatment and land application technology should be used);
 - ~~iv.~~ **geology** (← review of geological maps for preliminary soils/constraints assessment);
 - ~~v.~~ **rainfall** (← precipitation intensities and duration will influence the choice and siting of disposal systems relative to subsoil saturation effects);
 - ~~vi.~~ **vegetation cover** (← existing natural vegetation, trees, ~~and~~ bush can be retained and incorporated into both land application and buffer areas, or garden and lawn areas can be sub-irrigated);
 - ~~vii.~~ **slope aspect** (← note direction the slope faces in order to maximise evapo-transpiration potential through exposure to sun and wind);
 - ~~viii.~~ **slope shape** (← identify slope shape and location of depressions/zones of potential surface water ponding. Depressions in which water could pond should be avoided);
 - ~~ix.~~ **slope angle** (← past slope limits have been set to accommodate machine excavation of conventional trenches; ~~much~~ steeper slopes than 15°15 degrees can be utilised in good soils ~~either~~ by employing ~~either~~ narrow trenching machines, ~~or~~ by hand digging or pinning dripper irrigation lines to the ground surface, along with appropriate design considerations);
 - ~~x.~~ **slope stability** (← identify any areas of previous or existing slope instability; these areas require specific geotechnical investigation to assess the potential impact of land disposal of wastewater and may be unsuitable for wastewater irrigation);
 - xi. **surface water drainage** (← identify surface water flow paths onto and off the site, including concentrated or broad flow and areas of potential surface water ponding);
 - ~~xii.~~ **flooding potential** (← where there is a risk of flooding, the ~~1% and 20%~~ year flood (5%) levels are to be determined);
 - ~~xiii.~~ **surface water separation** (← identify any surface water such as permanent and ephemeral streams, lakes, ponds and wetlands);
 - ~~xiv.~~ **site clearances** (← identify separation distances from proposed and existing buildings, site boundaries, paved areas and topographical discontinuities, e.g. embankments either supported or unsupported, water bores, paved areas. Table 2.2 provides some recommended minimum separation distances as a guide to determining suitable clearances based on the wastewater treatment quality);
 - ~~xv.~~ **site characteristics** (← note characteristics of surface soil such as soil cracking, evidence for annual soil saturation, seepages, rock exposure etc); and
 - ~~xvi.~~ **water supply source** (← on-site supply via rainwater roof collection or groundwater bore, or reticulated public supply).

2.1.1.2 Sub-surface Evaluation

- i. **Borehole/test-pit** (~~←~~ all site assessments are to include a detailed assessment of the soils underlying that underly the proposed land application area. The assessment shall be by test pit or, where this is impractical, by hand auger borehole. The sub-surface assessment should be to a depth of at least ~~1.0 to 2.0~~ metres, or the minimum recommended groundwater separation distance between the base of the land application system and any groundwater table (see ~~table~~ Table 2.2). ~~Sub-Where practicable, subsurface~~ investigations within sand soils should be continued to the groundwater table upper surface ~~where this is practical. A. The following should be submitted with the site assessment report: a~~ detailed description of soils encountered, depth to the top of each soil horizon, depth to groundwater, and relevant soil ~~structure~~ structural and ~~soil-textural features shall be recorded, and the depth to each horizon and submitted with the site assessment report~~).
- ii. **In-situ soil** (~~←~~ determine if the soils are natural and determine soil suitability for land application of wastewater).
- ~~(g)iii.~~ **Fill** (~~←~~ fill may be unsuitable or poorly suited for land application of wastewater, depending on the composition and level of compaction, ~~in which. If that is the case,~~ the proposed land application area should be relocated, the fill removed, or the land application system specifically designed to accommodate the soil constraints. In the case of filled sloping sites, the designer should take into account the potential for short-circuiting along the fill/natural ground interface).

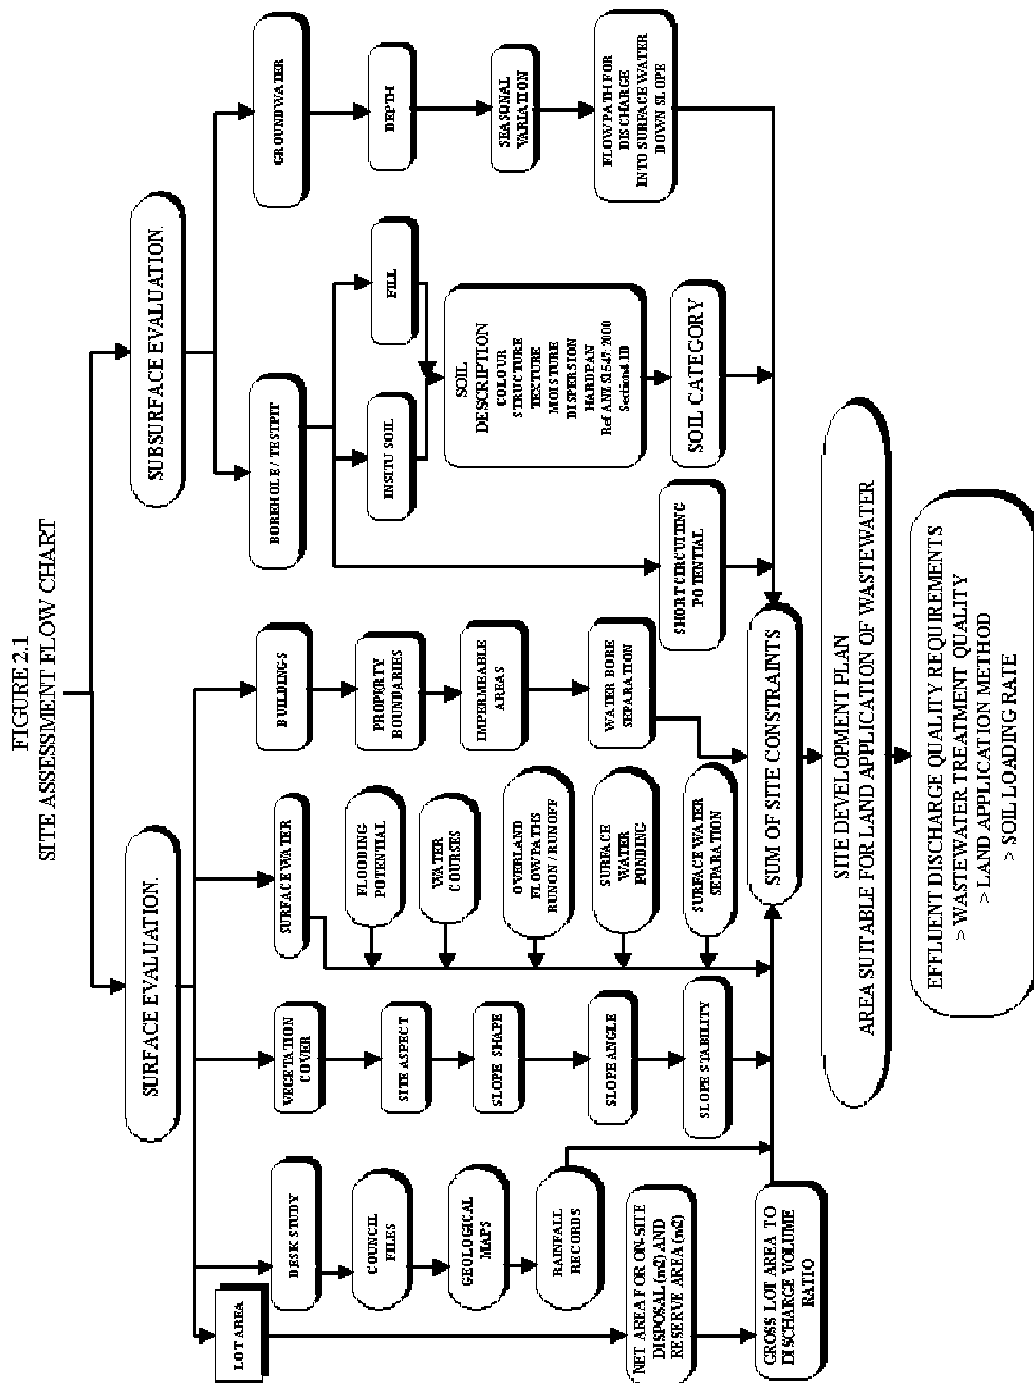

Source: Auckland Regional Council TP58 (2004).

- ~~(h)~~iv. **Soils** (— determine soil texture, clay, silt, sand, gravel, and provide a detailed description of the soil structure. The USEPA On-site Wastewater Treatment Systems Manual 2002 (sections 4.4.5, 5.5.7) and AAS/NZS 1547:2000 (section 4.1D) provide soil description procedures). Investigation test pits allow the most comprehensive assessment of the undisturbed soils but are not always practical to undertake. The texture (grain size, gravel, sand, silt, clay) is determined for each soil horizon ~~and~~, the soil category determined based on texture, and the depth to each horizon carefully measured.
- ~~(i)~~v. **Soil category** (— the soils description methods above, and also in the attached appendix ~~4(2)~~ titled Soil Description, allows ~~determination of the soil category~~ to be determined).
- vi. **Short-circuiting paths** (— assess potential for wastewater to short-circuit through clay or highly permeable soil into surface water or ground water. The soil type, permeability and level of wastewater renovation required within the soil also influence the clearance distance required from the groundwater table and separation from surface water. Extreme care is required in soils that are prone to summer desiccation, in which development of shrinkage cracks can provide short-circuiting paths directly to groundwater or surface water. If necessary, the "clearance" can be artificially increased by using a "mounded" land application system and/or the level of wastewater treatment can be increased to include at least secondary treatment prior to distribution to the system. A mound may be constructed from clean topsoil or other suitable clean soil to provide clearance between the base of the disposal system and the seasonally highest level of groundwater).
- ~~(d)~~vii. **Groundwater depth variation** (— it is important to determine the site's capacity ~~of the site~~ to accept renovated wastewater and to chose an appropriate disposal method which maximises on-site renovation of effluent and minimises groundwater impacts; a "clearance" will be required between the base of the disposal and application area and the critical groundwater level to satisfy one of two situations (refer Table 2.2).):
- a. 1) — Where no public health or environmental constraints exist then the clearance must be adequate to ensure that hydraulic conductivity requirements are met ~~(and and that~~ no adverse groundwater mounding occurs).
 - b. 2) — Where such constraints are present (e.g. due to the use of groundwater for individual or community water supply) then the clearance must be such that, when combined with quality control provided by the treatment and disposal system, the further renovation of effluent during its percolation through the unsaturated soil layer between the land application area and groundwater surface is adequate to meet environmental and public health criteria).
- ~~(e)~~viii. **Groundwater flow** (— groundwater flow direction is important in the more permeable soils ~~f,~~ such as sand and gravel, when in close proximity to lakes, rivers or beaches and groundwater extraction bores. The travel time for applied wastewater to reach the groundwater table, and to travel with groundwater to the zone of emergence or extraction, should be assessed and pathogen die-off predicted to determine if environmental and public health requirements are met).
- ~~(d)~~ix. **Sum of site constraints** (— all aspects determined from the site assessment, both positive and negative, are combined with the site

development plan to determine the location and area available for land application of wastewater.

~~(e)x.~~ **Land application system design parameters** ~~(~~ environmental constraints and soil types are combined to identify the wastewater treatment quality required, ~~–~~ **and** the most appropriate land application method, ~~–~~ **and** ~~to~~ determine the soil loading rate).

~~xi.~~ **Design for Operation and Maintenance** ~~(In~~ ~~–~~ ~~in~~ siting the pre-treatment and land application systems, account must be taken of the need for access for operation and maintenance purposes. Treatment systems ~~which~~ ~~that~~ require desludging via pump-out, must be located to enable ready access for maintenance. Land application systems must be located away from areas of vehicular or pedestrian traffic so their operation is not compromised by activities on the ground surface, such as high use lawn areas).

2.2 Soakage Testing vs Soil Category Assessment

The suitability of a soil for on-site land disposal of treated effluent has traditionally been assessed by ~~soakage~~ ~~percolation~~ testing, as described in the now withdrawn ~~NZS4610;NZS 4610:1982~~. ~~Percolation testing is not considered to be a relevant test method and an~~ ~~has been abandoned.~~ The alternative constant head ~~permeability~~ test described in AS/NZS/NZS 1547:2000 is not ~~provided~~ ~~covered~~ in this manual ~~but is an appropriate test to help determine loading rates for trench and bed land application systems.~~ ~~The constant head permeability test method is not well suited to soil testing for shallow pressure compensating dripper irrigation systems.~~ ~~Alternative test methods such as the Double Ring Infiltrometer (DRI) or disc permeameter provide for more reliable assessment of the surface zone into which treated effluent is applied by shallow systems such as surface or subsurface pressure compensating dripper irrigation.~~ There are inherent risks with ~~percolation~~ ~~permeability~~ testing, particularly where test results are not cross referenced with soil type. Misinterpretation of ~~percolation~~ ~~permeability~~ test results has occurred where short-circuiting via desiccation cracks in clay soils or macropores has been inferred to represent soil permeability, and ~~this has~~ resulted in the use of design loading rates ~~that are~~ unsuited to the soil.

~~Permeability testing should only be used to check a designer's assessment of soil category if there is doubt and is not to be used as the sole criteria for assigning a soil loading rate or soil category.~~

~~These guidelines adopt the use of a soil profile assessment by test pit or hand auger borehole to identify soil texture and structure for determination of a soil category.~~

~~Table 2.1—TP58—Soil—Category—Description—(Comparison provides a description of soils falling within each soil category (1 to 7) and provides a useful comparison with the AS/NZS: 1547:2000) soil categories (1 to 6).~~

~~This manual uses the Auckland Regional Council's TP58 (2004) soil category 1 to 7 descriptions for design purposes.~~

Table 2.1 TP58 and AS/NZS 1547:2000 Soil Category Descriptions

| Soil Category | Soil Description TP58 3 rd Edition | Soil Category | Soil Description AS/NZS 1547:2000. |
|---------------|--|---------------|---|
| 41 | Gravel, coarse sand – rapid draining | 1 | Gravels and sands – rapidly drained |
| 22 | Coarse to medium sand – free draining | 2 | Sandy loams – well drained |
| 33 | Medium-fine and loamy sand – good drainage | 3 | Loams – moderately well drained |
| 44 | Sandy loam, loam and silt loam – moderate drainage | 4 | Clay loams – imperfectly drained |
| 5 | Sandy clay-loam, clay-loam and silty clay-loam – moderate to slow drainage | 5 | Light clays – poorly drained |
| 6 | Sandy clay, non-swelling clay and silty clay – slowly draining | 6 | Medium to heavy clays – very poorly drained |
| 7 | Swelling clay, grey clay, hardpan – poorly or non-draining | | |

Source: Auckland Regional Council TP58 (2004).

~~Percolation testing should only be used to check a designer's assessment of soil category if there is doubt and is not to be used as the sole criteria for assigning a soil loading rate or soil category.~~

~~These guidelines adopt the use of a soil profile assessment by test pit or hand auger borehole to identify soil texture and structure for determination of a soil category.~~

2.3 Separation Distances

The potential impacts from disposal of wastewater into or onto the ground can be minimised by applying setbacks between the land application system and the limiting feature. Guidance for setback requirements is provided in ~~table~~Table 2.2 below.

2.4 Review of Development Plans

Prior to undertaking the site assessment it is critical that the proposed development plans are reviewed by the designer/site assessor to ensure that the proposal is practical.

The review should include:

- (h)j. Determination of the number of bedrooms and potential bedrooms.
- (i)ii. Preliminary daily wastewater production assessment.
- (j)iii. Determination of the area available and the areas unavailable (paved areas, building footprint) for the wastewater disposal and application system (include all setback requirements from boundaries, surface water, buildings – see Table 2.2).
- (k)iv. Preliminary assessment of the area required for wastewater land disposal application system.

Preliminary wastewater disposal and application areas can be identified and investigated at the time of the site inspection.

Table 2.2 Wastewater Quality and Recommended Minimum Separation Distances

| Minimum Recommended Separation Distance | Wastewater Treatment Level | | | | |
|---|--|--------------------|---|--------------------------------------|--|
| | Primary (septic tank plus effluent outlet filter) | Secondary (AWTS) | Advanced Secondary (packed bed reactor) | Tertiary (disinfection) ⁷ | Advanced Tertiary ^{8, 9 and 10} (nutrient reduction and disinfection) |
| Buildings/houses ¹ | 3 m | 1.5 to 3 m | 1.5 to 3 m | 1.5 to 3 m | 1.5 to 3 m |
| Property boundary ² | 1.5 m | 1.5 m | 1.5 m | 1.5 m | 1.5 m |
| Surface water ³ | | | | | |
| Soil Category 1 | Note 4 | 10 20 m | 10 20 m | 10 m | 10 m |
| Soil Category 2 - 3 | 20 m | 10 20 m | 10 20 m | 5 – 10 m | 5 m |
| Soil Category 4 – 6 | 20 m | 15 20 m | 15 20 m | 5 – 10 m | 5 m |
| Soil Category 7 | Note 4 | 15 20 m | 15 20 m | 5 – 10m | 5 m |
| Groundwater ^{4 and 5} | | | | | |
| Soil Category 1 | Note 4 | 1500 mm | 1200 mm | 1000 mm | 900 mm |
| Soil Category 2 - 3 | 1500 mm | 1200 mm | 900 mm | 600 mm | 600 mm |
| Soil Category 4 – 6 | 1200 mm | 900 mm | 600 mm | 600 mm | 600 mm ⁷ |
| Soil Category 7 | Note 4 | 600mm | 600 mm | 600 mm | 600mm |
| Water supply bore ⁶ | | | | | |
| Soil Category 1 | Note 4 | 20 m | 20 m | 10 m | 10 m |
| Soil Category 2- 3 | 20 m | 20 m | 20 m | 10 m | 10 m |
| Soil Category 4 - 6 | 20 m | 20 m | 20 m | 10 m | 10 m |
| Soil Category - 7 | Note 4 | 20 m | 20 m | 10 m | 10 m |
| Floodplain | One in 100 year | One in 20 year | One in 20 year | One in 20 year | One in 20 year |
| Embankments⁷ (Retaining walls, cut batter slopes) | 3 metres from the drainage material/excavated batter face crest or 45 ^o angle from the toe of the wall excavation (which-ever is greater) | | | | |

NOTES

1. Separation distances from houses of less than 3 m ~~is-are~~ only appropriate where drip irrigation land application areas are being used with low design irrigation rates, or where shallow sub-surface systems are being used with equivalent low areal loading rates. Requires consent from ~~territorial authority~~ Territorial Authority.
2. Separation distances from boundaries of as low as 0.5 m may be allowed by some ~~territorial authorities~~ Territorial Authorities where drip irrigation land disposal with low design irrigation rates (3 ~~mm~~ mm ~~5 mm/day~~), or where shallow sub-surface systems are being used with equivalent low areal loading rates, and slopes descend to and not away from the land application area.
3. Separation distances from surface water area ~~is~~ defined as the ~~distance between the~~ areal edge of the land application system (design area plus surrounding absorption buffer) to the edge of the waterway (pond, lake, swamp, stream, river, defined stormwater channel). The above only applies to sub-surface land disposal. An increased separation distance allowance will be required on sloping sites and where surface disposal is proposed.
4. For discharge of effluent into category 1 and 7 soils, specific design considerations are required. Where groundwater quality protection is required in Category 1 soils (gravels) the level of in-ground treatment will be limited unless measures are taken to slow the soakage rate. Discharge of primary treated wastewater into category 7 soils is not appropriate.
5. Groundwater or groundwater cut-off trench clearance distance is defined as the vertical distance from the base of the land disposal system to the highest ~~seasonal~~ permanent water table level. To minimise the potential for ~~an~~ adverse ~~impact~~ effects on groundwater quality, clearance distances should be maintained at all times. Where insufficient groundwater clearance is available, the ground level can be raised by importing topsoil or similar, as well as improved wastewater treatment.
6. Separation distances from water supply bores should be reviewed on a case-by-case basis; distances can be dependent ~~upon~~ the soil type, depth of the bore, its casing depth and quality, water usage, the direction of groundwater flow, ~~and~~ presence or absence of down-stream users, in addition to the quality of the wastewater being discharged.
7. When determining minimum distances from embankments or cut slopes, the type of disposal system must also be taken into account. Such clearances may need to be increased in areas where slope stability is of concern.
8. Groundwater separation distances may be reduced on a case-by-case basis as part of a discharge consent disposal.
9. Disinfection refers to the reduction in ~~the number of~~ faecal ~~coliforms~~ coliform units (fcu) per 100 mls of wastewater and is likely to vary depending on site constraints. A maximum number of ~~200FCU/200fcu/~~ 100 mls is accepted here as the minimum level of reduction.
10. The nutrient type and level of reduction ~~is dependent upon~~ depends on the site constraint and risk level.

Source: Auckland Regional Council TP58 (2004).

2.5 Reserve Wastewater ~~Disposal~~ Land Application Area

A reserve wastewater ~~disposal~~ land application area is required for all on-site wastewater ~~disposal~~ systems. The reserve area is only installed ~~in the event that if~~ problems are experienced with the primary land application area. There is some debate about the necessity for a reserve area when a ~~treatment system with~~ secondary discharge quality or better ~~treatment system~~ is installed and treated effluent is discharged into the ground by pressure compensating dripper irrigation.

Horizons ~~Regional Council is of the opinion~~ believes that the benefit of having a reserve area outweighs the risks of not having a reserve area. The primary

reason for requiring a reserve area is that ~~in the event if~~ wastewater production exceeds the design discharge volume, or the disposal system does not perform as expected, then additional land is available for expansion of the primary ~~disposal~~ land application area.

All on-site and decentralised wastewater disposal systems are to include a reserve ~~disposal~~ land application area. Minimum reserve area requirements are provided in Table 2.3 below.

Table 2.3 Reserve ~~Disposal~~ Land Application Area Requirements

| Land application <u>Application</u> Method | Minimum Reserve Area Required |
|---|-------------------------------|
| Sub-surface Pressure Compensating Dripper Irrigation <u>Subsurface pressure compensating dripper irrigation</u> | 50% |
| Surface Pressure Compensating Dripper Irrigation <u>Surface pressure compensating dripper irrigation</u> | 50% |
| Conventional Trenches <u>trenches</u> | 100% |
| Deep Trenches <u>trenches</u> | 100% |
| ETS beds | 100% |
| Conventional Beds <u>beds</u> | 100% |
| Bottomless Sand Filters <u>sand filters</u> | 100% |
| Notes:- 1. Reduced reserve disposal <u>land application</u> area requirements may be considered where there is reduced potential for environmental risk. 2. Additional reserve area may be required where there is doubt concerning effluent production or proposed disposal <u>land application</u> area loading rates. | |

3. WASTEWATER PRODUCTION

3.1 Introduction

The wastewater production assessment is to take into account the occupancy and the per capita flow allowance. Occupancy ~~is dependent up~~depends on the type of facility, but for a dwelling is typically based on the number of bedrooms. ~~The~~Per capita water consumption is influenced by the water supply (roof water collection vs unrestricted water bore or reticulated supply) and the type of water conservation measures installed ~~influence per capita water consumption. It~~. The designer is recommended ~~that~~to adopt a conservative design approach ~~is adopted by the designer in order~~ to provide a factor of safety in the system design.

The design wastewater production is determined by multiplying the maximum occupancy by the per capita flow allowance appropriate to the facility being serviced.

3.2 Occupancy Assessment

~~The following~~ Table 3.1, which follows, provides design occupancy for dwellings and some commercial facilities.

3.3 Wastewater Production Assessment

~~The following~~ Table 3.2 provides typical per capita flow allowances for a range of facilities with either roof water collection and storage or reticulated ~~/bore~~ water supply. A higher allowance is generally provided for facilities having permanent water supply to reflect the reduced level of self-monitored water conservation practised by occupants.

Table 3.1 Occupancy Allowances

| Facility | Occupancy For Design Purposes |
|--|----------------------------------|
| Dwellings (Notes 1, 2 and 3) | |
| Number of Bedrooms | |
| 1 | 2 |
| 2 | 4 |
| 3 | 5 |
| 4 | 6 |
| 5 | 8 |
| 6 | 9 |
| Hotels and Motels | |
| Guests | Maximum Occupancy/number of beds |
| Staff | Maximum number of staff. |
| Hospitals (Note 4) | |
| Patients | 1 per bed |
| Staff | Maximum number of staff |
| Retirement Village Units (Note 4) | |
| 1 bedroom | 1.3 per unit ⁵ |
| 2 bedroom | 2.0 to 2.5 per unit |
| 3 bedroom | 4 per unit |
| Staff | maximum number |
| Notes: | |
| <ol style="list-style-type: none"> 1. It is usual to adopt a minimum occupancy of 4 persons (equivalent to a 2 bedroom dwelling) for rural-residential development. 2. In situations where large dwellings are proposed which have additional rooms beyond those allocated as dining, lounge, bedrooms, (e.g. "family", "recreation", "games", "office", "study", "sewing", "work" rooms) and which have potential to be utilised as bedrooms, an additional occupancy allowance can be made on the basis of 1 extra person times the ratio of the total floor area of the additional room(s) to that of the smallest designated bedroom and rounded up to the next whole number. 3. Design occupancy should allow for a seasonal peak, not just the daily average daily flow. Holiday homes tend to have intermittent occupancy but when occupied are likely to have a higher occupancy than a continuously occupied dwelling. An allowance in design occupancy should be made for higher seasonal flows. 3. Design occupancy should allow for a seasonal peak, not just the daily average. Holiday homes tend to have intermittent occupancy but when occupied are likely to have a higher occupancy than a continuously occupied dwelling. An allowance in design occupancy should be made for the seasonally higher flows. 4. Design occupancy data from the literature and observed levels. Allow for higher water use/person in providing community care unless specific water meter data is available. | |

Source: Auckland Regional Council TP58 (2004).

Table 3.2 Domestic Wastewater Flow Allowances

| SOURCE | Typical Wastewater Flow Allowance (Litres/Person/Day) [Note 1 and Note 2] | |
|---|--|--|
| | On-site Roof Water Tank Supply | Reticulated Community or Bore Water Supply |
| A. Up-market/Luxury householdsHouseholds with Extra Wastewater Producing Fixtures including fixtures such as garbage grinders; dishwashers, modern shower or bath facilities or other comparable fixtures [Note 3] | 220 | 220 |
| B. Households with Standard Fixtures including 11 litre flush water cisterns; automatic washing machine and dishwasher and NO garbage grinder [Note 4] | 180 – 200 | 200 |
| C. Households with 11/5.5 or 6/3 Flush Toilet(s) and Standard Fixtures, Automaticautomatic washing machine, low water use dishwasher and NO garbage grinder [Note 5] | 160 | 180 |
| D. Households with 6/3 Flush Toilet(s) And Standard Water Reduction Fixtures and NO garbage grinder [Note 6] | 145 | 165 |
| E. Households with Full Water Reduction Fixtures on all water outlets , NO bath and NO garbage grinder [Note 7] | 120 | 145 |
| F. Decreased Flow Allowances for Households with Full Water Reduction Facilities as above (Including, including 6/3 dual flush toilet systems, standard water reduction fixtures and NO BATH)bath [Note 8] | 100 to <115 | 135 |
| G. Households with Full Water Reduction Facilities Plus Water Recycle for toilet cistern flushing [Note 9] | 95 to 100 | 100 to 115 |
| H. Households – Black-water Only (Based on an 11 litre flush toilet) [Note 10] | | 66 |
| I. Households – Black-water Only (Based on a 11/5.5 flush toilet) | | 45 |
| J. Households – Black-water Only (Based on a 6/3 flush toilet) | | 25 |
| K. Households – Grey-water Only (with Extra Water Reduction Fixtures) [Note 11] | 95 to 100 | 100 to 115 |

| Commercial Flow Allowances for Standard Fixtures <i>(Care is required applying water use reduction to commercial situations)</i> | | |
|---|----------|----------|
| Motels/Hotels [Note 12 and 13] | | |
| - Guests, resident staff | | 220 |
| - Reception rooms | | 30 |
| - Bar trade (per customer) | | 15 to 20 |
| - Restaurant (per diner) | | 30 |
| Restaurant/Bar/Cafe [Note 13] | | |
| - Per dinner patron | | 30 |
| - Per lunch patron | | 25 |
| - Per bar patron | | 15 to 20 |
| Lunch Bar (per customer) | | |
| - Without restroom facilities | 10 | 15 |
| - With restroom facilities | 15 | 25 |
| Community Halls | | |
| - Banqueting | 20 | 30 |
| - Meetings | 10 | 15 |
| Marae [Note 14] | | |
| - Day only visitors | | 40 |
| - Day plus overnight visitors | | 150 |
| Schools (pupils plus staff) [Note 15] | 12 to 15 | 15 to 20 |
| Public Toilets (including hand wash) [Note 16] | 10 – 20 | 10 – 20 |
| Camping Grounds [Note 17] | | |
| - Fully serviced | 100 | 130 |
| - Recreation areas | 50 | 65 |
| Rest Homes/Hospitals [Note 18] | 220 | 250 |
| Retirement Home | | |
| - Per Resident resident [Note 18] | 200 | 220 |
| - Per Day Staff Per day staff | 40 | 50 |
| Day Staff | | |
| - High Water Usage e.g. High water usage, eg. some factories [Note 19] | | 60 |
| - For ALL Standard Facilities standard facilities (above) | | 40 |
| - Facilities with Full Water Reduction Fixturesfull water reduction fixtures [Note 20] | | 20-30 |

Notes:

1. These flows are recommended **minimums** for design purposes (unless actual comprehensive water usage/flow records, along with actual occupancy numbers, are available). In some instances ranges of design flow rates are provided to reflect the inherent uncertainty associated with actual per capita wastewater production.
2. Where a site is reliant on water supply being supplemented by water tanker, the design flow allowances based on reticulated water supply must be applied.
3. Extra Wastewater ~~producing fixtures~~Producing Fixtures include fixtures such as garbage grinders, dishwashers, modern shower or bath facilities, or other comparable fixtures.
4. These include 11 litre flush water cisterns, automatic washing machine and dishwasher. No garbage grinder unless other water saving measures such as low flush 6/3 litre toilet cisterns.
5. Standard Fixtures include dual flush 11/5.5 or 6/3 litre toilet cisterns, and ~~includes include~~ standard automatic washing machine, but a low water use dishwasher, ~~and~~ no garbage grinder.
6. Standard Water Reduction Fixtures include dual flush 6/3 litre toilet cisterns, aerator faucets, shower flow restrictors, water-conserving automatic washing machines and dishwasher, ~~and~~ no garbage grinder.
7. Full Water Reduction Fixtures include the combined use of the dual flush 6/3 litre toilet cisterns, shower flow restrictors, low pressure aerator faucets (taps), front load/low water consumption water conserving automatic washing machines and ~~LOW~~low water use dishwasher, ~~NO~~no garbage grinder, ~~NO~~no bath ~~AND~~and includes fixed orifice flow control (FOFC) devices in ~~ALL~~all water use outlets or flow restriction valves to achieve the following flow rates: ~~Laundry~~laundry faucets: 10 L/min, ~~Kitchen~~, kitchen faucets: 9 L/min, ~~Bathroom~~, bathroom faucets: 6 L/min, ~~Shower~~, shower rose: 9 L/min. A water meter is required for any design flow based on low water

- allowances, assuming full water reduction fixtures are in place, to ensure flows can be monitored to verify fixtures are maintained in place.
8. Design flows for Households with Full Water Reduction Facilities and no ~~Bath~~bath, if a design flow of less than 115 litres per person per day (for roof water supply) and less than 140 litres per person per day (for reticulated water supply) is used.
 9. Fixtures as for Notes 7 plus on-site recycle to toilet cisterns for flushing. The flow allowance reflects the removal of toilet flush water from the land application system. The wastewater treatment system must be sized to treat the pre-water conservation flow volume ~~(~~to account for the same or higher Biochemical Oxygen Demand (BOD) load.
 10. Flow rates to be applied where only the blackwater from toilets is to be treated and discharged to land disposal.
 11. Flow rates to be applied where only the greywater is to be treated and discharged to land disposal. The lower design flow is only to be applied where there is no bath. Applicable where solids from kitchen and toilet waste flows are excluded from the wastewater stream. For households with low water use facilities in accordance with Category C and Note 5, the lower end of the range applies; for standard household domestic facilities, the higher range applies.
 12. Evidence does not support lower water usage by staff or guests of commercial premises, so no differentiation is made to the flow allowances according to the water supply source. Some reduction (up to 25%) may apply to the per guest water usage allowance if laundry is undertaken off-site.
 13. For bar patrons, it is assumed that there is minimal if any food served, other than odd bar snacks. Where meals are served, meal water usage allocations apply per patron. In bar facilities, where full water reduction fixtures are installed on all water usage outlets and patrons are only present for short periods, a water usage allowance of 10 litres per person may be appropriate.
 14. Assumes that lunches and lunch/dinners will be served, and that overnight visitors have access to showers but not to laundry facilities. Water meter readings should be installed to provide added certainty to the accuracy in the design flow allowance. Unless specific metered water consumption information is available, conservative flow allowances should be applied.
 15. Based upon experience in the Auckland area, these values for schools are conservative. Recorded flows appear to be up to 15 litres/person/day on rainwater tank supply, and 15 to 20 litres/person/day on community or ~~bore~~bore water supply. For design purposes, figures from the lower end of the range should be supported by actual water usage records, otherwise the higher figure should be used. Additional allowances ~~also~~ need to be made in the design flows for schools that ~~also~~ have cafeterias ~~(with on-site catering)~~ and/or gyms with shower facilities.
 16. For low water use toilets with 6/3 litre flush cisterns, ie. standard public facilities, the lower end of the range applies; for modern upmarket toilet facilities, the higher range applies.
 17. Recreation areas with no showers or communal cooking facilities.
 18. Flow allowances for individual dwellings within a retirement village may be based on the recommended flow allowances for households or alternatively on flow meter rates where these are available. Where extra care facilities are provided, the actual per capita rates will be higher than standard tabulated rates provided, and a conservative design allowance should be applied.
 19. Increased water usage allowances are appropriate where staff activities are likely to involve regular cleaning of themselves and/or the facilities, e.g. rural food preparation factory. Where staff are likely to use showers, the designer should consider all the activities ~~the activities~~ being undertaken by staff, and rates higher than 60 litres per person per day may apply.
 20. Lower water usage allocations apply where staff water usage is likely to be minimal due to short hours and full water reduction fixtures (ie. equivalent to the allocation for a café customer). The provision of flow reduction fixtures may not result in significant water usage reduction for staff due to equivalent cleaning needs, irrespective of the water fixture devices.

Source: Auckland Regional Council TP58 (2004) with minor modifications.

3.3.1 Daily Wastewater Production Assessment Worked Example

| DAILY WASTEWATER PRODUCTION CALCULATION EXAMPLE | |
|---|----------------------------------|
| Water Supply supply | Roof water collection |
| Number of Bedrooms bedrooms | 4 Bedrooms 4 bedrooms |
| Occupancy Assessment assessment | 6 people (from Table 3.1) |
| Per Capita Flow Allowance Per capita flow allowance | 160 litre/person/day (Table 3.2) |
| Source C (roof water collection) | |

| | |
|---|---------------------------|
| Maximum Occupancy <u>occupancy</u> x per capita flow allowance | 6p x 160 l/p/d |
| Design Daily Wastewater Flow <u>Design daily wastewater flow</u> | 960 litres per day |

4. WASTEWATER TREATMENT

4.1 Introduction

Wastewater is defined as water arising from domestic activities in dwellings, institutions, or commercial facilities ~~consisting. It consists~~ of all-waste, ~~grey water, greywater~~ or black-water. Wastewater is defined as *foul water* in the New Zealand Building Code (Source: AS/~~NZSNZS~~ 1547:2000).

Effluent is defined as the liquid discharge from a processing step. The constituents found in wastewater can be classified as physical, chemical, and biological. The constituents ~~in wastewater that are~~ of most concern ~~in wastewater~~ are: suspended solids, biodegradable organics, pathogenic organisms and inorganic characteristics including nutrients (~~nitrogen Nitrogen~~ and ~~phosphorus~~), ~~(source Phosphorus)~~. (Source: *Small and Decentralised Wastewater Management Systems / Crites and Tchobanoglous, 1998*).

Wastewater treatment refers to the technologies used to retain and treat the components making up the wastewater stream prior to discharge to the land application system. The land application system will also provide additional in-ground treatment of the treated effluent prior to it reaching and merging with groundwater.

For the purposes of this document, the effluent treatment levels are defined as:

Primary Treatment _____

The separation of suspended materials by settlement and/or floatation in septic tanks prior to discharge to a land application system or a secondary treatment process.

Secondary Treatment _____

Aerobic biological treatment system including settling and/or filtering of effluent. Secondary treatment quality is expected to be equal to or better than 20 g/m³ ~~5-five-day biochemical oxygen demand and~~ Biochemical Oxygen Demand (BOD), 30 g/m³ suspended solids ~~30 g/m³ total nitrogen~~.

Advanced Secondary Treatment _____

Aerobic biological treatment process including settling and/or filtering of effluent. Advanced secondary treated effluent is expected to be equal to or better than 15 g/m³ ~~5-five-day biochemical oxygen demand and~~ BOD, 15 g/m³ suspended solids and 20 g/m³ total ~~nitrogen~~ Nitrogen.

The available wastewater treatment methods that treat wastewater residuals to range of treatment levels include:

Primary Treatment _____

Septic ~~Tank~~ tank without an effluent outlet filter.

Improved Primary Treatment

Septic ~~Tank~~ tank with effluent outlet filter.

Secondary Treatment ~~— Aerobic Treatment Plants~~
Aerated wastewater treatment systems.

Advanced Secondary Treatment ~~_____~~
Septic ~~Tank~~ tank/textile filter (recirculating textile filters).
Septic ~~Tank~~ tank/sand filter (intermittent or recirculating sand filters).
Membrane ~~Bioreactor~~ bioreactor units.

Tertiary Treatment ~~_____~~
Disinfection (~~Chlorination, Ultra-Violet~~ chlorination, ultra violet or ~~Ozone~~ ozone)
for reduction of disease-causing micro organisms.
Nutrient reduction with or without disinfection.

Other wastewater treatment technologies are available but these are outside the scope of this document.

The operation of the above wastewater treatment systems is reliant on a conservative design (including wastewater flow production assessment) and ongoing maintenance.

Typical raw and treated wastewater quality parameters are tabled in TP58 (2004) (~~table~~ Table 7.1 page 63), reproduced here as Table 4.1.

The choice of the wastewater treatment system, and therefore treated wastewater quality requirements, will be based on the Regional Rules for on-site effluent disposal and the results of the site assessment and assessment of environmental effects.

4.1.1 Water Tightness

All pipes, tanks, risers and all connections, including those into and out of the tank, must be watertight to prevent ground and surface water infiltration into the system. Infiltration can have a significant detrimental impact on the treatment process and the land application system, and has the potential to ~~lead to~~ cause catastrophic system failure.

4.2 Primary Treatment

Primary treatment is typically provided by a septic tank ~~which~~ that is sized to retain solids by settlement and scum (eg. fats, oils and grease) by floatation and to provide a minimum ~~retention time of~~ 24 hours settling volume based on the tank volume being 50% ~~to~~ 65% occupied by scum and solids. A clear zone that is relatively low in solids is created between the two layers, from which the primary treated wastewater is discharged. Septic tank performance is significantly improved by including an effluent outlet solids control device on the septic tank outlet. These devices minimise solids carryover to the secondary stage or land application system and are ~~mandatory in the Horizons Regional Plan~~ required for new on-site systems within Horizons' Region unless the equivalent or better level of treatment is provided in a secondary or advanced secondary treatment system.

TP58 (2004) terms septic tanks including an outlet solids control device as "Conventional Septic Tanks" and recommends a minimum septic tank

capacity of 4,500 litres. The larger the capacity of the septic tank, the longer the retention time ~~resulting in~~; this provides for improved settlement and floatation performance ~~and plus additional~~ storage capacity for solids and scum.

4.2.1 Individual Dwelling Septic Tank Capacities

There is a range of ~~recommended~~ septic tank capacities recommended ~~in the literature~~ for individual houses in the literature.

Septic tank capacity is determined from the daily wastewater production volume. Typically, the minimum septic tank retention time recommended is 24 hours. However, as the volume of solids and scum increases, the clear zone and retention time are reduced ~~increasing and this increases~~ the risk of solids carry-over.

~~Table 4.1 Typical domestic effluent quality ranges on-site treatment options~~

| Treatment Unit | Typical Concentration g/m ³ | | | | | | FC |
|--|--|----------------|-----------------|----------------------|---------------------------|-----------------|--|
| | BOD ₂ | TSS | NH ₃ | NO ₃ | TN (Note 8) | PO ₄ | CFU per 100 ml |
| • Raw Wastewater — (Mixed value) | 250 to 350 | 100 to 400 | varies | <1 | Varies | 10–30 | 10 ⁶ to 10 ¹⁰ |
| • Raw Greywater | 180 to 240 | 130 to 160 | | | | | |
| Traditional Septic Tank | | | | | | | |
| • Septic Tank — (poor operation) | 170 to 250 | 80 to 110 | 40 to 60 | <1 | | 10–20 | 10 ⁶ to 10 ¹⁰ |
| • Septic Tank — (good operation) | 120 to 150 | 50 to 70 | 20 to 30 | <1 | 40–100 Typical | 7 to 20 | 10 ⁵ |
| • Greywater Tank — (average operation) | 50 to 80 | 30 to 50 | | | | | |
| • Digestive Tank — (average operation) | 60 to 100 | 40 to 60 | | | | | |
| • Two stage septic Tanks (in series) | 70 to 120 | 40 to 60 | | | | | |
| Septic Tank | | | | | | | |
| • Septic Tank with Outlet Filter | 70 to 120 | 30 (Note 3) | | | 40–100 | | |
| • S T plus [note 4] Intermittent Sand Filter | <10 | <10 | | 20–25 | 25–40 | 7 | 4 x 10 ² to 10 ³ (Note 9) |
| • S T plus Recirculating Sand Filter | <10 | 2 to 6 | 2 to 4 | 30 (ave) [note 6] | 15–40 (note 7) | <1 to 10 | 10 ² to 10 ⁴ |
| • S T plus Recirculating Textile Filter | <15 | 15 | 0–5 | 30 (ave) [note 6] | 30–60 (note 7) | 5 to 15 | 10 ³ to 10 ⁴ 99% reduction |
| • Recirculating Sand filter with N reduction | | | | | 75% reduction (note 7) | | |
| • AS-ATP [note 5] AS-ATP Plus Sand Filter | 20 to 50 | 20 to 100 | <1 | 35 | 25–60 (Note 7) | 4–10 | 3 x 10 ³ |
| • Tertiary Disinfection | | | | | | | [note 10] |

NOTES:

1. The typical concentrations are to be used only as a guide as the concentrations of constituents in wastewater are highly variable.
2. Data based on indicative values from the literature (and in some cases on estimates) and NOT on recorded New Zealand information.
3. Total suspended solids level following an effluent outlet filter is dependent upon the type of filter and hydraulic flow. Some literature indicates TSS following some filter types may be significantly higher e.g. up to 70 g/m³.
4. ST refers to Septic Tank.
5. AS-ATP refers to activated sludge aerobic wastewater treatment plant.
6. The effluent quality obtained from the more sophisticated treatment system is reliant upon the system design, loading rate and being correctly operated and maintained.
7. Treated wastewater output quality can vary significantly from the above typical values and is dependent upon the influent concentrations
8. Lower nitrate concentration can be achieved by following an additional nitrate reduction cycle.
9. The percent reduction with intermittent sand filters is better than that achieved by recirculating sand filter systems, due to the single pass and lower loading rate.
10. The level of disinfection and reduction in indicator organisms is dependent upon the level of and type of disinfection and is reliant on regular monitoring and maintenance.

Source Auckland Regional Council TP58 (2004) Table 7.1.

TP58 (2004) recommends a minimum septic tank capacity of 4,500 litres for individual dwellings with up to four bedrooms (~~6six~~ people). ~~The minimum septic tank capacity is~~, based on a minimum hydraulic retention time of 24 hours when the tank is 50% ~~to~~ 65% full of sludge and scum. ~~When~~ designing for daily wastewater production exceeding 2,500 litres per day, a rule of thumb is to size the septic tank for two to three days hydraulic retention time. The larger tank capacity allows for improved decomposition and, when fitted with an effluent outlet filter/control device, the larger ~~tanks provide~~tank provides for an extended pump-out interval requirement.

In the case of restaurants and other commercial activities, septic tank capacities require adjustment to accommodate increased solids production. This guideline only addresses domestic “all waste” septic tanks accepting wastewater derived from domestic blackwater (ie. toilets) sources and greywater (ie. bath, shower, laundry and kitchen) sources.

A ~~minimum 4,500 litre~~ septic tank that includes an effluent outlet control device and has a minimum volume of 4,500 litres is mandatory within ~~the Horizons~~Horizons’ Region for new on-site systems.

Table 4.2 Septic Tank Capacity Requirements ~~For~~for Individual Dwellings

| SINGLE DWELLING SEPTIC TANK CAPACITY REQUIREMENTS | |
|---|-----------------------------|
| 1 to 4 Bedrooms (max daily hydraulic loading 2,500 litres/day) | Minimum Volume 4,500 litres |
| Note: For larger wastewater flows refer to ARC TP58 (2004). | |

4.2.2 Septic Tank Effluent Outlet Solids Control Devices

Effluent outlet solids control devices ~~are~~, also termed effluent outlet filters ~~and~~, are very effective at improving septic tank performance (refer Figure 4.1). An effluent outlet filter is fitted to the septic tank outlet and operates by modulating effluent discharge, which improves septic tank performance and minimises solids discharge to the second treatment stage or land application system. Research indicates that effluent outlet filters increase the time interval required between solids pump ~~out~~outs, through improved biodegradation within the tank.

Effluent outlet filters replace the older concept of multiple septic tanks in series, and provide for performance exceeding that achieved by multiple septic tanks. Effluent outlet filters are mandatory in ~~the Horizons~~Horizons’ Region for new on-site systems, unless the equivalent or better level of treatment is provided in a secondary or advanced secondary treatment system.

There are three basic effluent outlet filter configurations available:

- i. Single or multiple mesh tubes.
- ii. Single or multiple slotted tubes.
- iii. Multiple plate disc dam module.

Table 4.1 Typical Domestic Effluent Quality Ranges – On-site Treatment Options

| Treatment Unit | Typical Concentration g/m ³ | | | | | | FC |
|--|--|----------------|-----------------|----------------------|---------------------------|-----------------|--|
| | BOD ₂ | TSS | NH ₃ | NO ₃ | TN (Note 8) | PO ₄ | CFU per 100 ml |
| • Raw Wastewater (Mixed value) | 250 - 350 | 100 - 400 | Varies | <1 | Varies | 10 - 30 | 10 ⁶ - 10 ¹⁰ |
| • Raw Greywater | 180 - 240 | 130 - 160 | | | | | |
| Traditional Septic Tank | | | | | | | |
| • Septic Tank (poor operation) | 170 - 250 | 80 - 110 | 40 - 60 | <1 | | 10 - 20 | 10 ⁶ - 10 ¹⁰ |
| • Septic Tank (good operation) | 120 - 150 | 50 - 70 | 20 - 30 | <1 | 40 - 100 Typical | 7 - 20 | 10 ⁵ |
| • Greywater Tank (average operation) | 50 - 80 | 30 - 50 | | | | | |
| • Digestive Tank (average operation) | 60 - 100 | 40 - 60 | | | | | |
| • Two stage septic Tanks (in series) | 70 - 120 | 40 - 60 | | | | | |
| Septic Tank | | | | | | | |
| • Septic Tank with Outlet Filter | 70 - 120 | 30 (Note 3) | | | 40 - 100 | | |
| • S T plus [note 4] Intermittent Sand Filter | <10 | <10 | | 20 - 25 | 25 - 40 | 7 | 4 x 10 ² to 10 ³ (Note 9) |
| • S T plus Recirculating Sand Filter | <10 | 2 - 6 | 2 - 4 | 30 (ave) [note 6] | 15 - 40 (note 7) | <1 - 10 | 10 ² - 10 ⁴ |
| • S T plus Recirculating Textile Filter | <15 | 15 | 0 - 5 | 30 (ave) [note 6] | 30 - 60 (note 7) | 5 - 15 | 10 ³ - 10 ⁴ 99% reduction |
| • Recirculating Sand filter with N reduction | | | | | 75% reduction (note 7) | | |
| • AS – ATP [note 5] | 20 - 50 | 20 - 100 | <1 | 35 | 25 - 60 (note 7) | 4 - 10 | 3 x 10 ³ |
| • AS – ATP Plus Sand Filter | <10 | <10 | <1 | 35 | | | |
| • Tertiary Disinfection | | | | | | | [note 10] |

Notes:

- The typical concentrations are to be used only as a guide as the concentrations of constituents in wastewater are highly variable.
- Data based on indicative values from the literature (and in some cases on estimates) and NOT on recorded New Zealand information.
- Total suspended solids (TSS) level following an effluent outlet filter depends on the type of filter and hydraulic flow. Some literature indicates TSS following some filter types may be significantly higher, eg. up to 70 g/m³.
- ST refers to septic tank.
- AS-ATP refers to activated sludge aerobic wastewater treatment plant.
- The effluent quality obtained from the more sophisticated treatment system relies on the system design, loading rate and being correctly operated and maintained.
- Treated wastewater output quality can vary significantly from the above typical values and depends on the influent concentrations.
- Lower nitrate concentration can be achieved by following an additional nitrate reduction cycle.
- The percent reduction with intermittent sand filters is better than that achieved by recirculating sand filter systems, due to the single pass and lower loading rate.
- The level of disinfection and reduction in indicator organisms depends on the level of and type of disinfection, and relies on regular monitoring and maintenance.

Source: Auckland Regional Council TP58 (2004) Table 7.1.

Effluent outlet filters require regular maintenance comprising of washing the filter to remove solids and algae build up, and should be inspected at least six monthly and cleaned as required.

Effluent discharge from a septic tank with or without an effluent outlet filter is considered to be primary treated.

4.2.3 Grease Traps

Grease traps are essential for assisting with the reduction in fat, oil and grease (FOG) from the wastewater stream derived from restaurants or situations where there is a high ~~oil, grease and fat~~ FOG content. Specific design recommendations are available in TP58 (2004) section 7.2.6.

4.2.4 Septic Tank Pump-out


Septic tanks retain solids and scum, which builds up over time ~~reducing and~~ reduces the depth of the clear zone and effluent retention time. Septic tank solids and scum should be pumped out when the combined depth represents 50% of the tank depth.

~~4.3 Alternative Wastewater Treatment Systems~~


~~The design of composting, vermiculture, peat bed and wetland systems is outside the scope of these guidelines. It is recommended that specialist design guidelines be consulted for the design and implementation of these systems.~~

Figure 4.1 Examples ~~Of of~~ Septic Tank Effluent Outlet filters

Type A. Single or Multiple Mesh Tube Effluent Outlet filter

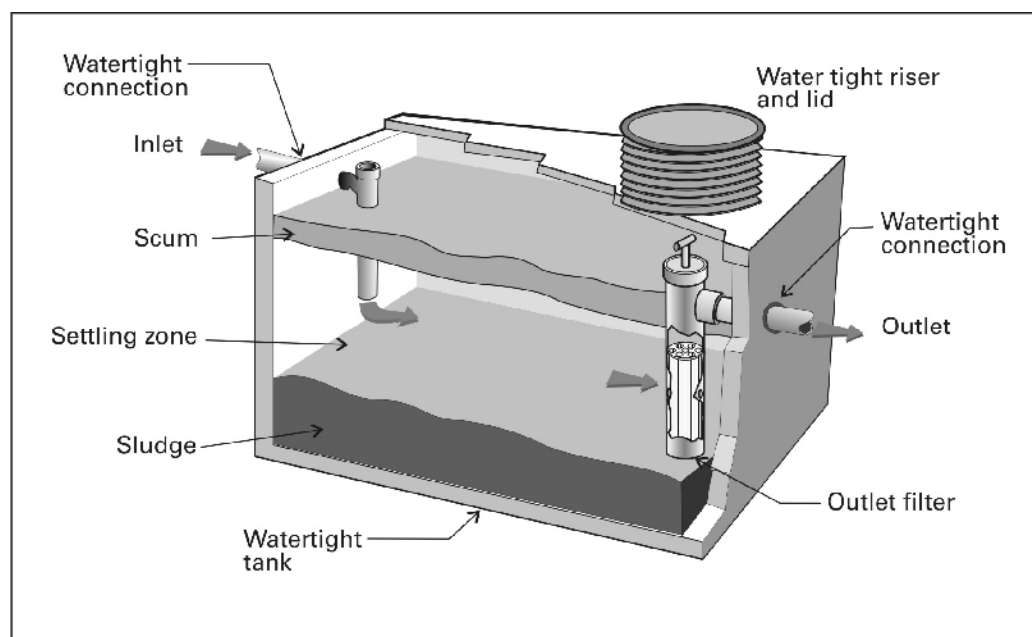

Type B. Plate Disc Dam Effluent Outlet Filter

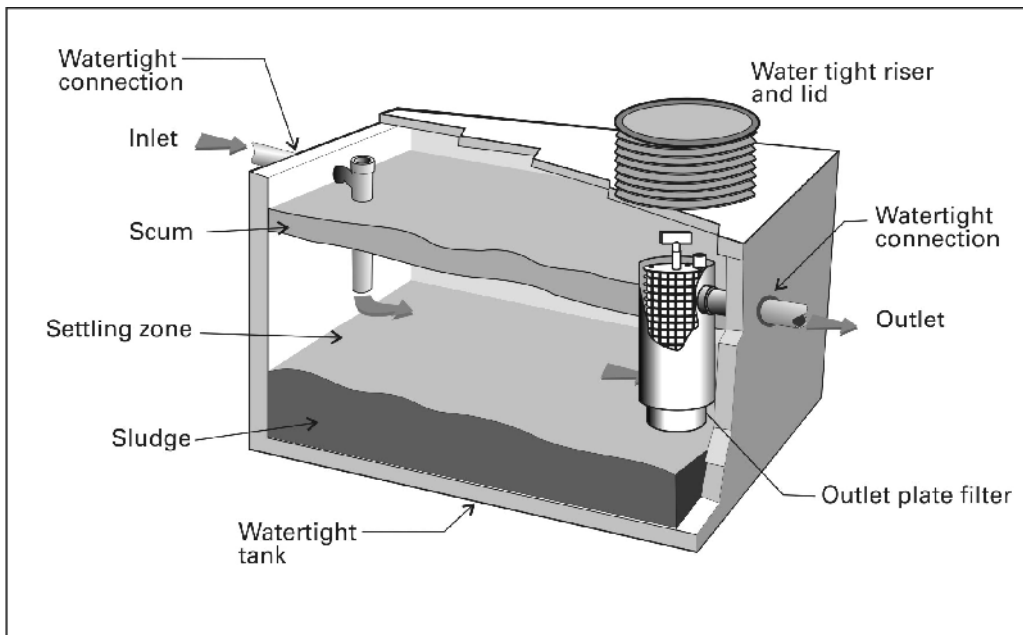

Source: Auckland Regional Council TP58 (2004).


4.3 Secondary Treatment

Secondary treatment systems suitable for treating domestic wastewater are readily available and are typically termed **AerobicAerated** Wastewater Treatment Systems (AWTS) (Figure 4.2). AWTS systems are more susceptible to variable treated effluent discharge quality, particularly where ~~treating~~ they are used to treat wastewater derived from intermittently occupied holiday homes ~~than~~ instead of advanced secondary systems.

The daily wastewater treatment capacity for the various commercially available systems varies, and the designer is urged to confirm with the supplier before installation that the AWTS is capable of treating the design wastewater flow volume and organic load within the wastewater.

As with any wastewater treatment system, an operative maintenance and management programme with an experienced service provider is critical for achievement of optimum performance. A six ~~(6)~~ month maintenance frequency is recommended to maintain consistent treated effluent discharge quality. A copy of the ~~sign~~ signed maintenance contract is to be supplied to the Territorial Authority for all new wastewater systems.

Figure 4.2 Example of An Aerobic Aerated Wastewater Treatment System

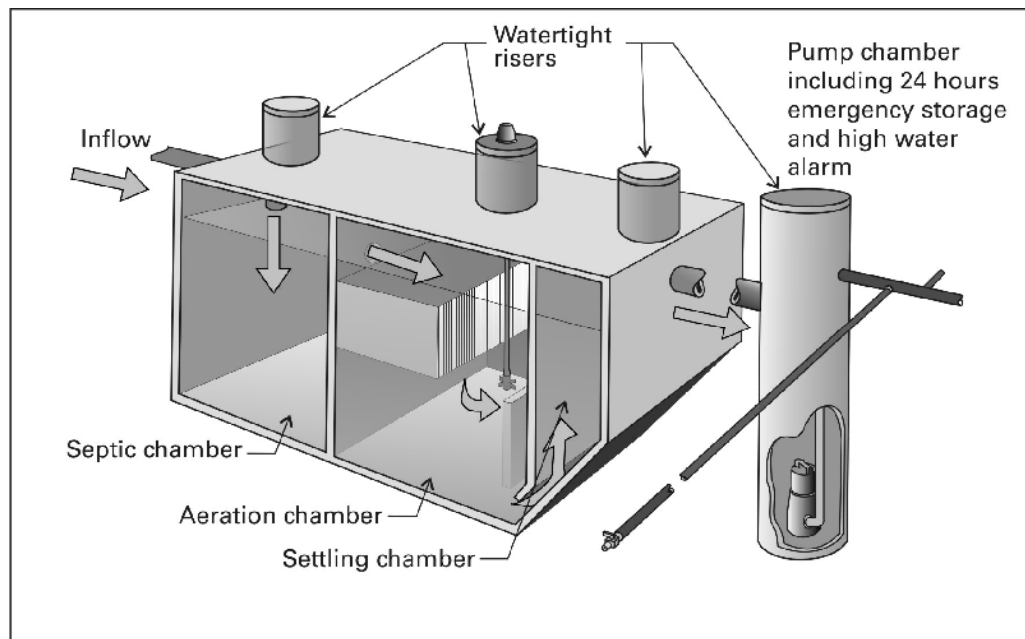

Source: Auckland Regional Council TP58 (2004).

4.4 Advanced Secondary Treatment

Advanced secondary treatment systems include sand filters, textile filters and membrane bioreactor systems. Advanced secondary system performance is typically less affected by intermittent wastewater flows.

4.4.1 Sand Filters

Modern sand filter design comprises primary treatment by septic tank, including an effluent outlet filter from which primary treated effluent is timer dose loaded by pump to the surface distribution system and spread across the entire sand filter surface to ensure thin film flow. Failure to ensure even distribution across the entire surface can result in spot loading, which leads to short-circuiting and saturated flow through the sand filter, causing this causes reduced effluent treatment quality and, in extreme cases, sand filter failure. Timer-dosed systems provide for more effective treatment than sand filters dosed on demand (ie. the pump is operated by float switch or automatic siphon). Timer dosing buffers the daily peak wastewater production in the septic tank and doses the sand filter in a series of controlled doses over 24 hours. On-demand dose loading by float switch operated pump or siphon results in doses being concentrated around peak wastewater production times and this can result in periodic overloading and less effective treatment.

It is critical that to use graded sand free of fines is used for sand filters to ensure optimum performance (TP58 (2004) includes sand grade guidance).

Sand filters are also termed packed bed reactors. The surface of intermittent sand filters can be covered with porous soils, but recirculating sand filters must be open to enable transfer of air into the filter for maintenance of aerobic conditions and as such; therefore they should never be covered with soil.

4.4.1.1 Intermittent Sand Filters (ISF)


Intermittent sand filters are single pass sand filters which that are very effective at reducing BOD, TSS, turbidity, ammonia and faecal coliforms. Effluent from the septic tank, including an effluent outlet filter, is dose loaded as frequent small doses onto the sand filter surface. Applied effluent makes a single pass through the graded sand bed, is collected via under drains, and discharged to the treated effluent tank for land disposal (Figure 4.3). Design parameters for intermittent sand filters are provided in Table 4.3.

Table 4.3 Intermittent Sand Filter

| Intermittent Sand Filter Design Parameters | |
|---|---|
| Hydraulic <u>Loadingloading</u> | 40 to 100mm per day |
| Organic <u>Loadingloading</u> | 0.0025 – 0.01 <u>kgkg</u> BOD/m ² /day |
| Dosing <u>Frequencyfrequency</u> | 12 to 48 times per day |
| <u>Sand—DepthEffective sand media size (d₁₀)</u> | <u>600mm—900mm0.25 – 0.75mm</u> |
| <u>Uniformity Coefficient (UC)</u> | <u>< 4 typically 3.5</u> |
| <u>Sand depth</u> | <u>600mm – 900mm</u> |
| Notes: | |
| 1. The above design application rates are for domestic strength wastewater. | |
| 2. Sand must be durable and free of fine silt, clay and organic particles. | |
| 3. Effective media size d ₁₀ is defined as the 10% size by weight determined by a wet sieve analysis. | |
| 4. Uniformity Coefficient (UC) is d ₆₀ divided by d ₁₀ . UC indicates whether individual particles are of a similar size or if there is a wide range of particle sizes. | |

Source: Crites and Tchobanoglous (1998)

Figure 4.3 Example Of An intermittent Sand Filter

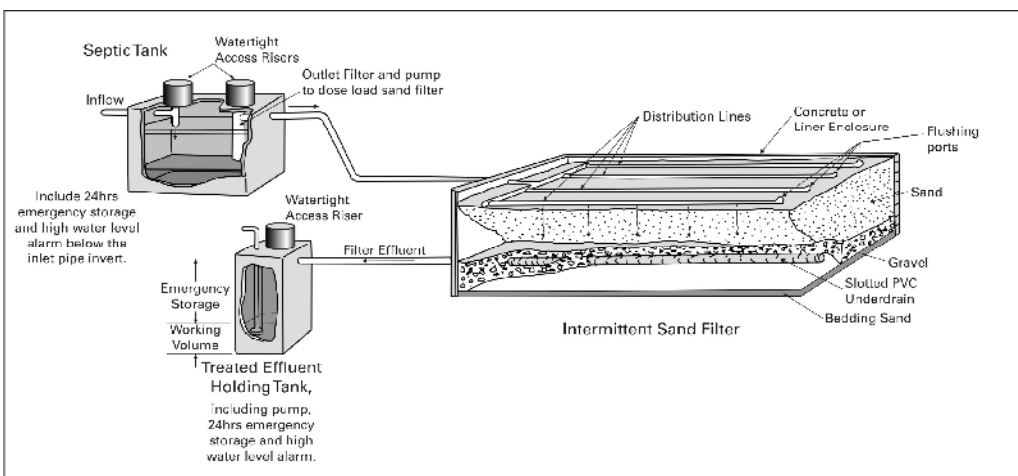

Source: Auckland Regional Council TP58 (2004).


4.4.1.2 Recirculating Sand Filters (RSF)

Recirculating sand filters are multiple pass sand filters (Figure 4.4). They are similar to intermittent sand filters except that part of the treated effluent is mixed with and dilutes primary treated effluent in a recirculation tank, and is then reapplied to the sand filter. Dilution of primary treated effluent allows for a higher loading rate than that for intermittent sand filters. Recirculating sand filters are very effective at producing a nitrified effluent low in BOD and TSS. However, sand grain size and the hydraulic and organic loading rate isare critical for effective performance. Design parameters for recirculating sand filters are provided in Table 4.4.

Table 4.4 Recirculating Sand Filters

| Recirculating Sand Filter Design Parameters | |
|---|--|
| Hydraulic Loading loading | 120 to 200 mm per day |
| Organic Loading loading | 0.01 – 0.04 kg BOD/m ² /day |
| Dosing Frequency frequency | 48 to 120 times per day |
| Sand Depth depth | 450 mm – 900 mm |
| Recirculation Tank volume Effective media size (d ₁₀) | Typical 1 day's flow plus 24 hours' emergency storage or gravity to TET chamber. 5mm Typically 2.5mm |
| Treated Effluent Tank Uniformity Coefficient (UC) | Working volume plus 24 hours flow emergency storage <2.5 Typically 2 |
| Recirculation tank volume | Typical 1 day's flow plus 24 hours' emergency storage or gravity to treated effluent tank (TET) chamber. |
| Treated effluent tank | Working volume plus 24 hours flow emergency storage |
| <p>Notes:</p> <ol style="list-style-type: none"> <u>1. The above design rates are for domestic strength wastewater discharged from a septic tank that includes an effluent outlet filter.</u> <u>2. Organic and hydraulic loadings are independent variables that depend on the wastewater source.</u> <u>3. Sand must be durable and free of fine silt, clay and organic particles.</u> <u>4. Effective media size d₁₀ is defined as the 10% size by weight determined by a wet sieve analysis.</u> <u>5. Uniformity Coefficient (UC) is d₆₀ divided by d₁₀. UC indicates whether individual particles are of a similar size or if there is a wide range of particle sizes.</u> | |

Source: Crites and Tchobanoglous (1998)

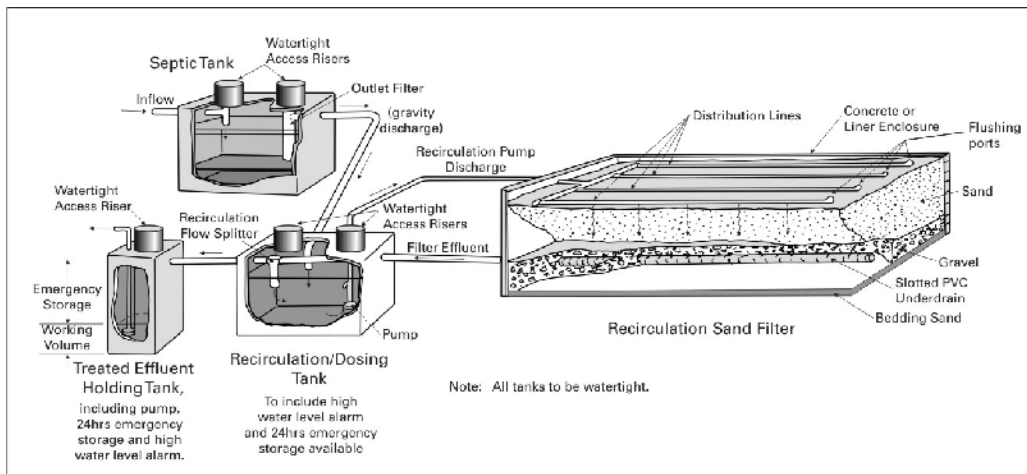Figure 4.4 Example of a Recirculating Sand Filter

Source: Auckland Regional Council TP58 (2004).


4.4.1.3 Bottomless Intermittent Sand Filters

Bottomless intermittent sand filters are a combined effluent advanced secondary treatment and land application method ~~and; they~~ are covered in section 6.6.

4.4.2 Textile Filters

Textile filters utilise an engineered textile, ~~having a high~~ that has a large surface area and high porosity for aerobic treatment of primary treated effluent. The highlarge surface area and porosity allows for a significantly higher loading rate than for sand filters, and therefore a significantly smaller footprint for treatment of a given volume. Primary treated effluent is timer dose loaded from a recirculation tank onto the textile surface and percolates down to a collection system or directly to the recirculation tank. Textile can be in the form of sheets, cubes or coupons. ~~It is important that there is a (Figure 4.5).~~ A good air flow is important for maximisation of maximising oxygen transfer to the bacterial film that develops on the textile surfaces.

The effective hydraulic and organic loading rate ~~is dependent~~ depends on the particular textile filter system, and ~~it is~~ designers are recommended ~~that~~ designers to apply loading guidelines provided by the equipment suppliers.

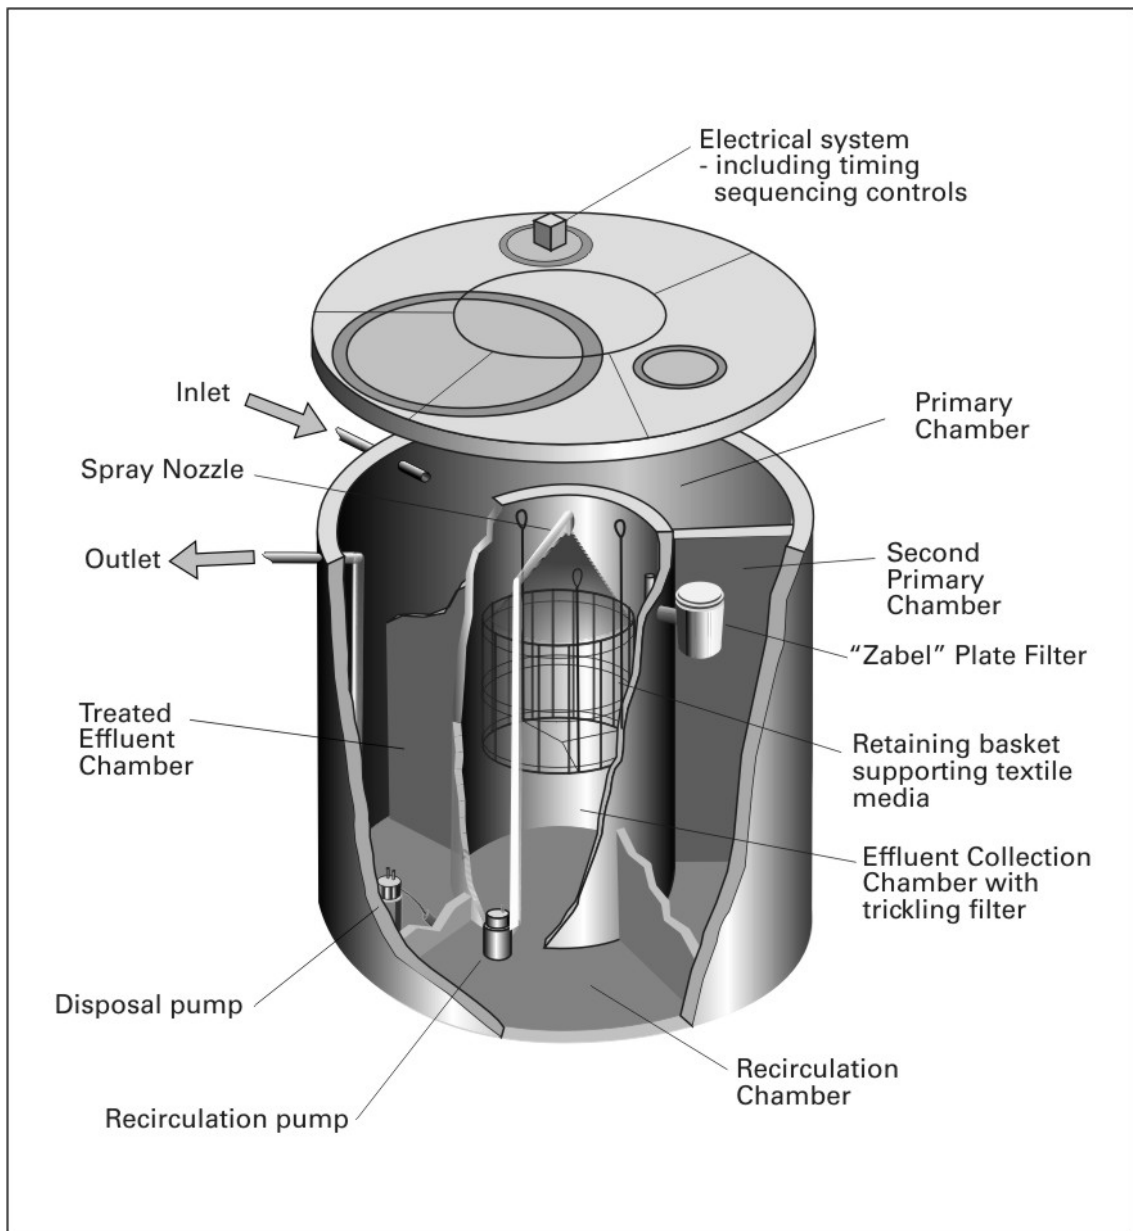Figure 4.5 Example of a Textile Filter

Source: Auckland Regional Council TP58 (2004).

4.4.3 Membrane Bioreactors (MBR)

Membrane bioreactor (MBR) systems ~~using~~, which use ultra fine membrane filtration ~~which and~~ are suitable for treating effluent from individual dwellings, have only recently become available. Typically ~~the~~, an MBR system comprises a primary treatment chamber from which wastewater is discharged to the MBR filtration chamber. The filtration chamber contains the submerged flat membrane panels. Air blowers located below the membrane panels generate an upward flow of wastewater over the membrane panel surface, and help to reduce clogging of the filtration surfaces. The panels are located below the water surface to provide the head necessary for the effluent to pass

through the membrane into the hollow central section of the panel. Permeate from the hollow centred panel is then discharged to the treated effluent tank. In operation, the membrane panels have an effective pore size of less than ~~0.04–01~~ micron (ultra filtration), and may remove viruses and pathogenic micro-organisms prior to discharge. Activated sludge that accumulates in the MBR filtration chamber is recycled back to the primary treatment septic chamber to achieve partial denitrification.

It is recommended that designers use the ~~suppliers~~supplier's design services when sizing these systems.

4.5 Tertiary Treatment

Tertiary treatment refers to additional treatment comprising disinfection for microbiological reduction and/or nutrient reduction following secondary treatment.

4.5.1 Disinfection

Designers are reminded that disinfection does not remove all micro-organisms from the effluent but it should limit their ability to reproduce.

4.5.1.1 Chlorine

Chlorine is the most common disinfection method because:

- i. it is effective; and
- ii. the chlorine residual is easily monitored.

~~It–Effluent~~ is not recommended ~~that–effluent–to~~ be chlorinated prior to discharge to land because the chlorine reacts with organic contaminants to form chlorination by-products including organochlorines. Some of the chlorine by-products are carcinogenic and can have cumulative ~~affect~~effects on the environment. These risks are considered acceptable where the benefits to public health outweigh the potential environmental risks ~~and are unlikely to be an issue with on-site systems.~~

Effluent that has been treated to advanced secondary level, and thus has a very low organic content, is more readily disinfected using chlorine than effluent having a high organic content. Low organic content effluent has a lower chlorine demand than high organic content effluent, and therefore a reduced chlorine requirement.

Common chlorination methods include:

- i. chlorine tablet ablation; and
- ii. automated flow proportionate chlorine dosing.

The use of tablet chlorination is considered to be unreliable as the level of chlorine addition is not controlled and not related to the actual dose requirement to achieve a $0.5\text{g}/\text{m}^3$ chlorine residual.

~~A To ensure effective disinfection requires a~~ freely available chlorine (FAC) or chlorine residual of at least 0.5 g/m^3 ~~is required~~ and a minimum contact time of ~~30–30 minutes to ensure effective disinfection~~. An advantage of chlorine disinfection is that the chlorine residual and disinfection effectiveness is readily monitored.

The most effective chlorination method comprises a chlorine contact tank, chlorine dosing system, mixing system, redox probe or chlorine probe to monitor the chlorine residual, and alarms to monitor the chlorine residual in the contact tank and the volume of chlorine remaining in the holding tank.

4.5.1.2 Ultraviolet Light (UV) Disinfection ~~(UV)~~

Ultraviolet disinfection utilises UV radiation to penetrate cell walls ~~to and~~ disrupt the nucleic acids and prevent reproduction. The advantage of UV disinfection over chlorination is that UV disinfection does not result in formation of toxic by-products. However ~~it is more difficult to monitor~~, the effectiveness of UV disinfection ~~is more difficult to monitor~~ than chlorination.

The most effective UV disinfection depends on the effluent quality and is best achieved with effluent ~~having that has~~ low suspended solids and turbidity. Suspended solids provide protection for bacteria by shading and also a media for attachment, ~~thus~~ resulting in ineffective disinfection.

Effluent should be treated to at least secondary quality but may require additional filtration for effective UV disinfection. UV disinfection systems typically comprise mercury arc bulbs ~~which that~~ provide the UV source.

4.5.1.3 Ozone

Ozone (O^3) is a highly effective oxidant and is more effective than chlorine. However ozonation is an expensive option as it is highly unstable and must be produced on-site.

4.5.2 Nutrient Reduction

Nutrient reduction refers to the reduction in nitrate and phosphates contained within the effluent prior to land disposal.

4.5.2.1 Total Nitrate Reduction

Increasing nitrate concentrations within groundwater can impact on human health. Ammonia is highly soluble, easily leached into groundwater and is toxic to aquatic life. The maximum Total Nitrate (TN) ~~(organic and inorganic)~~ content within drinking water recommended by the New Zealand Ministry of Health is 50 g/m^3 .

Nutrients can also stimulate plant and algae growth in surface water and are factors leading to eutrophication. Bacteria that use oxygen from the water to decompose the additional vegetation further degrade water quality for aquatic life.

A detailed description of the nitrogen cycle is available in TP58 (2004) section 11.4.

Secondary and advanced secondary wastewater treatment systems can be configured to reduce the nitrogen content of the treated effluent. ~~There is a significant variation~~ Capacity for nitrate reduction varies significantly between the available on-site wastewater systems, ~~capacity for nitrate reduction~~. Performance testing of a number of wastewater treatment systems, including ~~the their~~ nitrate reduction capability, is being undertaken in Rotorua, ~~and~~ the results of the testing regime are available for designers to allow ~~a comparison~~ comparisons between systems. This will enable an informed decision when choosing which system to install in a nitrate-sensitive environment.

4.5.2.2 Phosphate Reduction

Total ~~phosphorus~~ Phosphorus (TP) in untreated domestic wastewater is about one third in the inorganic soluble form, ~~dissolved reactive phosphorus~~ Dissolved Reactive Phosphorus (DRP), and the remainder is insoluble organic phosphorus. However, most of the insoluble phosphorus converts to DRP after anaerobic processes in a septic tank, and DRP is typically 75% to 90% of the total phosphorus in an effective secondary treatment system.

Standard wastewater treatment systems have limited capacity for phosphorus reduction. Any removal that is achieved is from the binding of phosphorus to solids in the effluent and removal of these solids by floatation or settlement.

Phosphorus removal or reduction is rarely required for discharge to land application systems within New Zealand because the phosphorus binds to aluminium and iron within the soil. However, phosphorus saturation will occur with time ~~at which stage~~ and leaching may ~~occur~~ follow.

4.6 Pump Chambers and Emergency Storage

A pump chamber is any tank that includes a pump, either within the treatment process or for storing treated effluent prior to discharge to the land application system.

4.6.1 Alarms

Any pump system is to include high water level emergency alarms to ~~warn of a problem~~ alert operators to potential problems within the system should water level rise above the normal operating level. The alarm can be either audible or visual. The visual alarm is to be located in a prominent position so as to be certain it is noticed in the event of activation.

4.6.2 Emergency Storage

There is always a risk of pump failure or disruption to the electricity supply potentially resulting in overflow from the chamber. This risk can be minimised by including at least 24 hours emergency storage in any pump chamber, or by providing overflow to a chamber ~~having~~ within the system that has sufficient

storage capacity ~~within the system~~. Emergency storage is to be provided above the high water level alarm and is required to allow time for the maintenance contractor to remedy the problem.

4.7 System Construction Integrity

Construction and installation of a watertight system is critical to the performance of both the treatment stage and land disposal stage.

All tankage must be completely watertight to prevent groundwater infiltration and effluent exfiltration. In addition, all risers and lids must be watertight along with all sewer pipes, sewer pipe joints, and tank inlet and outlet pipe connections.

Infiltration is an extremely serious problem for any wastewater treatment system and will result in hydraulic loading exceeding the design capacity of the system, potentially leading to catastrophic failure.

4.8 Greywater

Greywater is wastewater derived from domestic sources within a dwelling, including the ~~bathroom~~ shower and bath, hand basins, laundry and kitchen. The minimum wastewater treatment requirement is ~~an advanced a~~ septic tank ~~(including that includes an~~ effluent outlet filter), followed by discharge to ~~the a~~ land application system that is appropriately sized according to the daily greywater discharge volume, soil category and land application method. The land application system design is to be based on design for normal domestic wastewater.

A greywater collection, treatment and land application system is required where a composting toilet is installed in the dwelling. ~~There are also proprietary~~ Proprietary greywater reuse systems are available that take water from the laundry, bathroom and kitchen for irrigation of gardens. However ~~it is important that~~, a dedicated greywater land application system ~~is also should~~ also be installed for use when garden irrigation is not required.

4.9.1 Greywater ~~Recycle~~

4.8.1 Recycling

Greywater recycling refers to systems that treat the greywater and return it to toilet cisterns for flushing. Horizons ~~Regional Council~~ has health concerns with greywater reuse and is waiting on advice from ~~Public~~ the Ministry of Health before approving installations ~~with~~ in the Region.

4.9 Alternative Wastewater Treatment Systems

The design of composting, vermiculture (use of worms to convert organic wastes to stable soil enriching compounds), peat bed and wetland systems is outside the scope of these guidelines. Specialist design guidelines should be consulted for the design and implementation of these systems.

4.9.1 Composting Toilets

Composting toilets ~~take~~ either ~~take~~ all toilet waste or separate the solids and urine. The solids are typically collected in a container that is replaced when full. Waste in the full container is then buried within topsoil to complete the composting process. There are variations on the process described. The success of a composting toilet ~~is dependent upon~~depends on the commitment of the homeowner and not all homeowners are comfortable with ~~the system~~these systems. It is therefore important that sufficient area is available within the property for installation of a full waterborne on-site wastewater treatment and land application system to manage both blackwater and greywater.

A resource consent ~~will~~may be required for any composting system and the application is to include a detailed system management plan ~~detailing that~~details operation, maintenance and compost handling and disposal procedures.

Wherever a composting system is installed it will still be necessary to install a greywater treatment and land application system. The greywater system is to be designed in accordance with a domestic system using the per capita flow allowance provided in Table 3.2, and a land application system designed for the design daily greywater production.

5. DOSING AND DISTRIBUTION METHODS AND DEVICES

Dosing and distribution methods are defined as the method of discharging effluent from the treatment system to the land application system, and the method for distributing treated effluent within the land application system across the infiltration surface. Historically, systems utilised trickle loading by gravity. However, this ~~can~~ potentially can result in creeping failure within the land application system through effluent being becoming concentrated at the inlet end of the system and overloading ~~of~~ a small area.

5.1 Controlled Loading Devices

Discharge of a set volume of treated effluent by pump or siphon allows for the treated effluent to access the entire length of the land application system distribution line. This is important to ensure the entire design infiltrative surface is utilised rather than the effluent being concentrated on only part of the surface and potentially resulting in creeping failure. Effective distribution ensures the entire infiltration surface is utilised and improves the land treatment potential of applied effluent by soils below the infiltration surface.

5.1.1 Pump-Controlled Dose Loading

Pumped dose loading is preferable to siphon loading as the dose volume and timing of that dose can be controlled to suit the land application system and soils. Pumping also allows the treated effluent produced during the daily peaks to be buffered and discharged evenly over the entire 24 hours as a series of small doses on a timer system; this is in contrast to discharge being concentrated as large doses around the peak times of production.

5.1.2 Siphon-Controlled Dose Loading

Siphon dose loading requires sufficient height difference between the treated effluent tank and land application system to ensure even distribution throughout the distribution pipe(s). A set volume of effluent can be discharged each time the siphon trips. Siphons can only dose on demand, and intermittently overload the infiltrative surface during periods of peak wastewater production over the day.

5.2 Controlled Dose Loading Methods

The treated effluent discharge pump can ~~be~~ either ~~be~~ operated on ~~demand~~ or timer controlled.

5.2.1 On-Demand Dose Loading

On-demand dosing can be by siphon or pump operated by a float switch. The disadvantage is that treated effluent discharge is concentrated around the peak time of wastewater production.

5.2.2 Timer-Controlled Dose Loading

Timer dose loading allows control over the volume and timing of each discharge. The advantage is that effluent produced during daily peaks can be buffered in the treated effluent tank (TET) and discharged over the entire day; ~~which.~~ This can improve the performance of the land application system and land treatment potential of the infiltrated effluent.

5.3 Uncontrolled Gravity Loading

Uncontrolled gravity or trickle loading should only be used where there is no alternative. The disadvantage is that effluent may not be distributed across the entire infiltrative surface, resulting in creeping failure.

5.4 Distribution ~~To The~~ to the Land Application System

Treated effluent discharged from the TET can ~~be either~~ be discharged to load the entire land application system with each dose or to load sections of the system sequentially. It is critical that the distribution pipe to the land application system is watertight so as to exclude ~~ground~~ groundwater or surface water infiltration and exfiltration of treated wastewater.

5.5 Distribution Methods ~~Within The~~ within the Land Application System

The distribution method within the land application system (trench, bed or mound) refers to the pipe from which effluent is discharged within the land application system. The distribution pipe ~~is either~~ may be flood loaded via:

- i. perforated pipe; or
- ii. slotted pipe ~~or~~.

Or dose loaded by:

- i. low pressure effluent distribution pipe;
- ii. low pressure pipe; or
- iii. pressure compensating emitters—dripper irrigation line.

Dose loading by pumping (or siphon) is required to ensure equal loading of the entire distribution system and that effluent is distributed evenly across the entire infiltration surface.

5.5.1 Flood Loading

A land application system is termed to be flood loaded where effluent from the treatment unit is discharged via siphon or pump to a distribution box, with effluent distributed by gravity along the entire length of each trench or bed by a perforated or slotted pipe. It is important that the dose volume is sized to provide distribution along the entire length of individual trenches or bed, taking the pipe diameter and length into account. The length of each trench or bed should not be more than about 15 metres to maximise distribution along the entire trench/bed length.

5.5.2 **Dose Loading**

A land application system is termed to be dose loaded where effluent from the treatment unit is discharged via siphon or pump to an LPP (low pressure pipe), LPED (low pressure effluent distribution pipe) or PCDI (pressure compensating dripper irrigation pipe) within the land application system. Dose loading ensures even distribution along the entire length of distribution pipe or pipes.

5.5.3 **Distribution Aggregate**

Graded aggregate of a durable material is required within most sub-surface land application systems to support the distribution lines, allow effluent to spread across the entire infiltration surface and maintain the integrity of the trench or bed excavation. Only distribution aggregate free of fines is to be used, as any fine will be washed onto and clog the infiltration surface over time, resulting in reduced infiltration capacity and potentially system failure.

AS/~~NZSNZS~~ 1547:2000 recommends an aggregate size range of 20-~~mm to~~ 40-40 mm. The designer must be aware that different land application methods may require different aggregate grading.

6. LAND APPLICATION METHODS

6.1 Discussion

This section provides guidance for selecting the most appropriate on-site land application method and sizing the system based on soil category. A thorough surface and sub-surface site assessment (see section 2) must be completed before the most appropriate land application method suited to site soils, environmental constraints and site constraints can be identified, the basal or areal loading rate based on soil category determined, and the system sized.

Appropriate loading rates based on soil category, along with a worked design example for each land application method, are provided.

~~There is a~~ range of land application methods is detailed in this section of the guidelines ~~and these include, including:~~

- i. Sub-surface pressure compensating dripper irrigation (ssPCDI).
- ii. Surface pressure compensating dripper irrigation (sPCDI).
- iii. Shallow narrow trench low pressure effluent distribution (LPED)).
• ~~Standard trench disposal~~
- iv. trenches.
- v. Conventional beds.
- vi. Evapotranspiration seepage beds (ETS).
- vii. Mounds.
- viii. Bottomless intermittent sand filters.

The land application system provides for distribution of treated effluent across the infiltration surface and final land treatment of the wastewater before mergingit merges with groundwater.

6.2 ~~Disposal~~ Land Application Area Sizing

The footprint of the primary land application system is based on the peak daily effluent volume to be discharged from the treatment system to the land application system, the type of land application method proposed, and the soil loading rate based on soil category. In addition to the primary system, it is also necessary to set aside a reserve disposal-land application area that is to be available for use in the future if required. Reserve disposal-land application area requirements are set out in Table 2.3 (page 17).

The final selection of a design loading rate for a specific land application method is based on soil category and site and environmental constraints determined from the site assessment. Where environmental or site limitations are significant, it is important that-for the designer applies to apply the more conservative loading rate.

Horizons ~~Regional Council~~ does not support the use of increased design loading rates for secondary treated effluent, as provided in AS/NZSNZS 1547:2000. The use of elevated wastewater loading rates reduces the factors

of safety required in any design ~~necessary~~ to make allowance for unforeseeable wastewater production, soil infiltration capacity and soil moisture variations. It is accepted that primary treated effluent applied to an infiltration surface results in formation of a biological mat that effectively slows the infiltration into the underlying natural soil. However, the literature reports increased risk of inadequate land treatment of ~~the~~ effluent if the loading rate is increased to make use of potentially more rapid infiltration. Reduced land treatment ~~increases the~~ leads to increased environmental and public health risks from nutrients and pathogens merging with ground and surface water. Horizons ~~Regional Council~~ considers that a conservative approach ~~to be~~ is important for optimal land application system operation.

The land application system design infiltration area is calculated on either areal loading or basal loading and detailed for each method.

6.2.1 Areal Loading Rate Design

Areal loading refers to the entire enclosing area of the wastewater land application system. Areal loading rates are applied to shallow sub-surface or surface irrigation systems, including:

- i. Sub-surface pressure compensating irrigation systems.
- ii. Surface pressure compensating irrigation systems.
- iii. Sub-surface shallow narrow trench low pressure effluent distribution systems (LPED).

6.2.2 Basal Loading Design

Basal loading refers to the basal area only of a land application system. Basal loading rate design is applied to trench and bed systems including:

- i. Conventional trenches.
- ii. Conventional beds.
- iii. Evapotranspiration seepage beds.

In addition to the basal loading rate, the designer must also confirm the areal loading rate for the entire land application system enclosing area ~~which includes, including~~ the area between beds and trenches.

6.2.3 Land Application System Method and Design Area Calculation Method

Table 6.1 below sets out the method for ~~disposal~~ calculating the land application area ~~calculation~~ to be used for the land application methods described in this section.

Table 6.1 ~~Disposal System~~Land Application Area Calculation ~~method~~Method

| Land Application Method | Design Area Calculation Method |
|---|---|
| Pressure Compensating Dripper Irrigation | Areal Loading |
| LPED Trenches Secondary Treated Effluent or Better | |
| Pressure compensating dripper irrigation | Areal Loading |
| Conventional Trenches | Basal Loading |
| Evapotranspiration Beds Primary Treated effluent (min septic tank & Effluent Outlet Filter) | |
| LPED shallow trenches | Basal Loading Areal loading |
| Conventional Beds | Basal Loading |
| Bottomless Sand Filters Minimum Primary Treated Effluent | |
| Conventional trenches | Basal Loading loading |
| Evapotranspiration beds | Basal loading |
| Conventional beds | Basal loading |
| Bottomless sand filters | Basal loading |

6.3 Pressure Compensating Dripper Irrigation

Pressure ~~Compensating Dripper Irrigation~~compensating dripper irrigation (PCDI) refers to the use of small diameter pipe including pressure compensating emitters. Pressure compensating emitters allow for the same volume of treated effluent to be discharged from each emitter, even where the lines are not installed level. The lines must be pressurised by pump to achieve the flow rate required to operate the emitters. PCDI requires a minimum of secondary treated effluent ~~of~~with BOD₅:TSS ~~of~~of better than 20:30 to minimise the risk of premature line clogging and blockage. Fine filtration ~~may be required for fine filtration~~of aeration treatment plant effluent ~~discharge~~may be required in order to minimise solids carry-over to the land application system. In any event, a programmed maintenance schedule should include regular flushing of the lines to remove accumulated material.

There are a number of PCDI line suppliers who should be consulted for specific design and installation guidance.

Non-pressure compensating irrigation line is also available but must be installed level to achieve even distribution along the entire length of line. It is recommended that designers use pressure compensating irrigation lines in all installations.

6.3.1 Sub-surface Pressure Compensating Dripper Irrigation

Sub-surface PCDI lines are either mole ploughed or hand trenched into the topsoil zone. ~~It is not recommended that the~~The lines ~~are~~should not be placed into poorly drained soils underlying topsoil as this can result in the irrigated effluent tracking along the line. Additional topsoil can be imported and placed over the land application area in the event there is insufficient natural topsoil depth. The maximum recommended depth of installation is ~~150 mm to~~200 mm within the aerobic and biologically active surface soils.

Extreme care is recommended where it is proposed to sub-irrigate effluent under lawns where the underlying soils are not well drained, and particularly if the lawn is subject to foot traffic. This can result in pugging of the ground surface and effluent ponding. It is preferable that PCDI is placed under garden areas, although care is required when digging the garden subsequently not to cut the lines.

The advantages of PCDI are:

- i. Allows irrigation within irregular shaped areas.
- ii. Allows irrigation in areas that are not practical for trench or bed systems.
- iii. Lines do not need to be installed level.
- iv. Allows for widespread distribution over the infiltration area, maximising land treatment potential.
- v. Allows for improved control of effluent irrigation.
- vi. Allows for beneficial reuse of effluent for sub-irrigation of gardens.

6.3.2 Surface Pressure Compensating Dripper Irrigation

Where it is not practical to bury the PCDI lines they can be placed on and pinned to the ground surface. Situations where surface irrigation may be applicable include bushed areas or gardens where public access can be restricted. There is increased risk of run-off from the disposal and application area, particularly on sloping sites. The disposal and application area must be fenced to restrict access.

6.3.3 PCDI Areal Loading Rates

The areal loading rate refers to the disposal of effluent over the entire area enclosed by the irrigation system, including the area between the lines.

Recommended areal loading rates for pressure compensating dripper irrigation systems are presented in Table 6.2 below.

Table 6.2 Pressure Compensating Drip Irrigation Loading Rates

| RECOMMENDED AREAL LOADING RATES FOR PRESSURE COMPENSATING DRIPPER IRRIGATION (PCDI) | |
|--|---|
| Soil Category | Areal Loading Rate mm/day (litres/square metre/day) |
| Category 1 | 5 (Note 1) |
| Category 2 | 5 (Note 1) |
| Category 3 | 4 – 5 (Note 1) |
| Category 4 | 4 - 5 |
| Category 5 | 3 - 4 |
| Category 6 | 2 - 3 (Note 2) |
| Category 7 | Note 2 |

Notes:

1. Pressure compensating dripper irrigation ~~is (PCDI) can also be~~ used as an effluent distribution method within a bed or trench for soils ~~having that have~~ good to rapid drainage (~~Cat Category~~ 1-3 soils). The design loading rate ~~will be dependent upon depend on~~ the soil ~~type category~~ and land application method employed. ~~In the case of The loading rate for~~ bed or trench land application ~~the loading rate methods~~ is to be calculated on basal rather than areal loading.
2. Special design considerations are required for Category 6 and 7 soils, and where there is limited topsoil depth.

Source: Auckland Regional Council TP58 (2004) ~~and modified~~.

6.3.4 Loading Methods

6.3.4 PCDI Head Loss Assessment

PCDI irrigation systems must be dose loaded by pump, although siphon loading may be used where there is sufficient head difference between the ~~TET treated effluent~~ tank (TET) outlet and uppermost irrigation line.

Irrigation line suppliers provide design guidelines for their products. The designer is recommended to calculate the minimum pump head required, ensuring effluent is distributed through the entire irrigation system. Failure to specify sufficient pump head can result in uneven loading and distribution through the entire network, effluent breakout and premature pump failure. An example head loss assessment is provided in Table 6.3.

Table 6.3 Head Loss Calculation Example

| PCDI PUMP HEAD LOSS CALCULATION EXAMPLE | | |
|--|---------------------------------------|--|
| Component | Head Loss (m) | Comments |
| Emitter | 12.0 | Minimum pressure required |
| Lateral | 0.0 | Head loss insignificant |
| Sub-main | 1.0 | Using Netafim Ram 17 as a sub-main |
| Main | 0.6 (note 3) | Using 25mm LDPE |
| Filter | 3.0 | Assume blocked filter |
| Tank Depth | 2.0 | |
| Water Meter | 1.5 (note 4) | Required |
| Elevation | 10 (note 5) | Upslope (If downslope include anti-siphon measures). |
| Total Design Head | 30.1m + 10% = 32.11m = 32m | |
| Notes: | | |
| <ol style="list-style-type: none"> 1. Based on Netafim design guidelines. 2. Confirm individual headloss values with equipment supplier. 3. Varies depending on length of main. 4. Depends on brand. 5. When pumping downslope always include anti-siphon measures. Elevation is the height difference between the <u>treated effluent tank (TET)</u> and highest point of the disposal field. If the field is downslope elevation is zero. | | |

6.3.5 Pressure Compensating Dripper Irrigation Design Example

A worked example of a PCDI calculation for determining disposal and application area requirements is provided in Table 6.4 below and a typical layout in Figure 6.1.

Table 6.4 Pressure Compensating Dripper Irrigation Design Example

| PRESSURE COMPENSATING DRIPPER IRRIGATION DESIGN EXAMPLE | |
|--|---|
| Peak Daily Effluent Production <u>Peak daily effluent production</u> | 900 litres/ Day <u>day</u> |
| Soil Category <u>category</u> | 4 |
| Areal Loading Rate <u>Areal loading rate</u> | 3 litres/square metre/day Or <u>3 mm/day</u> |
| Daily effluent flow (l/d) <u>Areal loading rate (l/m²/d)</u> | 900 L/day <u>3mm</u> |
| Daily Effluent Flow (l/d) <u>Areal Loading Rate (l/m²/d)</u> <u>Design land application area</u> | 900 L/day <u>3mm</u> <u>300 m² (note 1)</u> |
| Design Disposal Area <u>Reserve land application area (50%)</u> | 300 m² (note 1) <u>150m²</u> |
| Reserve Disposal Area (50%) | 150m² |
| <u>Dimensions</u> | <u>Say 10m x 30m</u> |
| Linear Length of Line Required <u>Linear length of line required</u> (Lines at 1.0 metre centres) | <u>300 linear metres</u> |
| OR ALTERNATIVELY Linear Length of Line Required <u>Linear length of line required</u> (Lines at 0.5 metre centres) | <u>600 Linear</u> <u>linear metres</u> (note 2) |
| Notes: | |
| <ol style="list-style-type: none"> <u>Disposal Land application</u> areas exclude any setback requirements. The design <u>disposal and application</u> area must remain the same (300 m²) to achieve a 3 mm loading rate and therefore the length of line required is twice that for a 1.0 metre spacing. | |

6.3.6 PCDI Installation

Irrigation lines are generally installed at 0.3, 0.5 and 1.0 metre centres with the separation distance being dependent upon ~~depending on~~ the soil type. Closer spacings are applicable for slowly draining soils. Where installation is on steeper slopes a ~~where installation is on steeper slopes~~ wider line spacing may be required where installation is on steeper slopes. The designer should install ~~provide~~ the same total length of lines as for a 1.0 metre line separation, even where the line spacing is increased, as. This is because a reduced line length and reduced number of emitters can overload the soil adjacent to the emitters.

The flushing taps for manual flushed installations are to be marked by a permanent stake or toby box so as to allow easy identification for flushing maintenance.


6.3.7 Root Intrusion

Root intrusion via emitters is potentially a problem with aggressive vegetation such as Willow tree roots and Kikuyu grass. Recent developments in emitter design are claimed to prevent root intrusion. ~~There are products~~ Products available ~~including~~ include impregnated herbicide irrigation line or a herbicide dispenser located in-line following the discharge pump. There is still some argument on the scale of the problem and uncertainty ~~if over whether~~ root intrusion is actually a significant problem.

6.3.8 Maintenance

Maintenance requirements include regular flushing of the irrigation lines to remove any ~~solids~~ solids build-up that ~~can~~ may develop. Lines should also be inspected (surface or sub-surface) for emitter operation. Wet zones can indicate uneven loading resulting from emitter blockage or damaged lines.

Figure 6.1 Schematic of a ~~Sub-surface pressure Compensating~~ Pressure Compensating Dripper Land Application System

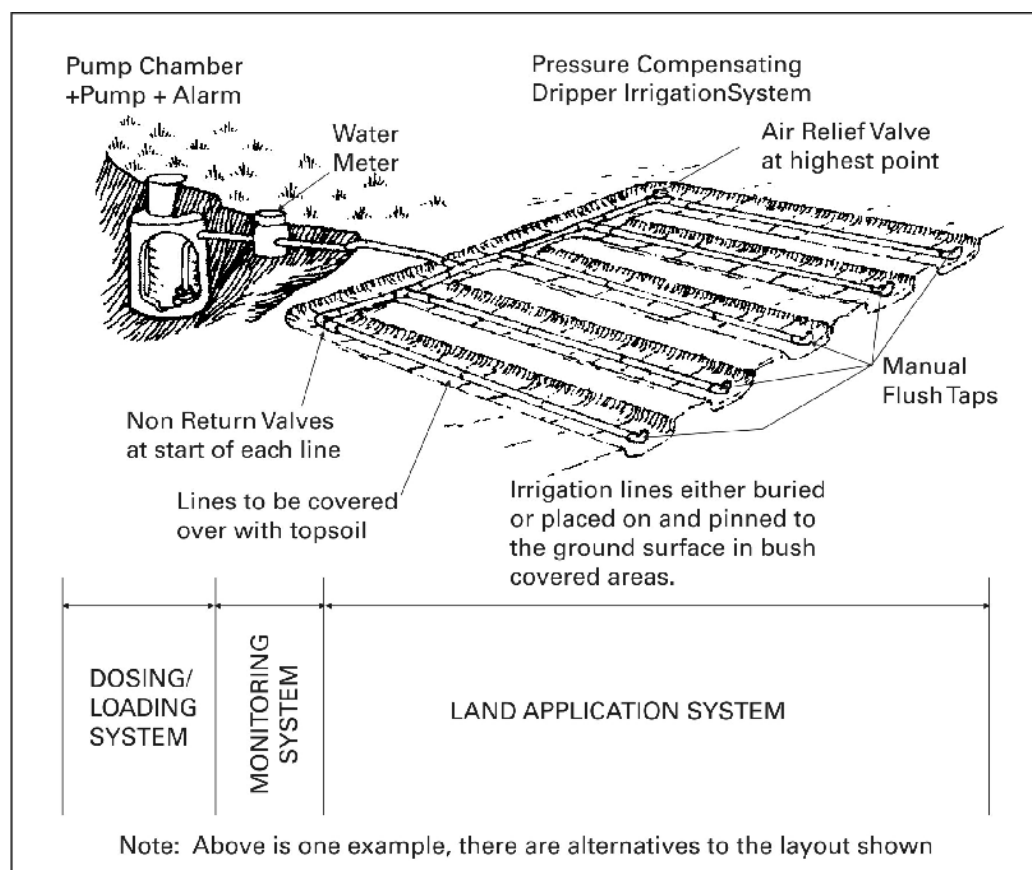

Source: Auckland Regional Council TP58 (2004).

6.3 Trench Systems

6.3.10 General

Trench land application systems are the conventional method for discharge of treated wastewater into the ground. The choice of the trench disposal system for any site is to be based on the results of the site assessment taking into account site environmental constraints identified by the site assessment. Trench disposal is better suited to larger blocks of land. The preferred land application method within the Region is pressure compensating dripper irrigation. No allowance has been made in the design basal loading rates for increased loading rates for secondary treated effluent.

6.3.9 Shallow Trenches and Low Pressure Effluent Distribution (LPED)

Shallow and narrow trench systems are 200 mm to 250 mm deep by 200 mm wide, backfilled with aggregate and including drilled uPVC pipe nested within slotted draincoil pipe or similar running the length of each trench to provide in-trench effluent distribution (Figure 6.2). The design theory is that side-wall soakage into the aerobic topsoil horizon is maximised by utilising to make use of the area between trenches and the evapotranspiration potential from plantings (Table 6.5). The disadvantage of shallow trench systems is that they only provide limited storage potential within the trench. Unless the trenches are installed in high quality organic topsoil being that is at least 250 mm in depth deep, or within category 1 to Category 1-3 soils, there is a risk of partially treated effluent breakout onto the ground surface. Extreme care is required with LPED systems discharging into dense and clay dominant soils, as the lateral and downward movement of effluent is restricted and slowed, potentially resulting in surface breakout.

The concept of LPED is can be somewhat confusing as it is both a distribution method within land application systems constructed in Category 1 to 3 soils (moderate to rapid draining soil) and is also a land application irrigation method utilising narrow shallow trenches and utilising the effective soakage area between trenches. Trenches are typically at 1.5 metre centres but it is recommended that the design areal loading rate only is recommended to be applied only to 1 metre and not to the entire 1.5 metres.

Although LPED shallow trench systems are installed in category Category 4 and 5 soils, it is recommended that pressure compensating dripper irrigation systems and at least secondary effluent treatment be installed in preference. The use of shallow trench systems is not highly recommended in category Category 4 or 5 soils due to the inherent risks with this system, unless there is no alternative.

Where LPED is used as a distribution method, the design area is to be based on the land application method employed, as. This is because LPED lines are only providing provide for even distribution along the full trench or bed length.

Primary or secondary treated effluent is discharged by pump or siphon to the distribution system comprising Low Pressure Effluent Distribution (LPED) slotted pipe running the entire length of each trench. Trenches are either aggregate or topsoil filled although there is some argument with the use of

~~topsoil preferably with aggregate.~~ Each LPED line comprises a ~~solid~~ PVC 25 ~~to~~ 30 mm central distribution line nested within slotted pipe or draincoil. Squirt holes ~~with drilled into~~ the central pipe are widely spaced, with the spacing calculated specifically for each installation. LPED laterals are dose loaded by pump or siphon via a main header line ~~including that has~~ specifically sized orifice plates at the start of each lateral to ensure equal loading of each lateral.

LPED systems require careful design and installation to operate effectively. Computer-aided design programmes are available to calculate the orifice plate diameter and squirt hole spacing, based on the length and elevation of each lateral, and it is important that all systems be designed accordingly.


Shallow trench LPED design is based on areal loading to utilise the area between trenches for assimilation of the irrigated effluent. Experience has indicated that unless there is an adequate depth (~~minimum~~ 250 mm) of topsoil with good drainage properties, there is a high risk of land application system failure. LPED is not effective within dense and clay soils as these limit lateral movement of irrigated effluent and potentially result in surface breakout. Extreme caution is required when designing these systems and it is recommended that only very conservative design areal loading rates are applied.

The recommended ~~area~~ areal loading rate for LPED is 3 ~~to~~ 5 mm per day, being the entire enclosing area within ~~category~~ Category 2 and 3 soils.

Pressure compensating dripper irrigation is recommended in preference to LPED methods.

Table 6.5 LPED Design Area Worked Example

| LPED DESIGN EXAMPLE | |
|--|--|
| Peak Daily Effluent Production <u>Peak daily effluent production</u> | 900 litres/ DAY day |
| Soil Category <u>category</u> | 4 |
| Areal Loading Rate <u>Areal loading rate</u> | 3 litres/square metre/day Or 3 mm/day |
| Daily Effluent Flow <u>effluent flow (l/d)</u> Areal Loading Rate <u>loading rate (l/m²/d)</u> | <u>900 L/day</u> 3 mm |
| Design Disposal Areal <u>land application area</u> (based on 1.0 metre effective area) | 300 m ² |
| Reserve Disposal Areal <u>land application area</u> | 300 m ² |
| Total Area Required <u>area required</u> (lines at 1.5m centres) | 450 m ² |
| Linear Length of Line Required <u>(Linear length of line required</u> (Lines at 1.0 metre centres) | 300 linear metres |

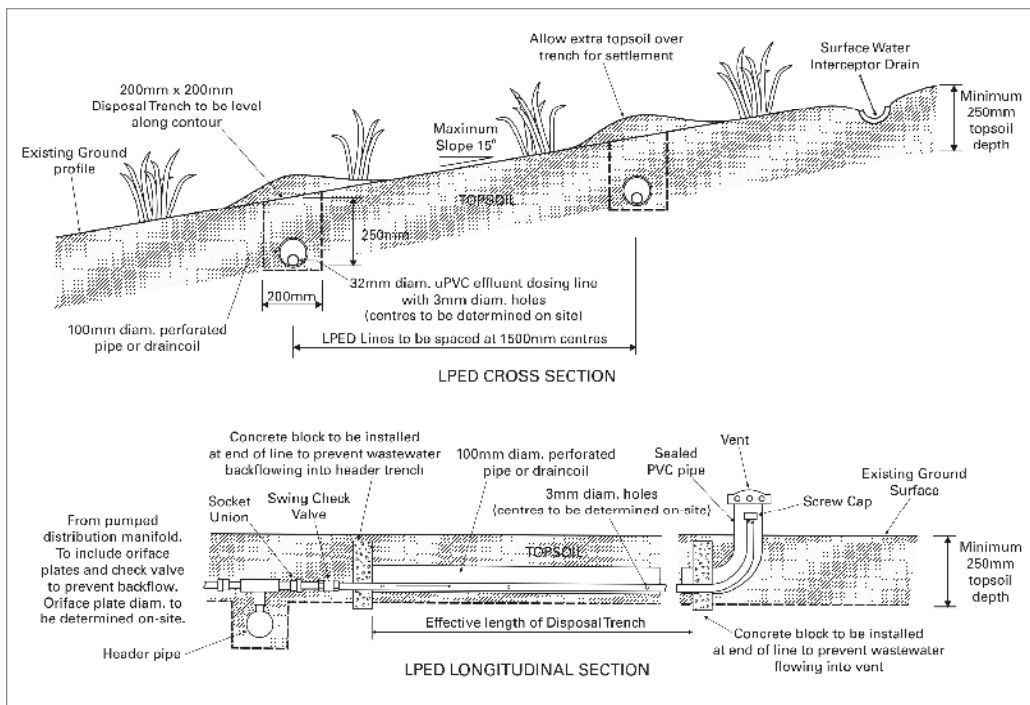Figure 6.2 Example of a Shallow LPED Land Application System

Note: Trenches can be backfilled with aggregate or topsoil but Horizons' preference is for aggregate backfill.

Source: Auckland Regional Council TP58 (2004).

6.4 Trench Systems

6.4.1 General

Trench land application systems are the conventional method for discharge of treated wastewater into the ground. The choice of the trench disposal system for any site is to be based on the results of the site assessment, taking into account site environmental constraints identified by the assessment. Trench disposal is better suited to larger blocks of land.

The preferred land application method within the Region is pressure compensating dripper irrigation (PCDI). No allowance has been made in the design basal loading rates for increased loading rates for secondary treated effluent.

6.4.2 Conventional Trenches

Conventional trenches are typically 450 mm in depth, backfilled with drainage aggregate and capped with topsoil (Figure 6.3). Effluent is distributed along the entire length of each trench by slotted pipe.

Conventional trench design is based on the bottom area of the trench only, which is termed 'basal loading'. Sidewall loading is not included in the design as this provides a safety factor in the design. The preferred method of

loading is by pumping, to ensure even distribution along the entire length of each trench. In any event, a maximum trench length of aroundabout 25 metres is recommended. Alternative loading methods include siphon dose loading where sufficient head difference is available between the treated effluent tank outlet and uppermost trench.

Trickle gravity loading is not recommended, as even distribution across the entire infiltrative surface cannot be guaranteed.

Designers should be aware that when the basal width of the trench exceeds the combined sidewall depth by more than 30%, the system design is to be based on conventional bed basal loading rates applicable for the soil type.


Recommended basal loading rates for each soil category are provided in Table 6.6. The table provides a “least conservative” and a “most conservative” loading rate for each soil category in which trench land application is appropriate. On-site wastewater system design is not an exact science and hence a range of loading rates is appropriate to accommodate specific site limiting conditions.

Table 6.6 Recommended Design Loading Rates ~~For~~ Conventional Trenches

| Soil Category | Soil Type | Basal Loading Rate mm/day | |
|---------------|--|---------------------------|-----------------------|
| | | Most Conservative | Least Conservative |
| 1 | Gravel, coarse sand – Rapid draining | 20 (Note 1) | 35 (Note 1) |
| 2 | Coarse to medium sand – Free draining | 20 | 30 |
| 3 | Medium fine and loamy sand – Good drainage | 20 | 30 |
| 4 | Sandy loam, loam and silt loam – Moderate drainage | 15 | 20 |
| 5 | Sandy clay/loam and silty clay loam – Slowly draining | 5 | 10 |
| 6 | Sandy clay, non-swelling clay and silty clay – Slowly draining | Trenches not suitable | Trenches not suitable |
| 7 | Swelling clay, grey clay, hard pan – Poorly or non draining | Trenches not suitable | Trenches not suitable |

Note:
 1. Special design considerations are required for effluent discharge into rapid draining soils.

Figure 6.3 Typical Conventional Trench Detail

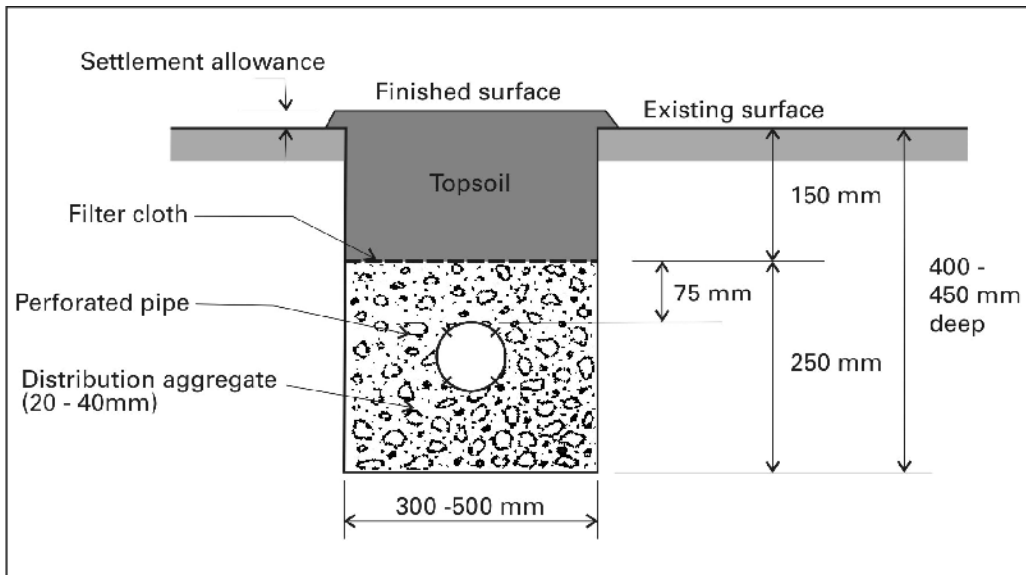

Source: Auckland Regional Council TP58 (2004).

Table 6.7 Conventional Trench Design Example

| CONVENTIONAL TRENCH DESIGN EXAMPLE | |
|---|--|
| Peak Daily Effluent Production <u>Peak daily effluent production</u> | 900 litres/ DAY <u>day</u> |
| Soil Category <u>category</u> | 4 |
| Sidewall Loading Rate <u>loading rate</u> | 15 litres/square metre/day OR 15 mm/day |
| Daily Effluent Flow <u>effluent flow (l/d)</u> Basal Loading Rate <u>loading rate (l/m²/d)</u> | <u>900 L/day</u> <u>15 l/m²/d</u> |
| Design Basal Disposal Area <u>Design basal land application area</u> | = 60 m ² |
| Trench Width <u>width (metres)</u> Trench Separation <u>separation (metres)</u> | <u>0.5 metres</u> <u>5 m</u> 1.5 metres edge to edge (2.0 m centres) |
| Total Trench Length Required <u>Total trench length required</u> Basal Area Required <u>area required (m²)</u> Trench Width <u>width (m)</u> | = <u>60 metres²</u> <u>0.5 metres</u> = <u>120 metres Total Length</u> <u>= 120 m total length</u> |
| Total Trench Length Required <u>Total trench length required</u> Say say | 5 trenches x 24 metres long at 2.0 m centres |
| Total Enclosing Area Required <u>Total enclosing area required</u> Trench Separation <u>separation</u> Total enclosing area (excludes area beyond outer trenches) | 2.0 metre centres [4 spaces (between 5 trenches) x 2.0 m + 2 x 0.25 m for half of each outside trench width not accounted for = 8.5 m x 24 m] Enclosing <u>Area</u> = 204 m ² |
| Reserve Basal Disposal Area <u>basal land application area (min 100%)</u> | 204 m ² |

6.5 Beds

6.5.1 Conventional Beds

Beds are the second best alternative to trenches and are only applicable where site topography and site constraints limit trench installation. The design basal loading rate for beds is less than trenches, to account for the reduced sidewall area available for ~~–~~treated effluent lateral infiltration. Bed land application methods should only be applied to ~~category~~Category 1 ~~to~~ 4 soils. Recommended design basal loading rates are provided in Table 6.8.

The design area for conventional bed is based on basal loading. The following design criteria are recommended:

- i. There is at least 1.55 metres separation edge to edge.
- ii. The maximum width to be 4.0 metres.
- iii. The maximum length to be about 20 metres.
- iv. Beds to be dose loaded by pump or siphon.
- v. Multiple distribution lines to be included where beds are more than 1.55 metres in width.
- vi. 100% reserve area required.

Table 6.8 Recommended Design Loading Rates ~~For~~for Conventional Beds

| Soil Category | Soil Type | Basal Loading Rate mm/day | |
|---------------|---|------------------------------|-----------------------|
| | | Most Conservative | Least Conservative |
| 1 | Gravel, coarse sand – Rapid draining | 20 (note 1) | 30 (note 1) |
| 2 | Coarse to medium sand – Free draining | 20 | 30 |
| 3 | Medium fine and loamy sand – Good drainage | 15 | 20 |
| 4 | Sandy loam, loam and silt loam – Moderate drainage | 10 | 15 |
| 5 | Sandy clay/loam and silty clay loam – Slowly draining | Beds not suitable | Beds not suitable |
| 6 | Sandy clay, non-swelling clay and silty clay – Slowly draining | Beds not suitable | Beds not suitable |
| 7 | Swelling clay, grey clay, hard pan – Poorly or non draining | Beds not suitable | Beds not suitable |

Notes:
1. Special design considerations are required for effluent discharge into rapid draining soils.

Table 6.9 Conventional Bed Design Example

| CONVENTIONAL BED DESIGN EXAMPLE | |
|---|---|
| Peak Daily Effluent Production <u>Peak daily effluent production</u> | 900 litres/day |
| Soil Category <u>category</u> | 3 |
| Basal Loading Rate <u>Basal loading rate</u> | 20 litres/square metre/day OR 20 mm/day |
| Daily Effluent Flow <u>effluent flow (l/d)</u> | 900 L/day |
| Sidewall Loading Rate <u>loading rate (l/m²/d)</u> | 20 l/m ² /d |
| Design Total Sidewall Area <u>total sidewall area (m²)</u> | = 45 m ² |
| Bed Width <u>width (m)</u> | 1.5 metres |
| Total Bed Length Required <u>Total bed length required</u> | <u>45 metres²m²</u> |
| Basal Area Required <u>area required (m²)</u> | 1.5 metres |
| Infiltration Area <u>area/linear Metre</u> (m) | = 30 metres <u>Total Length = 30 m total length</u> |
| Total Bed Length Required <u>Total bed length required</u> Say | 2 Beds <u>beds</u> x 15 metres long x 1.5 metres wide and 2.0 metres edge to edge |
| Total Enclosing Area <u>Total enclosing area</u> | 75 m ² |
| Reserve Area Required <u>area required</u> | 75 m ² |

6.5.2 Evapotranspiration (ETS) Beds ~~(ETS Beds)~~

ETS beds are for use on sites underlain by ~~category~~Category 5 or 6 soils ~~and~~. They operate on seepage into the soil and evapotranspiration provided by surface vegetation cover. Beds are mounded to promote surface water runoff and minimise rainfall infiltration. Designers must ensure surface water flow is diverted away from the bed. Design basal loading rates are provided in Table 6.10 and a typical ETS bed detail in Figure 6.5.

ETS bed design sizing is based on basal loading but includes an allowance for evapotranspiration. The design theory is that the beds may fill during winter when evapotranspiration rates are low, at which time they operate by sidewall and basal seepage alone. The design “areal” loading rate (being the design area plus natural soil between adjacent beds) should not exceed ~~3~~ 3 mm/day for primary treated effluent and ~~5–5~~ mm per day for secondary treated effluent. The designer is reminded that lateral seepage of effluent will be restricted by dense soil, requiring a conservative basal loading rate.

Recommended design criteria

- i. Minimum topsoil depth of 250 mm required.
- ii. Minimum treatment by septic tank ~~including~~that includes an effluent outlet filter.
- iii. Effluent to be dose loaded by pump or siphon.
- iv. The maximum bed length to be about 20 metres
- v. Surface water diversion drains to be installed.
- vi. A minimum of two beds to be installed.
- vii. 100% reserve area to be set aside.
- viii. Multiple distribution lines to be included where beds are more than ~~1.5~~ 5 metres in width.
- ix. Maximum width to be 4.0 metres.
- x. Minimum separation distance between bed edges to be 1.5 metres.

Table 6.10 Recommended Design Loading Rates ~~For~~ ETS ~~beds~~ Beds

| Soil Category | ETS Basal Loading Rate (mm/day) |
|---------------|---------------------------------|
| 1 | Note 1 |
| 2 | Notes 1 and 2 |
| 3 | Note 1 and 2 |
| 4 | 12 |
| 5 | 8 to 10 |
| 6 | 5 |
| 7 | Note 1 |


Notes:

- ETS systems are not normally used in Category 1 ~~to~~ 3 soils and are never used in Category 7 soils.
- Should ETS beds be used in Category 2 or 3 soils, the basal loading rates for conventional beds are to be applied.

Table 6.11 ETS Design Example

| EVAPOTRANSPIRATION SEEPAGE BED DESIGN EXAMPLE | |
|--|---|
| Peak Daily Effluent Production Peak daily effluent production | 900 litres/day |
| Soil Category category | 5 |
| Basal Loading Rate Basal loading rate | 8 litres/square metre/day OR 8 mm/day |
| Daily Effluent Flow effluent flow (l/d) Basal Loading Rate/loading rate (l/m ² /d) | 900 L/day 8 l/m ² /d |
| Design Total Basal Area/total basal area (m ²) | = 112.5 m ² |
| Bed Width/width (m) | 1.5 metres |
| Total Bed Length Required Total bed length required Basal Area Required/area required (m ²) Bed Width/width (m) | $\frac{112.5 \text{ metres}^2}{1.5 \text{ metres}}$ = 75 metres Total Length |
| Total Bed Length Required Total bed length required Say say | = 75 m total length 4 Beds/beds x 19 metres long x 1.5 metres wide |

Figure 6.5 Typical Evapotranspiration Seepage Bed Detail

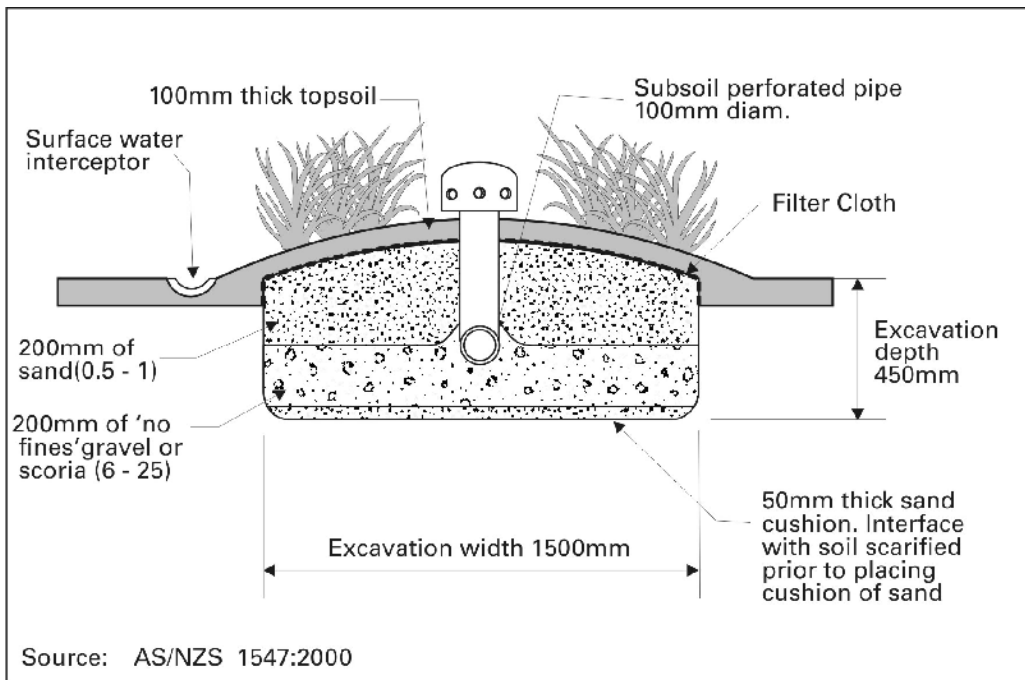

Note: Filter cloth is not mandatory.
Source: TP58 (2004)

6.6 Bottomless Intermittent Sand Filters

Bottomless intermittent sand filters are sand filters which that are not lined, thus allowing treated effluent to discharge from the base into the underlying Category 1 or 2 soils. The pre-treatment, design and construction of bottomless sand filters is to be the same for as intermittent sand filters. Wastewater is to be timer dose loaded onto the surface of the sand filter. Flood loading is unacceptable as this does not ensure even distribution across the entire sand filter surface.

Recommended sand filter basal loading rates are presented in Table 6.12 below.

Bottomless intermittent sand filters and rapid infiltration systems are not encouraged by Horizons.

Table 6.12 Recommended Design Loading Rates For for Bottomless Intermittent Sand Filters

| Soil Category | IBSF Basal Loading Rate (mm/day) |
|---------------|----------------------------------|
| 1 | 50 to 70 |
| 2 | 35 to 50 |
| 3 | Not suitable |
| 4 | Not suitable |
| 5 | Not suitable |

| | |
|---|--------------|
| 6 | Not suitable |
| 7 | Not suitable |

A 50 mm depth of distribution aggregate should be placed between the natural soil and base of the bottomless sand filter to act as a distribution layer.

Table 6.13 Bottomless Sand Filter Design Example

| BOTTOMLESS INTERMITTENT SAND FILTER DESIGN EXAMPLE | |
|---|---|
| Peak Daily Effluent Production <u>daily effluent production</u> | 900 litres/day |
| Soil Category <u>category</u> | 2 |
| Basal Loading Rate <u>Basal loading rate</u> | 50 litres/square metre/day OR 8 mm/day |
| Daily Effluent Flow <u>effluent flow (l/d)</u> Basal Loading Rate <u>loading rate</u> (l/m ² /d) | <u>900 L/day</u> <u>50 l/m²/d</u> |
| Design Total Basal Area <u>total basal</u> <u>area (m²)</u> | = 18 m ² |
| Dimensions say | 4.25 m x 4.25 m |

6.7 Wisconsin Mounds

Wisconsin ~~Mound~~mound land application systems are appropriate for construction on slopes of less than ~~14°~~which 11 degrees that have ~~450 mm to 600 mm~~ of unsaturated topsoil and subsoil overlying a limiting horizon or elevated groundwater table. Construction of mounds on steep slopes (greater than 11 degrees) increases the risk of breakout along the downslope toe and is not recommended.

Wisconsin ~~Mounds~~mounds are constructed of graded sand fill, and provide additional renovation of effluent before discharge into the underlying natural soils. The minimum effluent standard for discharge to a Wisconsin ~~Mound~~mound is by 4,500 litre primary septic tank ~~including that includes~~ an effluent outlet filter. Prior to construction of a Wisconsin ~~Mound~~mound, the natural soils are to be ploughed to allow effluent to infiltrate the natural ground.

On flat sites mounds can be constructed as ~~a rectangle~~rectangles but on steeper sites they should be as long and narrow as possible along the contour to minimise toe loading. The downslope side of the Wisconsin mound should be extended by design of a toe extending downslope to allow for assimilation of treated effluent moving in the downslope direction. Effluent must be dose loaded by pumping into the mound distribution bed and spread across the entire infiltration surface.

TP58 (2004) provides detailed design guidance and a worked example from the ~~Horizons Regional Council~~ Horizons' Model Design 6 is included below.

AS/~~NZSNZS~~ 1547:2000 provides guidance for construction and installation (section 4.5B).

6.7.1 Wisconsin Mound Model Design

Model Design 6 – Shallow Moderate to Slow Draining Soils above Hardpan or Shallow Groundwater Improved Septic Tank and Sand Filled Mound (Wisconsin Mound) (source: Horizons Regional Council, 2000).



This ~~Model Design~~ model design provides for in-mound treatment of septic tank effluent before it disperses into the shallow soil layer above clay hardpan or high water table. Some 300 mm or original soil depth is required.

| Model Design For 3 Bedroom Dwelling | |
|-------------------------------------|--|
| • | 3 Bedrooms |
| • | <u>3 bedrooms</u> |
| • | 5 person occupancy |
| • | Roof water collection |
| • | Per capita flow allowance 140 l/p/d |
| • | Daily wastewater production 700 litres |



Treatment Unit and Land Application Area Layout

Details for flat site:

System and Mound Details (details for a flat site)

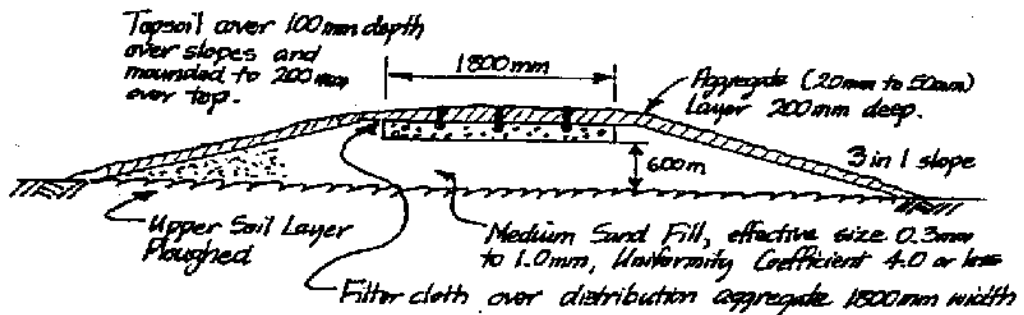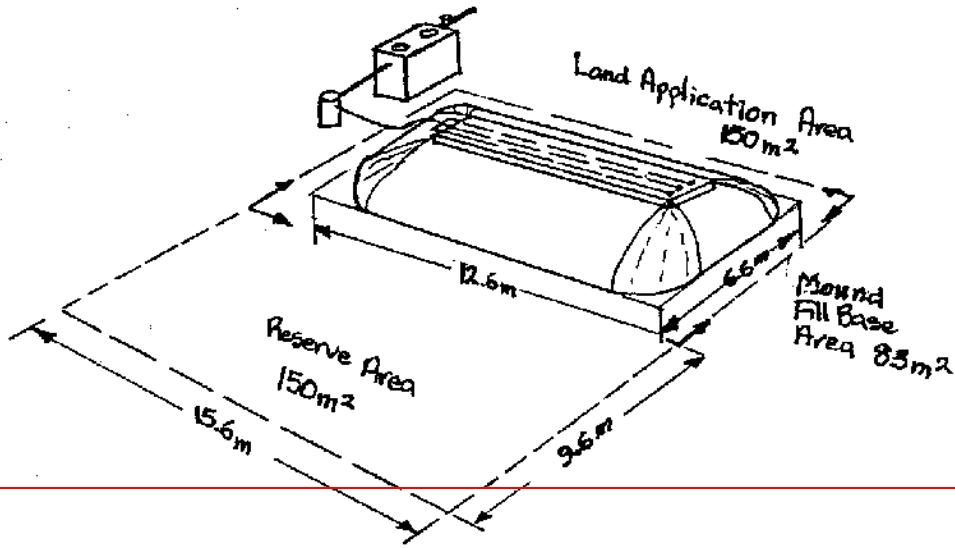

NOTES

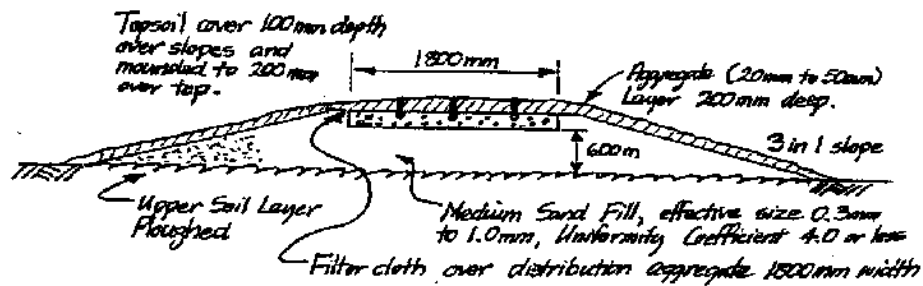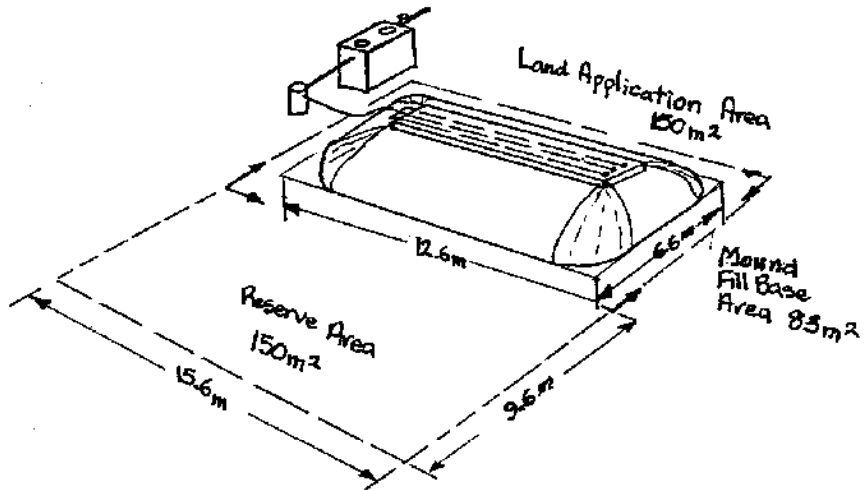

Notes on Functionfunction

1. The 50 mm/day loading rate dosed into the aggregate distribution bed allows the septic tank effluent to spread sideways by capillary action while seeping slowly through the 600 mm of treatment sand.
2. The resulting high quality effluent spreads into the natural soil and seeps sideways through the soil evenly around the edges of the mound.

Sizing the System to Suit your Soil Type

| Soil Conditions | Design Loading Rate | Dosing Lines Length | Number of Lines | Treatment, Basal and Land Application Areas | Reserve Area (100%) |
|--|--|---------------------|---|--|--|
| Shallow moderate to slow draining soil over hardpan or shallow groundwater | 12 mm/day basal area 50 mm/day into aggregate distribution bed. | 7.8 m | 3 of 30 mm diameter perforated lines in an 1,800 mm distribution bed | Internal treatment area 5.5 m Fill basal area 6.6 m by 12.6 m (83 sq.m ²) Land application overall area (1.5 m buffer) 9.6 m by 15.6 m, total 150 sq.m | Length 15.6 m Width 9.6 m Area 150 sq.m ² |
| Notes: 1. 1 mm/day is equivalent to one 1 litre of effluent spread over a one 1 metre square/day. 2. The 30mm diameter perforated low pressure dosing lines have shielded perforation holes and end elbow pieces with a capped riser at top of mound level (as for LPED, Model 1B dosing lines). | | | | | |

Adapting the System for your Household Size

| Household Size | System Details | Basal and Land Application Area Size |
|---|---|---|
| Dwelling: <ul style="list-style-type: none"> Two Bedroom Maximum of 4 persons Using water conservation fixtures Daily effluent volume of 450 litres/day Septic Tank Capacity: 3,000 litres | 3 lines in 1,200 mm wide distribution bed, 7.5 m length | Basal length 12 m, width 6.6 m and overall enclosing area 15 m by 9 m, area 135 sq.m ² |
| Dwelling: <ul style="list-style-type: none"> Five Bedroom Maximum 8 persons 1,120 litres/day Septic Tank Capacity: 4,500 litres | 3 lines in 1,800 mm wide distribution bed 12.4 m length | Basal length 17.2 m, width 6.6 m and overall enclosing area 20.2 m by 9.6 m, area 195 sq.m ² |

| Materials Requirement for Basic Household System | Quantity |
|--|------------------------|
| 1. Length of 30 mm distribution line | 24 m |
| 2. Distribution Aggregate aggregate | 3 cu.m ³ |
| 3. Filter cloth | 14 sq.m ² |
| 4. Medium sand fill | 31 cu.m ³ |
| 5. Topsoil cover | 11.5 cu.m ³ |

Design Notes

- ~~i.~~ 1. For a different number of household residents, calculate total daily wastewater effluent output at 140 litres/person/day for rainwater supply, and 180 litres/per/day for bore water or community supply.

- ii. ~~2.~~ 2.—To find the mound basal area, divide total daily wastewater output in litres by design loading rate in mm/day. Then allow 600 mm all round for the 3 to 1 slope effect of the 200 mm distribution bed.
- iii. ~~3.~~ 3.—Find the overall enclosing area requirement by allowing ~~1- $\frac{1}{2}$~~ 1.5 m clearance on either side of the design area (as a buffer), and ~~1- $\frac{1}{2}$~~ 1.5 m clearance at each end of the mound.

Pumping Requirements

The pump sump to provide storage and pumping cycle provisions to be designed to fit the total daily flow through the selected orifice size and spacing.

Installation Notes

- i. ~~1.~~ 1.—Groundwater or hardpan to be at least 300 mm below the base of the mound.
- ii. ~~2.~~ 2.—The natural soil on which the mound is to be placed should be ploughed or disc ploughed prior to laying the medium sand fill.
- iii. ~~3.~~ 3.—During installation, the dosing system should be pump tested with clean water to ensure even distribution is being achieved.

6.8 Land Application Method and Soil Category

Table 6.14 provides a quick reference to allow designers to match a land application method with a soil category when assessing the options available for an on-site land application system design. The designer is reminded that unless a secondary or better wastewater water treatment system plus pressure compensating dripper irrigation land application is installed, it will be necessary to apply to Horizons ~~Regional Council~~ for a wastewater discharge consent.

6.9 Reserve ~~Disposal~~Land Application Area Requirements

All on-site land application systems are to include a reserve land application area to be set aside for future use in the event the disposal primary area does not perform to design, or wastewater production exceeds design. Minimum reserve area requirements are set out in Table 2.3.

Table 6.14 Summary Soil Category and Land Application System Compatibility

| LAND APPLICATION SYSTEM TYPE | SOIL CATEGORY | | | | | | |
|---|---|--|--|--|---|--|---|
| | 1 Gravel Coarse Sand Rapid draining | 2 Coarse to Medium Sand Free Draining | 3 Medium Fine and Loamy Sand Good Drainage | 4 Sandy Loam and Silt Loam Moderate Drainage | 5 Sandy Clay Loam Clay Loam Mod to Slow Drainage | 6 Non-swelling Clay and Silty Clay Slowly Draining | 7 Swelling Clay Poorly or Non draining |
| Pressure Compensating Drip Irrigation Pressure compensating drip irrigation (PCDI) | Note 1 | Note 1 | Note 1 | | | Note 2 | Note 2 |
| LPED Shallow Trenches LPED shallow trenches | Note 3 | Note 3 | Note 3 | | | | |
| Discharge Control Trench control trench | | | | | | | |
| Conventional Trenches trenches | Note 4 | | | | | | |
| Conventional Beds beds | Note 4 | | | | | | |
| ETS Beds beds | | | | | | | |
| Wisconsin Mounds mounds | | | | | | | |
| Bottomless Sand Filters sand filter | | | | | | | |
| Notes: 1. PCDI becomes can also be used as an effluent distribution method within a land application system in these bed or trench for soils that have good to rapid drainage (Category 1-3). In the case of bed or trench systems the loading rate is to be calculated on basal rather than areal loading. 2. Specific design required within Category 6 and 7 soils and where there is limited topsoil depth. 3. LPED becomes a distribution method within Category 1 to 3 soils. 4. Special design considerations required in category Category 1 soils. | | | | | | | |

Source: Auckland Regional Council TP58 (2004) with minor modifications.

7. MAINTENANCE AND MANAGEMENT

7.1 Management Plan

The system supplier/installer should provide the system owner with a management plan ~~with~~that provides guidance on action to be taken in the event of an alarm sounding or other system malfunction. The plan should also include all contact details for the supplier, electrician, installer and maintenance provider.

7.2 Maintenance Contract

All on-site and decentralised wastewater treatment and land application systems require regular monitoring and maintenance to ensure ongoing optimum performance. The Regional Rules for ~~permitted activities requires~~ that Permitted Activities require all new systems ~~are required~~ to have an operative maintenance contract with the installer, system supplier or suitably qualified and experienced service provider.

The frequency of maintenance inspections ~~is dependent upon~~ depends on the system type but should be completed at ~~not more than~~ least six monthly ~~intervals~~. The maintenance contract should clearly list all items that are specific to the individual systems that will be ~~undertaken~~ inspected during the site visit. Inspections should include a visual appraisal of both the treatment system and land application system, ~~and not~~ noting any evidence of breakout or effluent pooling for rectification, and operation of pumps and alarms where installed. Comment on recent weather/rainfall is also useful to assist in the assessment of the land application system.

A copy of the signed maintenance contract is to be provided to the relevant Territorial Authority.

7.3 Owner Education

It is critical that the wastewater system owners understand their role in the successful operation and performance of an on-site system. Performance of a wastewater treatment system and land application system is greatly affected by the ~~owner's~~ owners' water use management. For example, the average washing machine wastewater production is 22% of the daily total. However, daily wastewater production derived from clothes washing can be significantly higher where all the use is on one or two days over a weekend. This can result in overloading of the treatment and land application system unless there is adequate buffering in the system. It is critical that the homeowner understands the implications of concentrated use of high water consumption appliances over a short time period, and that such use is moderated.

The owner is also responsible for maintaining vegetation within the wastewater disposal area and ensuring surface water diversion drains are clear and able to operate effectively.

7.4 Operation, Maintenance and Management

A brief summary of minimum requirements for development of a maintenance manual is provided below. Horizons strongly supports owner education to ensure that the owner is aware that all wastewater management is undertaken on-site. Owner education can be initiated by the Territorial Authority LIM report at the time of purchase, which should advise that the site is serviced by an on-site wastewater management system. Owner awareness is critical to the success of any on-site system and the owner must take responsibility for ensuring it is operated and maintained correctly, and does not cause nuisance or risk to public health or the environment. Horizons appreciates that homeowners do not have all the necessary skills for maintenance of an on-site system and to this end requires owners of all new on-site systems to have a current signed maintenance contract with the system supplier, installer or trained maintenance provider. A summary of the critical maintenance requirements of on-site systems is provided below. Modern on-site systems require the maintenance provider to have been trained in the operation, management and maintenance of system. Designers/system manufacturers/installers should supply an Operation and Maintenance Manual specific to the wastewater management system installed on the property. The operation and maintenance manual should include but not be limited to:

- i. The system specifications.
- ii. Maximum daily wastewater treatment capacity in litres and dwelling occupancy numbers.
- iii. As-built showing the location of all system components.
- iv. Contact details for the designer and service providers (drainlayer, electrician, council).
- v. Any water conservation measures installed in the dwelling.
- vi. A list of do's and don'ts for the householder that includes materials that are not suitable for discharge into the system.
- vii. Discussion on water use management and impact from overloading the wastewater system.
- viii. Maintenance frequency and items requiring checking at each maintenance milestone.

System operation, management and maintenance includes:

- i. The dwelling's wastewater producing facilities.
- ii. Wastewater collection system.
- iii. Wastewater treatment system.
- iv. Wastewater delivery system (pipes).
- v. Wastewater land application system.
- vi. Land application area vegetation.
- vii. System monitoring equipment.

7.4.1 Wastewater Production Facilities

All sources of wastewater within the dwelling or institution require ongoing maintenance to ensure wastewater production is minimised:

- i. Check that taps/shower roses are not dripping;

- ii. Check that cisterns are not leaking

7.4.1.1 Wastewater Collection System

Stormwater can enter the wastewater collection system (sewer pipes) and potentially result in failure of part or all of the wastewater treatment and land application system.

- i. Ensure that no roof water downpipes discharge stormwater into sewer gully traps.
- ii. Ensure that gully traps are proud of ground level to prevent surface water flow into the sewer.
- iii. Repair any damaged gully traps.

7.4.1.2 Wastewater Treatment System

The wastewater treatment system is a critical component and requires regular maintenance.

7.4.1.3 Existing Treatment Systems

Septic Tanks

- i. Inspect all lids and vents to ensure no surface water can access the tank.
- ii. Ensure all lids are watertight.
- iii. Ensure all vents are undamaged and in place.
- iv. Regularly desludge the septic tank (at least every three years or when the combined depth of sludge and scum occupies 50% of the tank volume/depth).
- v. Inspect the effluent outlet filter (if installed) at least once every three months and clean as necessary.
- vi. Check high water level/low water level alarm operation.
- vii. Ensure the discharge pump (where fitted) is operating effectively.
- viii. Ensure the dosing siphon (where fitted) is operating effectively and not continuously trickle discharging.
- ix. Ensure vehicles cannot drive over the tank.

Existing Secondary Treatment Systems

- i. Owners of all secondary or advanced secondary treatment systems require a current maintenance contract with the system supplier/installer or experience maintenance provider. The systems are to be inspected at least once every six months.
- ii. Ensure vehicles cannot drive over the tank.

7.4.1.4 Existing Discharge Systems

The discharge system includes all pipe work from the treatment system to the land application area.

- i. Ensure all pipes to the land application area are undamaged.
- ii. Ensure any distribution boxes are water tight, lids are securely fitted and the top is proud of ground level to exclude stormwater.

7.4.1.5 Existing Land Application System

Beds and trenches

- i. Maintain vegetation cover (mow grass, prevent rank overgrowth, trim larger vegetation).
- ii. Ensure large vegetation roots are not blocking distribution pipe work.
- iii. Keep stock and vehicles clear of the area.
- iv. Ensure all vents are intact and in place.
- v. Clear all upslope surface water diversion drains and ensure there is no discharge onto the land application area.
- vi. Make a visual check for any wet areas that could indicate system failure or a pipe blockage.
- vii. Ensure vehicles cannot drive over the area.
- viii. Ensure all stock are excluded from the area.

7.4.1.6 Existing Pressure Compensating Dripper Irrigation Systems

- i. Maintain vegetation cover (mow grass, prevent rank overgrowth, trim larger vegetation).
- ii. Keep stock and vehicles clear of the area.
- iii. Ensure all vents are intact and in place.
- iv. Clear all upslope surface water diversion drains and ensure there is no discharge onto the land application area.
- v. Make a visual check for wet areas that could indicate system failure or a pipe blockage.
- vi. Flush irrigation laterals at least every six months and preferably every three months.
- vii. Check that all laterals are connected to the rising main.
- viii. Check all valves are operating.
- ix. Check pressure within the system when operating.
- x. Check for wet areas that may indicate line breakage/damage, system failure, and stormwater run-on.
- xi. Ensure vehicles cannot drive over the area.
- xii. Ensure all stock are excluded from the area.

7.4.2 Wastewater System Automatic Monitoring Equipment

Modern secondary and advanced secondary systems, and existing older systems include pumps either within the treatment process or/and for pressure discharge of treated effluent to the land application system.

Any pump chamber must include a high and low water level alarm. Alarm operation requires regular checking to ensure warning is provided in the event of a pump failing or other failure resulting in a high water level.

7.4.3 New Systems

All owners of new on-site wastewater treatment systems and land application systems are required to have an operative signed maintenance contract with

the system installer, manufacturer or suitably qualified maintenance provider.
All systems are to be checked at least once every six months.

7.4.4 Alternative Systems

All owners of new on-site wastewater treatment systems and land application systems are required to have an operative signed maintenance contract with the system installer, manufacturer or suitably qualified maintenance provider. All systems are to be checked at least once every six months.

7.4.5 Consequences of Inadequate Maintenance

7.4.5.2 In-house Components

- i. Leaking taps result in excess water production and potential overloading, and failure of the treatment and land application systems.

7.4.5.3 Gully Traps and Sewer lines

- i. Failure of the treatment and land disposal system.
- ii. Overflow and potential direct contact with partially treated effluent.

7.4.5.4 Treatment System

- i. System failure resulting in inadequate treatment.
- ii. Generation of foul odours.
- iii. Overflow of partially treated effluent from the system creating risk of direct contact.
- iv. Public health and environmental risks.
- v. Impacts on surface water and beaches.

7.4.5.5 Land Application System

- i. Soil saturation.
- ii. Generation of foul odours.
- iii. Pooling/ponding of partially treated effluent on the ground surface.
- iv. Cross boundary flow.
- v. Public health and environmental impacts.

8. ASSESSMENT OF EFFECTS ON THE ENVIRONMENT

An assessment of potential effects on the environmental ~~(AEE)~~ from the proposed land application of wastewater is an essential part of every site assessment. Site assessment requirements are described in Section 2 of this document. The section also includes guidance on minimum separation distance requirements that can be used to support the proposal and ~~assessment~~Assessment of ~~environmental—effects~~Environmental Effects ~~(AEE)~~.

The AEE should at a minimum include the following:

- i. The anticipated treated effluent quality.
- ii. Water conservation measures included in the dwelling.
- iii. Impact on surface water (note the separation distance provided in the design).
- iv. Impact on groundwater (note the separation distance between the base of the land application system and highest seasonal groundwater level).
- v. Flood risk (disposal system to be above the 1:20 year flood (5%) level). A flood risk assessment may not be required for all proposed systems and Horizons may have existing flood risk information available.
- vi. Impact on soils (based on disposal system loading rate and proposed disposal method).
- vii. Impact on vegetation.
- viii. Presence of any historical sites.

More comprehensive assessment will be required for larger discharge volumes or in areas havingwith a sensitive environment.

Additional details for assessment of environmental effects are available in ARC TP58 (2004) section 11.0.

10.7. REFERENCES

Auckland Regional Council Technical Publication 58 (TP58) ~~“On-Site Wastewater Systems Design and Management Manual” (2004).~~

Crites R. and Tchobanoglous G. (1998) Small and Decentralised Wastewater Management Systems. McGraw-Hill, Boston, Maine, USA.

Horizons Regional Council (2000) On-Site Wastewater System Guidelines for the Manawatu-Wanganui Region.

Standards Australia/Standards New Zealand (2000) Australian/New Zealand Standard “On-site Domestic Wastewater Management” AS/NZS 1547:2000. Wellington, New Zealand.

United States Environmental Protection Agency (USEPA) (2002) “Onsite Wastewater Treatment Systems Manual”.

~~11. APPENDICES~~

~~Glossary of Terms~~

APPENDIX 1
GLOSSARY OF TERMS

| | |
|---|--|
| Absorption | The process by which one substance is taken into and included within another substance, such as the absorption/uptake of water/effluent by soil or of nutrients by plants. |
| Activated sludge process | A biological wastewater treatment process by which biologically active sludge (concentrated biomass) is agitated and aerated with incoming wastewater. The activated sludge is subsequently separated from the treated wastewater (mixed liquor) by sedimentation, and most of it is returned to the process. The rest is wasted as needed. |
| Adsorption | The physical or chemical attachment of substances to the surface of soil particles. |
| Advanced Secondary Treatment | Aerobic biological treatment process, including settling and/or filtering of wastewater. Secondary treated wastewater is expected to be equal to or better than 15 g/m ³ 5 five-day biochemical oxygen demand and 15 g/m ³ suspended solids. (This is for the purpose of land application. Higher quality, such as 10 gO/m ³ and 10 g/m ³ respectively or better, may be required where discharge is into water). Systems that can provide advanced secondary treatment are predominantly sand filters, advanced textile filters and packed bed reactors. Some high performing, stabilised and closely monitored aerobic treatment plants (refer AWTS) can also achieve the same discharge quality. |
| Aerobic | Having molecular oxygen as part of the environment, or growing or occurring only in the presence of molecular oxygen (as in "aerobic organisms"). |
| Aerated wastewater treatment plant/system (AWTP or AWTS) | A mechanical on-site treatment unit that provides secondary (biological) wastewater treatment by mixing air (oxygen) and aerobic and facultative microbes with the wastewater, followed by clarification. AWTSs AWTS systems typically use a suspended growth treatment process (similar to activated sludge extended aeration), but can also involve a fixed film (air vented fixed media) biological filtration treatment process, similar to trickling filter. These are also referred to as home aeration plants or household package plants. |
| All-waste | The combined blackwater and greywater flow from a dwelling or premise that is generating domestic waste. |
| Ammonia (NH₄) | Un-oxidised form of nitrogen; toxic to aquatic life at elevated concentrations. |
| Anaerobic | Characterised by the absence of molecular oxygen, or growing in the absence of molecular oxygen (as in "anaerobic bacteria"). |
| Biochemical Oxygen Demand | A commonly used gross measurement of the |

| | |
|---|---|
| (BOD) | concentration of biodegradable organic impurities in wastewater. The amount of oxygen, expressed in milligrams per litre (mg/L), required by bacteria while stabilizing <u>stabilising</u> , digesting, or treating organic matter under aerobic conditions is determined by the availability of material in the wastewater to be used as biological food and the amount of oxygen used by the micro-organisms during oxidation. |
| Biomat | The layer of biological growth and inorganic residue that develops at the wastewater-soil interface and extends up to about 25 mm into the soil matrix. The biomat controls the rate at which pre-treated wastewater moves through the infiltrative surface/zone for coarse to medium textured soils. This growth may not control fluxes through fine clay soils, which are more restrictive to wastewater flows than the biomat. |
| Blackwater | Liquid and solid human body waste and the carriage waters generated through toilet usage. |
| Best Practicable Option (BPO) | The best —option for wastewater servicing and/or treatment and/or disposal that best meets public health, environmental and economic objectives. |
| Building Consent<u>consent</u> | A permit issued or authorised by the regulatory authority that allows the installation of wastewater treatment system in accordance with approved plans and disposal codes. |
| Centralised Wastewater Treatment System (CWTS) | The collection of wastewater from homes and commercial facilities in an urban area, that consists , <u>consisting</u> of collection sewers with a centralised treatment and disposal/reuse facility, usually remote from its source or the community. |
| Chemical Oxygen Demand (COD) | A measure of oxygen use equivalent to the portion of organic matter that is susceptible to oxidation by a strong chemical oxidizing <u>oxidising</u> agent. |
| Chlorine residual | The total amount of chlorine remaining in water, sewage, or industrial wastes at the end of a specified contact period following disinfection. |
| Clarifiers | Settling tanks that typically remove settleable solids by gravity. |
| Clay | A textured class of soils consisting of particles less than 0.002 mm in diameter. |
| Coliform bacteria | A group of bacteria predominantly inhabiting the intestines of humans or other warm-blooded animals, but also occasionally found elsewhere. Used as an indicator of human faecal contamination. |
| Colloids | The solids fraction that is described as the finely divided |

suspended matter that will not settle by gravity and yet is too large to be considered dissolved matter.

Decentralised Wastewater Treatment System (DWTS)

The collection, treatment, and disposal/reuse of limited volumes of wastewater, generally from a cluster(s) of dwellings and/or accommodation facilities that are usually located relatively close together, with the wastewater system relatively close to the source (also referred to as "community", "neighbourhood" or "cluster" systems).

Deep ~~Beresbores~~

Deep bores are a form of deep infiltration system, typically around 6 metres deep, used on sites where low permeability surface soils, such as poorly draining clays, are underlain by more permeable subsoil layers at depth.

Denitrification

The biochemical reduction of nitrate or nitrite to gaseous molecular nitrogen, or to an oxide of nitrogen.

Design Irrigation Rate (DIR)

The loading rate that applies to the irrigation of a land ~~disposal~~application area with effluent of a secondary quality. It is expressed in L/m²/week or mm/week. If a spray irrigation system is used, the secondary effluent is subject to continuous disinfection.

Desludging

Removal of the accumulated sludge and scum from the septic tank.

Disinfection

The process of destroying pathogenic and other micro-organisms in wastewater, typically through ~~disposal~~oftreatment by chlorine compounds, ultraviolet light, iodine, ozone, and the like.

Disposal method

The type of land application system (dripper irrigation, trench, bed, mound) sized to the daily wastewater flow and wastewater loading rate for dispersal of treated wastewater into the ground for final treatment.

~~Disposal field~~

~~Shallow, covered, excavation made in unsaturated soil into which pretreated wastewater is discharged through distribution piping for disposal into/onto soil infiltration surfaces through porous media or manufactured (gravel-less) components placed in the excavation. The soil accepts, further treats, and disperses wastewater as it percolates through the soil, ultimately discharging to groundwater.~~

Dissolved Oxygen (DO)

The oxygen dissolved in water, wastewater or other liquid, usually expressed in milligrams per litre (mg/L), parts per million (ppm), or percent of saturation.

Dissolved solids

The fraction of solids dissolved in water.

Distribution ~~Method~~method

The pipe system within the land application system to distribute treated wastewater onto the design infiltration

area.

Domestic

Wastewaterwastewater

Wastewater originating from households or personal activities, including water closets, urinals, kitchens, bathrooms and laundries. Includes such wastewater flows from facilities serving staff/employees/residents in institutional, commercial and industrial establishments, but excluding commercial and industrial wastes, large-scale laundry activities and any stormwater flows.

Drainage

An indication of the local soil wetness conditions likely to occur in most years. Soil wetness is further described as very poorly drained, poorly drained, imperfectly drained, moderately well drained, well drained, and rapidly drained.

- Very poorly drained: water is removed from the soil so slowly that the water table remains at or near the surface for most of the year.
- Poorly drained: All horizons remain wet for the periods of several months.
- Imperfectly drained: Some horizons are wet for periods of several weeks.
- Moderately well drained: Some horizons may remain wet for as long as one week after water addition.
- Well drained: Some horizons may remain wet for several days after water addition.
- Rapidly drained: No horizon is normally wet for more than several hours after water addition.

Dry vault

A chamber that receives and treats human and domestic organic waste using a biological degradation or dehydrating process. The only water used is for cleaning or assisting the biological degradation process.

Effluent

Sewage, water, or other liquid, that is partially or completely treated, or in its natural state, flowing out of a wastewater treatment system or out of a component of a treatment system.

Effluent filter (also called an Outletoutlet filter and an Outletoutlet solids control device)

A removable, cleanable device inserted into the outlet piping of the septic tank that is designed to trap excessive solids that are due to tank upsets and that would otherwise be transported to the sub-surface wastewater infiltration system or other downstream treatment components.

Engineered design

An on-site or cluster system that is designed to meet specific performance requirements for a particular site as certified by a chartered engineer or other qualified person experienced in on-site wastewater treatment and land application systems.

Environment

Surroundings, including natural and physical resources, community and neighbourhood relating to health,

aesthetic, social, economic and cultural conditions.

Environmental Sensitivity

The relative susceptibility to adverse impacts of a water resource or other environments that may receive wastewater discharges.

Eutrophic

A term applied to water that has a concentration of nutrients optimal, or nearly so, for plant or animal growth. In general, nitrogen and phosphorus compounds contribute to eutrophic conditions in coastal and inland fresh waters, respectively.

Evapotranspiration

The combined loss of water from a given area and during a specified period of time by evaporation from the soil or water surface and by transpiration from plants.

Evapotranspiration-seepage bed

A land-disposal system that embodies the principles of evaporation, transpiration and absorption. Also known in Australia as an **Evapo-evapotranspiration** absorption trench, bed or area.

Fabric

The combination of arrangements of individual soil particles into definable aggregates or peds, which are characterised and classified on the basis of size, shape, and degree of distinctness.

Filter cloth

Any durable, permeable textile material suitable for use with soil, rock or earth.

Fixed-film wastewater treatment system

A biological wastewater treatment process that employs a medium such as rock, plastic, wood, or other natural or synthetic solid material that will support biomass on its surface. Fixed film systems include those in which the medium is held in place and is stationary relative to fluid flow, those in which the medium is in motion relative to the wastewater (e.g. rotating biological disk), and dual process systems that include both fixed and suspended biomass together or in a series.

Greywater

Domestic wastewater drained from sinks, tubs, showers, baths, dishwashers, clothes washers, and other non-toilet sources. (Greywater should not contain waste from garbage grinders.)

Groundwater

The separation distance defined as the vertical distance from the base of the land application system to the highest permanent water table level.^[c]

Holding tank

A tank used for holding wastewater prior to pumping out.

Hydrologic conductivity

As applied to soils, the ability of the soil to transmit water in liquid form through pores.

Intermittent Packed Bed Reactor

A single-pass sealed reactor media bed (refer Packed Bed Reactor).

| | |
|---|--|
| Infiltration | Passage of water into soil. |
| Laminar flow | Used to describe flat, sheet-like ground water flows that migrate laterally along the upper surface of a confining layer of soil or rock. |
| Land application system (also called Application System) area | The system used to apply effluent from a wastewater treatment unit into or onto the soils for further in-soil treatment and absorption. <u>Shallow, covered, excavation made in unsaturated soil into which pre-treated wastewater is discharged through distribution piping for application into/onto soil infiltration surfaces through porous media or manufactured (gravel-less) components placed in the excavation. The soil accepts, further treats, and disperses wastewater as it percolates through the soil, ultimately discharging to groundwater.</u> |
| Long term Acceptance Rate Land Application System (also called Application System) | The maximum rate that a land application system can treat primary or secondary used to apply effluent. It allows from a wastewater treatment unit into or onto the soils for loss to the further in-soil by percolation through the base treatment and sidewalls of the disposal system and other losses to the atmosphere by evaporation and evapotranspiration absorption. |
| Long term acceptance rate | <u>The maximum rate at which a land application system can treat primary or secondary effluent. It allows for loss to the soil by percolation through the base and sidewalls of the disposal system, and other losses to the atmosphere by evaporation and evapotranspiration.</u> |
| Mineralisation | The conversion of an element from an organic form to an inorganic state as a result of microbial decomposition. |
| Mottling | Spots or blotches of different colours or shades of colour interspersed with the dominant soil colour, caused in part by exposure to alternating unsaturated and saturated conditions. |
| Nitrate NO₃ | The oxidised form of nitrogen, and the form most readily absorbed by plants. |
| Nitrification | The biochemical oxidation of ammonium to nitrate. |
| On-site wastewater treatment system On-site Wastewater Treatment System (OWTS) | The collection, treatment, and disposal/reuse of wastewater from an individual home or commercial facility on the same property as it is (OWTS) generated. |
| Organic nitrogen | Nitrogen combined in organic molecules such as proteins and amino acids. |
| Organic soil | A soil <u>Soil</u> that contains a high percentage of organic |

| | |
|---|---|
| | matter (more than 15 to 20%) throughout the soil column. |
| Outlet filter (Also call Effluent <u>also called effluent filter</u>) | A removable, cleanable device inserted into the outlet piping of the septic tank <u>that is</u> designed to trap excessive solids <u>arising</u> due to tank upsets <u>and</u> that would otherwise be transported to the sub-surface wastewater infiltration system or other downstream treatment components. |
| Package plant | Term commonly used to describe an aerobic treatment unit (refer also AWTs systems) but can include any custom built secondary or advance <u>advanced</u> secondary treatment system. Can be a standard built plant that is <u>has</u> similar design for many sites or custom made <u>and</u> specifically designed to serve a particular situation, e.g. involving multiple dwellings or accommodation facilities. |
| Packed Bed Reactor | A sealed reactor media bed (usually layered sand and gravel) with an under drain collection. Screened effluent is applied to the top of the reactor media in small precise timer controlled doses via a piped distribution system, <u>to</u> provide for a thin film flow through the bed reactor. |
| Particle size | The effective diameter of a particle, usually measured by sedimentation or sieving. |
| Particle size distribution | The amounts of the various soil size fractions in a soil sample, usually expressed as weight percentage. |
| Pathogenic | Causing disease, commonly applied to micro-organisms that cause infectious disease. |
| Ped | An element of soil structure. Peds are lumps of soil that can be separated from each other by hand. Void spaces between peds control the passage of water through the soil. |
| Perched water table | The permanent or temporary water table of a discontinuous saturated zone in a soil, into which groundwater drains. |
| Percolation | The flow or trickling of a liquid downward through a contact of filtering medium. |
| Permeability | Ability of a porous medium such as soil to transmit fluids or gases. |
| pH | A term used to describe the hydrogen ion activity of a <u>system solution, which provides a measure of its acidity or basicity.</u> |
| Plastic soil | A soil capable of being moulded or deformed continuously and permanently by relatively moderate pressure. |

| | |
|---|--|
| Platy structure | Laminated or flaky soils aggregate developed predominantly along the horizontal axes. |
| Primary treatment system | The separation of suspended material from wastewater by settlement and/or floatation in septic tanks, primary settling chambers etc. prior to effluent discharge to either a secondary treatment process or to a land application system. |
| Population equivalent | The ratio of the total quantity of wastewater produced to that defined as being equivalent to that produced by one person. |
| Producer statement | A written declaration by a person responsible for an activity/product/process, setting out the performance requirements, how these are to be met and the measures required in a assessment of their effectiveness. |
| Recycle | The beneficial reuse of tertiary treated wastewater, usually for toilet flushing purposes only. |
| Recirculating Packed Bed Reactor | A multiple pass sealed reactor media bed (refer Packed Bed Reactor). The recirculating ratio is typically at 1 to 3 to 1 to 5. |
| Regulatory authority (RA) | The level of government that establishes and enforces codes related to the permitting, design, placement, installation, operation, maintenance, monitoring, and performance of on-site wastewater treatment systems. |
| Reserve area | An area set aside for future use as a land application area to replace or extend the original land application system. |
| Residuals | The solids generated and retained during the treatment of domestic sewage in treatment system components, including sludge, scum, and pumping from grease traps, septic tanks, aerobic treatment units, and other components of an on-site or cluster system. |
| Reuse | The beneficial reuse of treated wastewater (usually secondary treated) to irrigation lawns and gardens, typically by pressure compensating dripper irrigation. |
| Sand filter | A packed bed filter of sand or other granular materials used to provide advanced secondary treatment of settled wastewater or septic tank effluent. Sand/media filters consist of a lined (e.g. impervious PVC liner on sand bedding) excavation or structure filled with uniform washed sand that is placed over an under-drain system. The wastewater is dosed onto the surface of the sand through a distribution network and allowed to percolate through the sand to the under-drain system, which collects the filter effluent for further processing or |

disposal.

| | |
|---------------------------------|--|
| Scum | The floating mass of wastewater solids buoyed up by entrained gas, grease or other substances which form an accumulating layer on the liquid surface inside the treatment tank. |
| Secondary treatment | Aerobic biological treatment process, including settling and/or filtering of wastewater. Secondary treated wastewater is expected to be equal to or better than 20 g/m ³ five-day biochemical oxygen demand and 30 g/m ³ suspended solids. Systems that can provide secondary treatment include well designed and operated, stabilised aerated treatment plants (refer AWTS), usually based on extended aeration activated sludge processes and <u>which</u> can also include sand filters, advanced textile filters, packed bed reactors (refer to <u>advanced secondary treatment systems</u> <u>Advanced Secondary Treatment Systems</u>). |
| Septage | The liquid, solid, and semisolid material that results from wastewater pre-treatment in a septic tank, which is removed from the system by pump-out/desludging operations. |
| Septic tank | A buried, watertight tank designed to receive and partially treat raw wastewater by allowing solids separation from the liquid phase and the decomposition of the retained organic matter by anaerobic bacteria, forming dissolved fatty acids and gases. Settleable solids settle to the bottom, forming a sludge layer <u>and</u> , <u>while</u> grease and other light materials float to the top, forming a scum layer. Tanks are normally vented to enable release of the gases generated during liquefaction of the solids. |
| Sequencing batch reactor | A sequential suspended growth (activated sludge) process in which all major steps occur in the same tank in sequential order. Sequencing batch reactors include intermittent-flow batch reactors and continuous-flow systems. |
| Setback | The distance that a wastewater system must be situated from any facility boundary, water body or other limiting factor. |
| Settleable solids | Matter in wastewater that will not stay in suspension during a designated settling period. |
| Sewerage | The network of collection drains that carry domestic wastewater or effluent away from the properties of origin for off-site treatment. |
| Silt | A textural class of soil consisting of particles between 0.05 and 0.002 millimetres in diameter. |

| | |
|---|---|
| <u>Site Assessment</u> | An evaluation of site and soil characteristics, and the identification of site constraints. Also includes other environmental, public health, legal and economic factors to be considered prior to the determination of wastewater treatment and land application system options. |
| <u>Site assessment</u> | |
| Slickensides | The skin or coating formed on (usually) large units of soil, which will show striations or grooves resulting from the periodic rubbing together of the soil units due to shrinkage and swelling in response to moisture change. |
| Sludge | The semi-liquid solids settled from wastewater. |
| Soil absorption zone | The volume of soil that is required to filter, isolate and absorb wastewater micro-organisms, nutrients and particles. For normal soils, the zone path length required is at least 0.6 m to 1.2 m. For sandy soils, greater volumes of soil may be required. For sandy soils greater volumes of soil may be required. |
| Soil horizon | A layer of soil or soil material approximately parallel to the land surface and different from adjacent layers in physical, chemical, and biological properties or characteristics such as colour, structure, texture, consistence and pH. |
| Soil map | A map showing the distribution of soil types or other soil mapping units in relation to the prominent physical and cultural features of the earth's surface. |
| Soil morphology | The physical constitution, particularly the structural properties, of a soil profile as exhibited by the kinds, thickness, and arrangement of the horizons in the profile and by the texture, structure, consistency, and porosity of each horizon. |
| Soil permeability | A calculated value derived from the rate at which a head of liquid is absorbed into soil, usually measured in m/day as K_{sat} . |
| Soil survey | The systematic examination, description, classification, and mapping of soils in an area. |
| Soil texture | The relative proportions for the various soil separates (e.g. silt, clay, sand) in a soil. |
| Soil water | A general term emphasising the physical rather than the chemical properties and behaviour of the soil solution. |
| Subsoil | In general, that part of the soil below the depth of ploughing. |
| <u>Sub-surface wastewater infiltration system (SWIS)</u> | An underground system for dispersing and further treating pre-treated wastewater. The SWIS includes the distribution piping/units, any media installed around or |
| <u>Subsurface</u> | |

| | |
|--|--|
| <u>Wastewater Infiltration System (SWIS)</u> | below the distribution components, the biomat at the wastewater-soil interface, and the unsaturated soil below. |
| Terrain-soil map unit | An individual mapped area (polygon), which that contains a definable slope or group of soils, which require individual soils evaluation prior to use as a land application area. |
| Textile Packed Bed Reactor (also known as Textile Filter) | A sealed reactor media bed (textile) with an under-drain collection, in which engineered textile media replaces the sand and gravel layers used in other forms of packed bed reactors. The effluent is uniformly dosed through a surface pressure distribution system using a timer-controlled dosing regime. |
| Topsoil | The layer of soil moved in agricultural cultivation. |
| Total Kjeldahl Nitrogen (TKN) | The sum of the total organic nitrogen component plus ammonia. |
| Total Nitrogen (TN) | The sum of the organic nitrogen, ammonia, nitrite and nitrate. |
| Unsaturated flow | Movement of water in a soil that is not filled to capacity with water. |
| Wastewater | The contaminated water produced from domestic activities in dwellings, institutions, or commercial or public facilities, consisting of all waste, greywater or and blackwater. Also defined as foul water in the New Zealand Building Code. |
| Water quality-based performance requirement | A specific, measurable, and enforceable standard that establishes limits for pollutant concentrations or mass loads in treated wastewater discharged to ground water or surface waters. |
| Water table | The level in saturated soil at which the hydraulic pressure is zero. |
| Watercourse | A stream that: <ol style="list-style-type: none">1. Has visible bed and banks, i.e. an eroded channel of any size, but not a defined non-eroded grassy course or drainage depression; and2. Is partially fed with water from some source other than or in addition to surface water run-off. |
| Wetland | A system that can provide further treatment of effluent and consists of a bed or rock of other durable media, in which wetland plants are grown. |

Source: Auckland Regional Council TP58 (2004).

APPENDIX 2
SOIL DESCRIPTION

~~Source: Auckland Regional Council TP58 (2004).~~

SOURCED FROM TP58 (2004) Auckland Regional Council Technical Sheet D-1 ASSESSMENT OF SOIL CHARACTERISTICS

FORMATION OF SOILS

Soils are formed as a result of weathering of the parent material from which they are derived. Five key factors determine the nature of the soil profile at any location:

- The type of parent material (which determines soil physical and chemical properties).
- Climate, particularly rainfall and seasonal temperature fluctuations, as these affect the rate and extent of weathering, and also the accumulation and breakdown of organic matter in the soil.
- Living matter such as vegetation and micro-organisms which have significant influence on the weathering process and contribute to the organic content of soil.
- Topography influences the effects of climate; elevated sloping areas drain better than low lying flat locations; slopes with a northern aspect have higher soil temperatures than those with a southern aspect; steepness affects erosion and deposition of soil layers.
- Soil age affects soil profile; older soils have well-developed profiles compared to younger soils (the soil forming process evolves over thousands of years of geological time, it being estimated that approximately ~~one hundred~~100 years of weathering is required to accumulate 25 mm of soil from a parent material).

SOIL TYPE AND PROFILE

The two main types of soils are "mineral" and "organic". Mineral soils are mainly weathered parent material with a small proportion of decayed plant and animal matter. For example, a silt loam soil suitable for plant growth would consist of 45% mineral particles, 5% organic matter, 25% air, and 25% water (by volume). Organic soils are those consisting of mainly decayed plant material such as occurs in swamps, bogs, marshland or peat lands.

The soil profile consists of the mainly unconsolidated material at the land surface ~~which~~that is utilised for growing crops and supporting structures, and which assimilates and transmits rainfall and constituents of wastes from animal and human activity. Three significant layers make up the soil profile:

The A Horizon – comprises the uppermost layer of most weathered material in which the bulk of the physical, chemical and biological activity in the soil takes place.

The B Horizon – is a transitional layer to which the very fine particles resulting from weathering will migrate and accumulate (e.g. clays).

The C Horizon – is the unweathered layer which most resembles the original parent material from which the soil has been formed, and as such is the zone of least activity in the soil.

In any soil situation the actual soil profile may be made up of a range of horizons as affected by the time history of soil formation and the combination and dominance of the five soil-forming factors outlined above.

SOIL TEXTURE

Texture is determined by the proportions of the three principal mineral size fractions in soil - these fractions are clay, silt, and sand. The United States Department of Agriculture (USDA) classification of size fractions ~~are~~ is the most commonly utilised in on-site wastewater practice. The USDA textural classification (Figure D1) is based upon the following particle size ranges:

Fraction Particle Diameter mm

| | |
|------------------|-----------------|
| Clay | less than 0.002 |
| Silt | 0.002 to 0.05 |
| Very fine sand | 0.05 to 0.10 |
| Fine sand | 0.10 to 0.25 |
| Medium sand | 0.25 to 0.50 |
| Coarse sand | 0.50 to 1.00 |
| Very coarse sand | 1.00 to 2.00 |
| Fine gravel | > 2.00 |

Either laboratory sieve analysis or a field method based upon "feel" of the soil can be used to determine texture. The following explanation of the "feel method" is taken from guidelines prepared by the University of Minnesota Agricultural Extension Service:

First, a large marble-sized portion of soil is moistened and then kneaded by hand until it has the consistency of putty. Then, the ball of soil is squeezed between thumb and forefinger so that by pushing the thumb forward over the forefinger a ribbon of soil is formed. The nature of any ribbon that forms (or does not form) indicates the soil textural class. Six general textural classes can be readily distinguishable by this technique –

Clay: Fine-textured soil that usually forms hard lumps or clods when dry and is quite plastic when wet. It can be very sticky when wet. When moist it can be squeezed into a long flexible ribbon. A clay soil leaves a "slick" surface when rubbed with a long stroke and firm pressure. Clay also tends to hold thumb and forefinger together due to its stickiness.

Clay Loam: Fine textured soil which usually breaks into clods or lumps that are hard when dry. When moist soil is squeezed, it will form a thin ribbon which will break readily, barely sustaining its own weight. The moist soil is plastic and will form a cast which will bear more handling. When hand kneaded it does not crumble readily, but tends to become a heavy, compact mass.

Silt Loam: When dry, may appear quite freely cloddy, but lumps are readily broken; when squeezed, it feels soft and floury. When wet, the soil readily

runs together. Either dry or moist, it will form casts which can be handled freely without breaking, and when moistened and squeezed, it will not ribbon, but will have a broken effect.

Loam: Has a relatively even mixture of sands, silt and clay. A loam feels somewhat gritty, yet fairly smooth and highly plastic. Squeezed when moist, it will form a cast which can be handled quite freely without breaking, and it will not form a ribbon.

Sandy Loam: Contains much sand, but has enough silt and clay to make it somewhat sticky. Individual sand grains can be seen readily and felt. Squeezed when dry, it will form a cast which will fall apart. Squeezed when moist it will form a cast which will bear careful handling without falling apart.

Sandy: Loose and single grained. The individual grains can be readily seen or felt. Squeezed in the hand when dry, it will fall apart when the pressure is released and will not form a ribbon. Squeezed when moist, it will form a cast, but will crumble when the pressure is released.

Soil texture influences its permeability, aeration potential, and capacity to store water and nutrient salts, all of which affect the soils' ability to assimilate and rejuvenate wastewater components. Soil texture thus has a significant influence on determining design loading rates for on-site systems.

SOIL STRUCTURE

The hydrologic conductivity of a soil is significantly affected by ~~the~~its structure ~~of a soil. By structure. Structure is meant~~ the aggregation of soil mass into lumps known as "peds" which can be separated from each other by hand. The surfaces of "peds" will be planar in nature and void spaces between "peds" influence the passage of water through the soil, particularly in clayey soils. Common soil structural elements are "prismatic", "columnar", "blocky", "platy", and "granular". Structure may have a more significant effect on water movement in the soil than texture. For example "platy" structures are resistant to vertical water movement, but facilitate horizontal movement. "Blocky" structure in clay soils during dry weather shrinkage can provide high vertical transmission rates, but when wetted and swelled, will resist passage of water. Granular soils tend to be structureless and water movement is solely a function of texture. Aeration of subsoil is also affected by structure as is natural drainage through the subsoil.

WATER TABLE DETERMINATION

Soil colour and colour patterns are a good indication of the drainage characteristics of a soil and the seasonal variation in water table. Colour is influenced by the primary soil nature, the level of iron and manganese oxides present, and any organic content. Well drained soils above the water table are generally uniformly red, yellow, or brown in colour. Soils permanently (or nearly permanently) saturated are usually grey or blue in colour. Soils subjected to seasonal saturation can be speckled with different colours, known as mottles. Mottles indicate zones of saturated soil under winter conditions when complex biochemical reactions leach solubilised iron and manganese oxides from the soil, turning it grey in patches. Hence mottled soil


under unsaturated conditions indicates periodic saturation. It should be noted, however, that not all soils show mottles under saturation, and landscape position and other soil characteristics may be needed to properly interpret the local situation.

Hence, although the water table depth may be fixed by borehole investigation, that result must then be interpreted relative to the season of the year, the degree of soil mottling from the soil profile, and landscape position.

SELECTION OF SOIL CATEGORY

The estimation of soil category for design purposes (Section 5.4 of [TP-TP58](#) and Section 4.3 of Appendix E [of TP58](#)) should be made on the basis of textural and structural assessment of the soil profile along with all other relevant site information. Traditional on-site practice has been to identify a suitable permeable layer of subsoil at depth below the A Horizon and to construct media filled trench (or bed) systems to load ponded effluent through the base of the trench (or bed) system.

It is now recognised that the biologically active A Horizon provides better opportunity for assimilation of effluent organic matter and nutrient salts while at the same time taking advantage of the infiltration and percolation capacity of the underlying subsoil, and the evapo-transpiration potential of planted vegetation. Design techniques which utilise the KISS (keep infiltration systems shallow) approach can take advantage of the disposal capacity of the upper soil/topsoil layer and match the selection of soil category for proposed disposal purposes with the design approach.

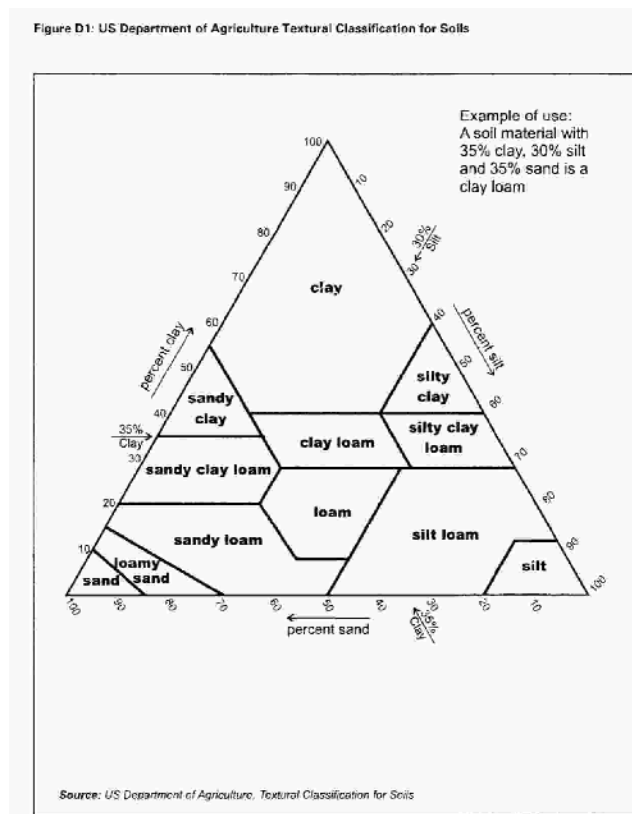

APPENDIX 3
ON-SITE WASTEWATER DISPOSAL SITE EVALUATION
INVESTIGATION CHECKLIST

ON-SITE WASTEWATER DISPOSAL SITE EVALUATION INVESTIGATION CHECKLIST

(Based on Auckland Regional Council TP58 (2004) Appendix E).

PART A: Contact Details

1. Applicant Details:

| | | | |
|------------------------|---------------|---------|--|
| Applicant Name: | | | |
| Company Name | | | |
| | First Name(s) | Surname | |
| Property Owner Name(s) | | | |
| | | | |
| | | | |
| Nature of Applicant* | | | |

(*i.e. owner, lessee, prospective purchaser, developer)

2. Consultant/Site Evaluator Details:

| | | | | |
|------------------------|----------|--|---------|--|
| Consultant/Agent Name | | | | |
| Postal Address | | | | |
| | | | | |
| Phone Number | Business | | Private | |
| | Mobile | | Fax | |
| Name of Contact Person | | | | |
| E-mail Address | | | | |

3. Are there any previous existing discharge consents relating to this proposal or other waste discharge/disposal on the site?

Yes No (Please tick)

If yes, give Reference Number(s) and Description

| |
|--|
| |
| |

4. List any other consents in relation to this proposal and indicate whether or not they have been applied for: If so, specify Application Details and Consent No.): (e.g. water permit, land use consent, subdivision consent)

| |
|--|
| |
| |
| |

PART B: Property Details

1. Property for which this application relates:

| | |
|---|--|
| Physical Address of Property | |
| Territorial Local Authority | |
| Regional Council Area | |
| Legal Status of Activity | Permitted: Controlled: Discretionary: |
| Relevant Regional Rule(s) | |
| Total Property Area (m ²) | |
| Map Grid Reference of Property (NZMS 260) | |

2. Legal description of land (as shown on Certificate of Title):

| | | | | | |
|-----------------|--|--------|--|--------|--|
| Lot No. | | DP No. | | CT No. | |
| Other (specify) | | | | | |

Please attach copy of Certificate of Title.

PART C: Site Assessment: Surface Evaluation

Note: Underlined terms defined in section 2 of this manual

1. Has a desk study been undertaken for this property?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If yes, please specify the findings of the desk study and if not please specify why this was not considered necessary.

| |
|--|
| |
| |
| |

2. Has a slope stability assessment been carried out on the property?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If No, why not?

| |
|--|
| |
| |
| |

If Yes, please give details of report:

| | |
|--------------------------------------|--|
| Author | |
| Company/Agency | |
| Date of Report | |
| Brief Description of Report Findings | |
| | |
| | |
| | |

3. Site Characteristics

Provide descriptive details below:

| |
|---|
| Performance of Adjacent Systems: |
| |
| |
| Estimated Rainfall and Seasonal Variation: |
| |
| |
| Vegetation Cover: |
| |
| |
| Slope Shape: |
| |
| |
| Slope Angle: |
| |
| |
| Surface Water Drainage Characteristics: |
| |
| |
| Flooding Potential: YES/NO |
| |
| |
| If yes, specify relevant flood levels on appended site plan, i.e. one in 5 year and/or 20 year and/or 100 year return period flood level, relative to <u>disposal and application</u> area. |
| Surface Water Separation: |
| |
| |
| Site Clearances (Provide general description here and specific dimensions in Part 6 below and on Site Plan: |
| |
| |
| Site Characteristics: |
| |
| |

4. Site geology of the subject property

| | |
|--|--|
| | |
| | |
| | |

| | |
|---------------------------------|--|
| Geological Map Reference Number | |
|---------------------------------|--|

5. What aspect(s) does the proposed disposal system face (please tick)?

| | | | |
|-------------------|--------------------------|-------------------|--------------------------|
| North | <input type="checkbox"/> | West | <input type="checkbox"/> |
| North-West | <input type="checkbox"/> | South-West | <input type="checkbox"/> |
| North-East | <input type="checkbox"/> | South-East | <input type="checkbox"/> |
| East | <input type="checkbox"/> | South | <input type="checkbox"/> |

6. Site clearances, which should be also shown on the site plan:

| Separation distance from | Treatment Plant Separation Distance (m) | Disposal Field Separation Distance (m) |
|-----------------------------|---|--|
| Boundaries | | |
| Surface Water | | |
| Stands of Trees/Shrubs | | |
| Wells, water bores | | |
| Embankments/retaining walls | | |
| Buildings | | |
| Other (specify): | | |

PART D: Site Assessment: Subsoil Investigation

Note: Underlined terms defined in Table 2.

1. Please identify the soil profile determination method:

| | | | | |
|-----------------------|-----|-----------------|-------------------|---------------|
| Test Pit | | (Depth _____ m) | No. of Test Pits | |
| Bore Hole | | (Depth _____ m) | No. of Bore Holes | |
| Other (specify) | | | | |
| Soil Report Attached? | Yes | | No | |
| | | | | (Please Tick) |

2. Was fill material intercepted during the subsoil investigation?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If yes, please specify the effect of the fill on wastewater disposal

| | |
|--|--|
| | |
| | |
| | |

3. Has percolation testing been carried out?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If yes, please specify the method

| | | | | | |
|-------------------------------------|--------------------------|-----|--------------------------|----|--------------------------|
| | | | | | |
| | | | | | |
| | | | | | |
| Test Report Attached? (Please tick) | <input type="checkbox"/> | Yes | <input type="checkbox"/> | No | <input type="checkbox"/> |

4. Are surface water interception drains required?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If Yes, please show on site plan

5. Please state the depth of the seasonal water table:

| | | | |
|----------------------------------|--------------------------|--------------|--------------------------|
| Winter | <input type="text"/> | (m) | |
| Summer | <input type="text"/> | (m) | |
| Please indicate whether measured | <input type="checkbox"/> | or estimated | <input type="checkbox"/> |

(please tick)

6. Are there any potential short circuit paths?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If yes, please explain how these have been addressed

| | | | |
|--|--|--|--|
| | | | |
| | | | |

7. Based on results of subsoil investigation above please indicate the disposal field soil category

| | | | | |
|---------------------|--------------------------|-----------------------|----------------------|-----|
| Is Topsoil Present? | <input type="checkbox"/> | If so, Topsoil Depth? | <input type="text"/> | (m) |
|---------------------|--------------------------|-----------------------|----------------------|-----|

| Soil Category | Description | Drainage | Tick One |
|---------------|--|---------------------------|--------------------------|
| 1 | Gravel, coarse sand | Rapid draining | <input type="checkbox"/> |
| 2 | Coarse to medium sand | Free draining | <input type="checkbox"/> |
| 3 | Medium-fine and loamy sand | Good drainage | <input type="checkbox"/> |
| 4 | Sandy loam, loam and silt loam | Moderate drainage | <input type="checkbox"/> |
| 5 | Sandy clay-loam, clay loam and silty clay-loam | Moderate to slow drainage | <input type="checkbox"/> |
| 6 | Sandy clay, non-swelling clay and silty clay | Slow draining | <input type="checkbox"/> |
| 7 | Swelling clay, grey clay, hardpan | Poorly or non-draining | <input type="checkbox"/> |

Reasons for placing in stated category

| |
|--|
| |
| |
| |
| |
| |
| |
| |

PART E: Discharge Details

1. Water supply source for the property (please tick):

| | | |
|-----------------------------|--|--|
| Bore/well | | |
| Rainwater (roof collection) | | |
| Public supply | | |

2. Calculate the maximum daily volume of wastewater to be discharged, unless accurate water meter readings are available

| | | |
|-----------------------------------|--|-----------------------------|
| Number of bedrooms | | |
| Design Occupancy | | (number of people) |
| Per capita Wastewater Production | | (Litres per person per day) |
| Other - Specify | | |
| | | |
| Total Daily Wastewater Production | | (Litres per day) |

3. Do you propose to install:

| | | |
|--------------------------------|-----|--|
| a) Water Conservation Devices? | Yes | |
| b) Water Recycling – what %? | % | |

| | | |
|----|--|---------------|
| No | | (Please tick) |
| No | | (Please tick) |

If you have answered Yes, please provide additional information including the estimated reduction in water usage:

| |
|--|
| |
| |
| |

4. Is Daily Wastewater Discharge Volume more than 2000 litres:

| | | | | |
|-----|--|----|--|---------------|
| Yes | | No | | (Please tick) |
|-----|--|----|--|---------------|

NoteNOTE: if the answer to the above is ~~yes~~ an HRC Yes a wastewater discharge permit from Horizons Regional Council will be required.

5. Is a Horizons Regional Council Discharge Consent Required?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

PART F: Primary Treatment

1. Please indicate below the number and capacity (litres) of all septic tanks including type (single/dual/grease traps) to be installed or currently existing:

| Number of Tanks | Type of Tank | Capacity of Tank (Litres) |
|-----------------|--------------|---------------------------|
| | | |
| | | |
| | | |
| | | |
| Total Capacity | | |

2. Is a Septic Tank Effluent Outlet Filter to be installed?

| | | | | |
|-----|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|----|--------------------------|---------------|

If Yes, please state the type

| |
|--|
| |
| |

PART G: Secondary and Tertiary Treatment

1. Please indicate the type of additional treatment, if any, proposed to be installed in the system (please tick):

| | | |
|------------------------------|--------------------------|---------|
| Secondary Treatment | <input type="checkbox"/> | Specify |
| Home aeration plant | <input type="checkbox"/> | |
| Commercial aeration plant | <input type="checkbox"/> | |
| Intermittent sand filter | <input type="checkbox"/> | |
| Recirculating sand filter | <input type="checkbox"/> | |
| Recirculating textile filter | <input type="checkbox"/> | |
| Clarification tank | <input type="checkbox"/> | |
| Tertiary Treatment | <input type="checkbox"/> | |
| Ultraviolet disinfection | <input type="checkbox"/> | |
| Chlorination | <input type="checkbox"/> | |
| Other | <input type="checkbox"/> | |
| | | |

PART H: Disposal Method

1. Please indicate the proposed loading method (please tick):

| | |
|---------------|--|
| Gravity | |
| Pump | |
| Dosing Siphon | |

2. Is a high water level alarm being installed in all pump chambers?

| | | | | |
|-----|--|----|--|---------------|
| Yes | | No | | (Please tick) |
|-----|--|----|--|---------------|

3. If a pump is being used, please provide the following information:

| | | |
|--|--|----------|
| Total Design Head <u>head</u> | | (m) |
| Pump Chamber <u>Volume Pump chamber</u> | | (Litres) |
| Emergency Storage <u>Volume storage volume</u> | | (Litres) |

4. Please identify the type(s) of disposal method proposed for this site (please tick):

| | |
|---|--|
| Surface Dripper <u>Irrigation Surface dripper</u> <u>irrigation</u> | |
| Sub-surface Dripper <u>Irrigation Subsurface dripper</u> <u>irrigation</u> | |
| Standard Trench <u>Standard</u> <u>trench</u> | |
| LPED shallow trench <u>LPED</u> <u>shallow trench</u> | |
| Mound <u>Mound</u> | |
| Evapo-transpiration <u>Beds Evapotranspiration</u> <u>beds</u> | |
| Other (Please Specify) <u>Other</u> <u>(please specify)</u> | |

5. Please identify the loading rate you propose for the option selected in Part H, Section 4 above, stating the reasons for selecting this loading rate

| | | |
|---|-------|------------------------------|
| Loading Rate <u>rate</u> | | (Litres/m ² /day) |
| Disposal Area <u>application area</u> | Basal | (m ²) |
| | Areal | (m ²) |

Explanation

| |
|--|
| |
| |
| |
| |
| |
| |

6. What is the proposed reserve wastewater disposal area:

| | |
|--|--|
| Reserve Disposal Area land application area (m ²) | |
| Percentage of Primary Disposal Area primary land application area (%) | |

7. Please provide a detailed description of the design and dimensions of the disposal field, including a detailed plan of the field relative to the property site:

Description and ~~Dimensions~~ dimensions of ~~Disposal Field~~ disposal field

| |
|--|
| |
| |
| |
| |

Plan Attached Yes No (Please tick)

If not explain why not

| |
|--|
| |
| |

PART I: Maintenance and Management

1. Has a maintenance agreement been made with the treatment and disposal system suppliers?

Yes No (Please tick)

PART J: Assessment of Environmental Effects

1. Is an ~~assessment~~ Assessment of ~~environmental~~ ~~effects~~ Environmental Effects (AEE) included with the application?

| | | | | | |
|-----|--------------------------|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|--------------------------|----|--------------------------|---------------|

2. Are there any specific environmental constraints?

| | | | | | |
|-----|--------------------------|--------------------------|----|--------------------------|---------------|
| Yes | <input type="checkbox"/> | <input type="checkbox"/> | No | <input type="checkbox"/> | (Please tick) |
|-----|--------------------------|--------------------------|----|--------------------------|---------------|

If Yes, please explain

| |
|--|
| |
| |

PART K: Is your application complete?

1. In order to provide a complete application have you remembered to:

| |
|--|
| Fully Complete this Assessment Form <u>Fully complete this assessment form</u> |
| Include a Location Plan and Site Plan (with Scale Bars) <u>Include a location plan and site plan (with scale bars)</u> |
| Enclose a Property Title <u>Enclose a property title</u> (Certificate of Title) |
| Attach an Assessment of Environmental Effects (AEE) |

| |
|--|
| |
| |
| |
| |

2. Declaration

I hereby certify that, to the best of my knowledge and belief, the information given in this application is true and complete.

| | | | |
|-----------------|--|------------------|--|
| Name | | Signature | |
| Position | | Date | |



11-15 Victoria Avenue
Private Bag 11 025
Manawatu Mail Centre
Palmerston North 4442

T 0508 800 800
F 06 952 2929
help@horizons.govt.nz
www.horizons.govt.nz